# ICS
# MAINTENANCE SUBNET
# (FOR REMOTE POWER REBOOT AND TERMINAL SERVICE)

## NOTES:

* WILL BE MOVED FROM FE TEMPORARY CONTROL ROOM TO CLO CENTRAL EQUIPMENT ROOM ROOM WHEN CLO BUILDING BECOMES AVAILABLE

## KEY:

- RS-232 OR RS-422
- FAST ETHERNET (100BASE-TX)
- FAST ETHERNET (FIBER) (100BASE-FX)
- GIGABIT ETHERNET (1000BASE-SX or -LX)
- FUTURE; NOT INSTALLED UNTIL PHASE "B" OR LATER
- TX/FX — CONVERTER, 100BASE-TX TO 100BASE-FX
- R&TS — REBOOTER AND TERMINAL SERVER

## DEVICE NAMES:

CoreSw = Core Network switch
NetSw = Network switch
RTS = "Rebooter & Terminal Server" (Rabbit 2000 Single Bd Computer)

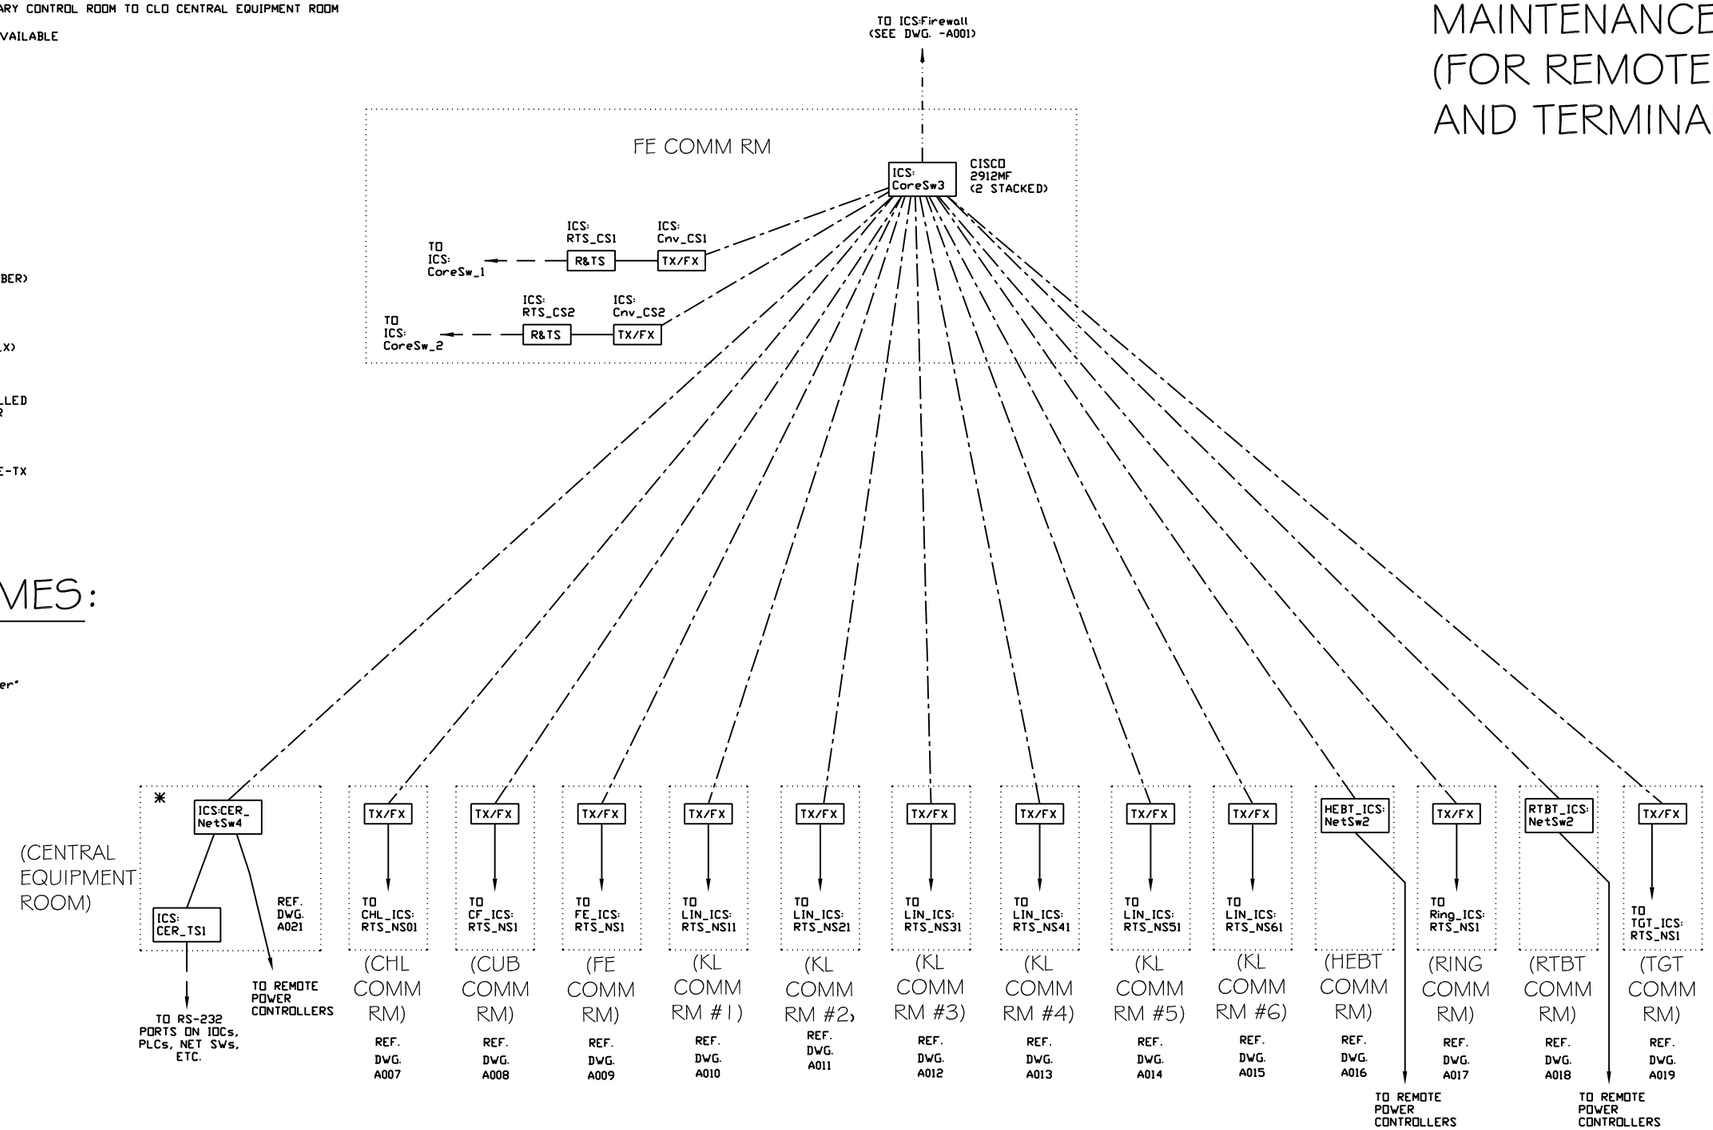


07.31.01

| REV | DESCRIPTION | BY | CHK | SECT | DEPT | DATE |
|---|---|---|---|---|---|---|
| | | | | | | |
| | | | | | | |
| | | | | | | |
| 0 | ISSUED FOR APPROVAL | BD | | | | 07.10.01 |
| A | PRELIMINARY | HRE | --- | --- | --- | 01.24.01 |

REVISION OR ISSUE PURPOSE — REVISION APPROVALS

| DRAWING APPROVALS | | DATE |
|---|---|---|
| DES | BILL DEVAN | 01.24.01 |
| DWN | RICHARD EPPS | 01.24.01 |
| CHK | | |
| L3TL | | |
| LE | | |
| STL | | |

Oak Ridge National Laboratory
operated for the DEPARTMENT OF ENERGY under U.S. GOVERNMENT contract DE-AC-05-00OR22400
Oak Ridge, Tennessee
SNS Spallation Neutron Source

ICS MAINT SUBNET
RMT PWR REBOOT/TRM SVR

DRAWING NUMBER: 109020100-R8D-8000-A002
REV: 0