


## GENERAL NOTES

1. COORDINATE EXACT LOCATION OF EACH LIGHTING FIXTURE WITH CABLE TRAY LAYOUTS AND AIR DUCT LAYOUTS.
2. FIXTURES SHALL BE LOCATED AT THE SAME ELEVATION IN EACH ROOM, UON.
3. FOR LIGHTING PANEL SCHEDULES SEE DWG E9.21.34
4. FOR LIGHTING FIXTURE SCHEDULES SEE DWG E9.30.01
5. PROVIDE 2" RIGID GALVANIZED STEEL SLEEVES FOR ALL CONCRETE CEILING AND WALL CONDUIT PENETRATIONS.

## SHEET KEYNOTES:

N001 SEE DWGS. E8.10.32 & E8.10.33 FOR STAIRS NO.1, 2, 5, 6, 7 & 8 SECTIONS

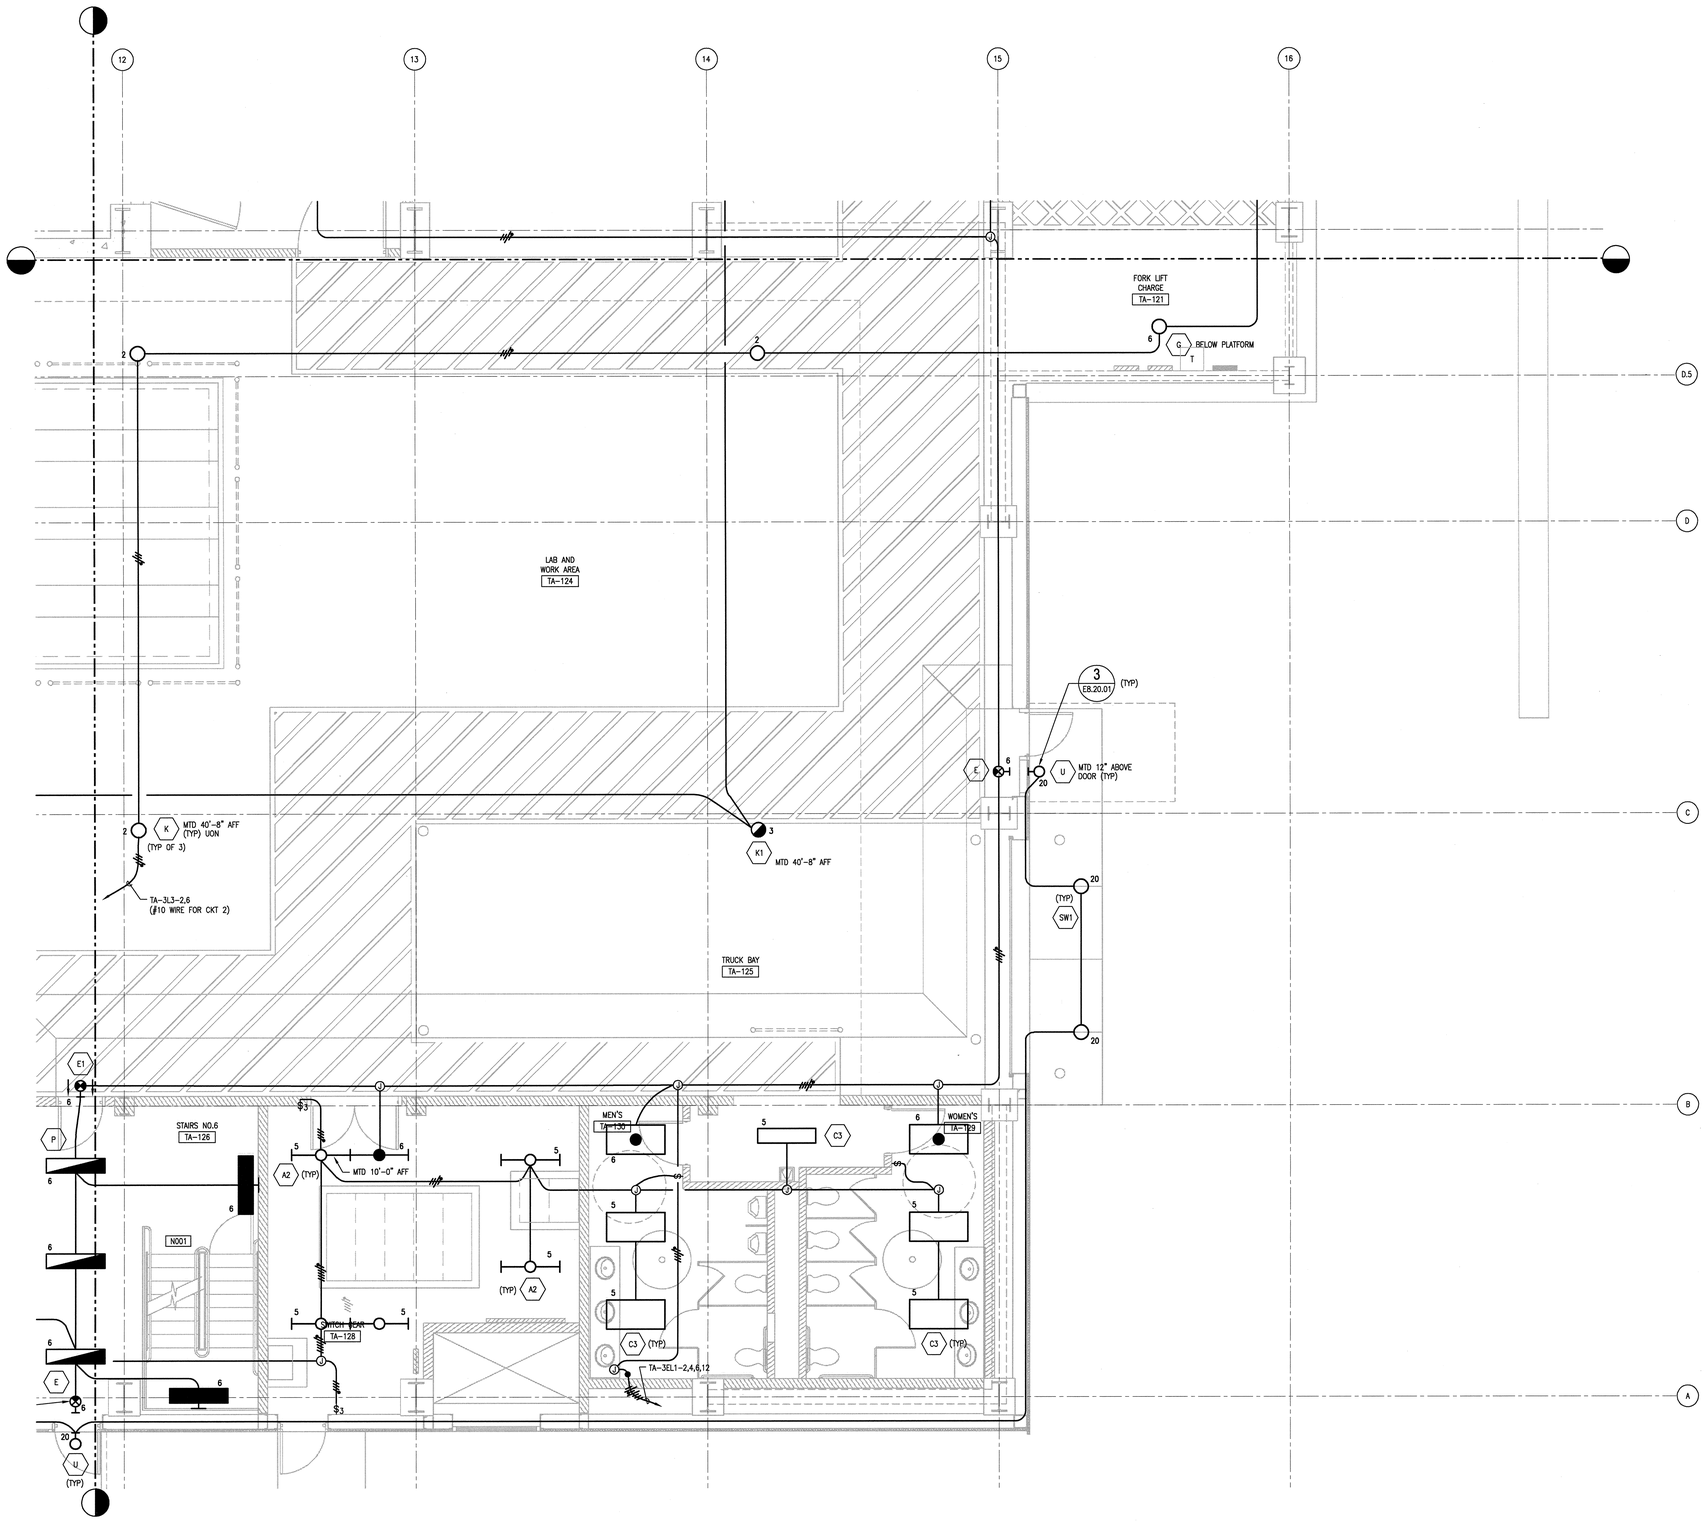


108030700-E8E-8700-A021

Knight/Jacobs Joint Venture
701 Scarboro Road, MS 8253
Oak Ridge, TN 37830
865-241-9433
fax 865-241-3400

KNIGHT
Knight Advanced Technology
540 West Randolph Street
Chicago, IL 60661

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under U.S. GOVERNMENT contract DE-AC05-00OR22725
UT-BATTELLE, LLC. • Oak Ridge, Tennessee

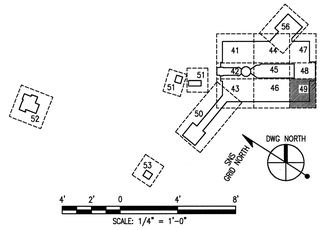PROJECT NAME:
SPALLATION NEUTRON SOURCE

TARGET BUILDING
ELECTRICAL LIGHTING PLAN
LEVEL 1, SECTOR 49

| 1 | 48 | 49 | 50 | PLANT | BLDG | FL | SH. | OF | TYPE | CLASS |
|---|---|---|---|---|---|---|---|---|---|---|
| 3 | E | X | X | 8 | 8700 | | 1 | 1 | P | U |
| 51 | | 52 | | 53 | WBS | | E3.01.49 | | | REV |
| NC | | NA | | | 1.8.3.7 | | | | | 0 |

| | | |
|---|---|---|
| DSN | H GROVER | 10/26/01 |
| DRW | L. MAKOVSKY | 10/26/01 |
| CHK | V.STEFFEN | 10/26/01 |
| DEPT | | |
| PE | | 11/15/01 |
| PJ | | 11/14/01 |
| REQ | | |
| UTB | | 11/14/01 |

RPE
STOR G. STEFFEN
REGISTERED PROFESSIONAL ENGINEER
No. 00106009
STATE OF TENNESSEE
11-13-01
REV. DATE

| REV | CHANGE TYPE | CHANGE CONTROL SYSTEM | PROJECT NUMBER | DESCRIPTION | DSN | CHK | DEPT |
|---|---|---|---|---|---|---|---|
| 0 | | | | CERTIFIED FOR CONSTRUCTION – 10/26/01 | HG | VGS | |

REVISION OR ISSUE PURPOSE

| DATE | PE | DATE | PJ | DATE | REQ | DATE | UTB | DATE | RPE | RPE NO | DATE |
|---|---|---|---|---|---|---|---|---|---|---|---|
| | 11/15/01 | | 11/14/01 | | | | 11/14/01 | | VGS | 00106009 | 10/26/01 |

REVISION APPROVALS

| REW | – | WRS | AK | WRS | BWJ | – | MP | – | ED |
|---|---|---|---|---|---|---|---|---|---|
| ST | CV | EC | EE | EM | IE | M | PD | SE | AR |

SQUAD CHECK

DRAWING APPROVALS

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDER ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

NUMBER OF SECTION OR DETAIL
DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN
SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY
CHANGE CONTROL SYSTEM 3
ENGINEERING PROCEDURE SNS-ENG-0001

Date: 11/13/2001 Time: 10:00:04
Username: MAKOVSKYL
Filename: J:\SJ\PROJECTS\SNS\NS_DWGS\NS8_DWGS\NS8_E8\NS_E8\E3-01-49.DWG

AutoCAD