
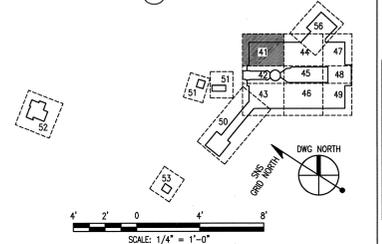


GENERAL NOTES

- COORDINATE EXACT LOCATION OF EACH LIGHTING FIXTURE WITH CABLE TRAY LAYOUTS AND AIR DUCT LAYOUTS.
- FIXTURES SHALL BE LOCATED AT THE SAME ELEVATION IN EACH ROOM, UNLESS NOTED OTHERWISE.
- FOR LIGHTING FIXTURE SCHEDULES SEE DWG E9.21.34
- FOR LIGHTING FIXTURE SCHEDULES SEE DWG E9.30.01
- PROVIDE 2" RIGID GALVANIZED STEEL SLEEVES FOR ALL CONCRETE CEILING AND WALL CONDUIT PENETRATIONS. LOCATE WALL PENETRATIONS IN THE BASEMENT 12" BELOW CEILING. SEE DETAILS AS NOTED.
- ALL CONDUITS RUN IN THE CEILING AREA IN THE BASEMENT SHALL BE MINIMUM OF 8'-6" ABOVE THE FINISHED FLOOR.

SHEET KEYNOTES

N001 ALL CONDUITS, CONDUIT FITTINGS AND J-BOXES IN THIS ROOM SHALL BE NON CORROSIVE EPOXY COATED GALVANIZED RIGID STEEL. WIRING DEVICES (SWITCHES, ETC.) SHALL BE ENCLOSED IN EPOXY COATED STEEL OR STAINLESS STEEL ENCLOSURES.

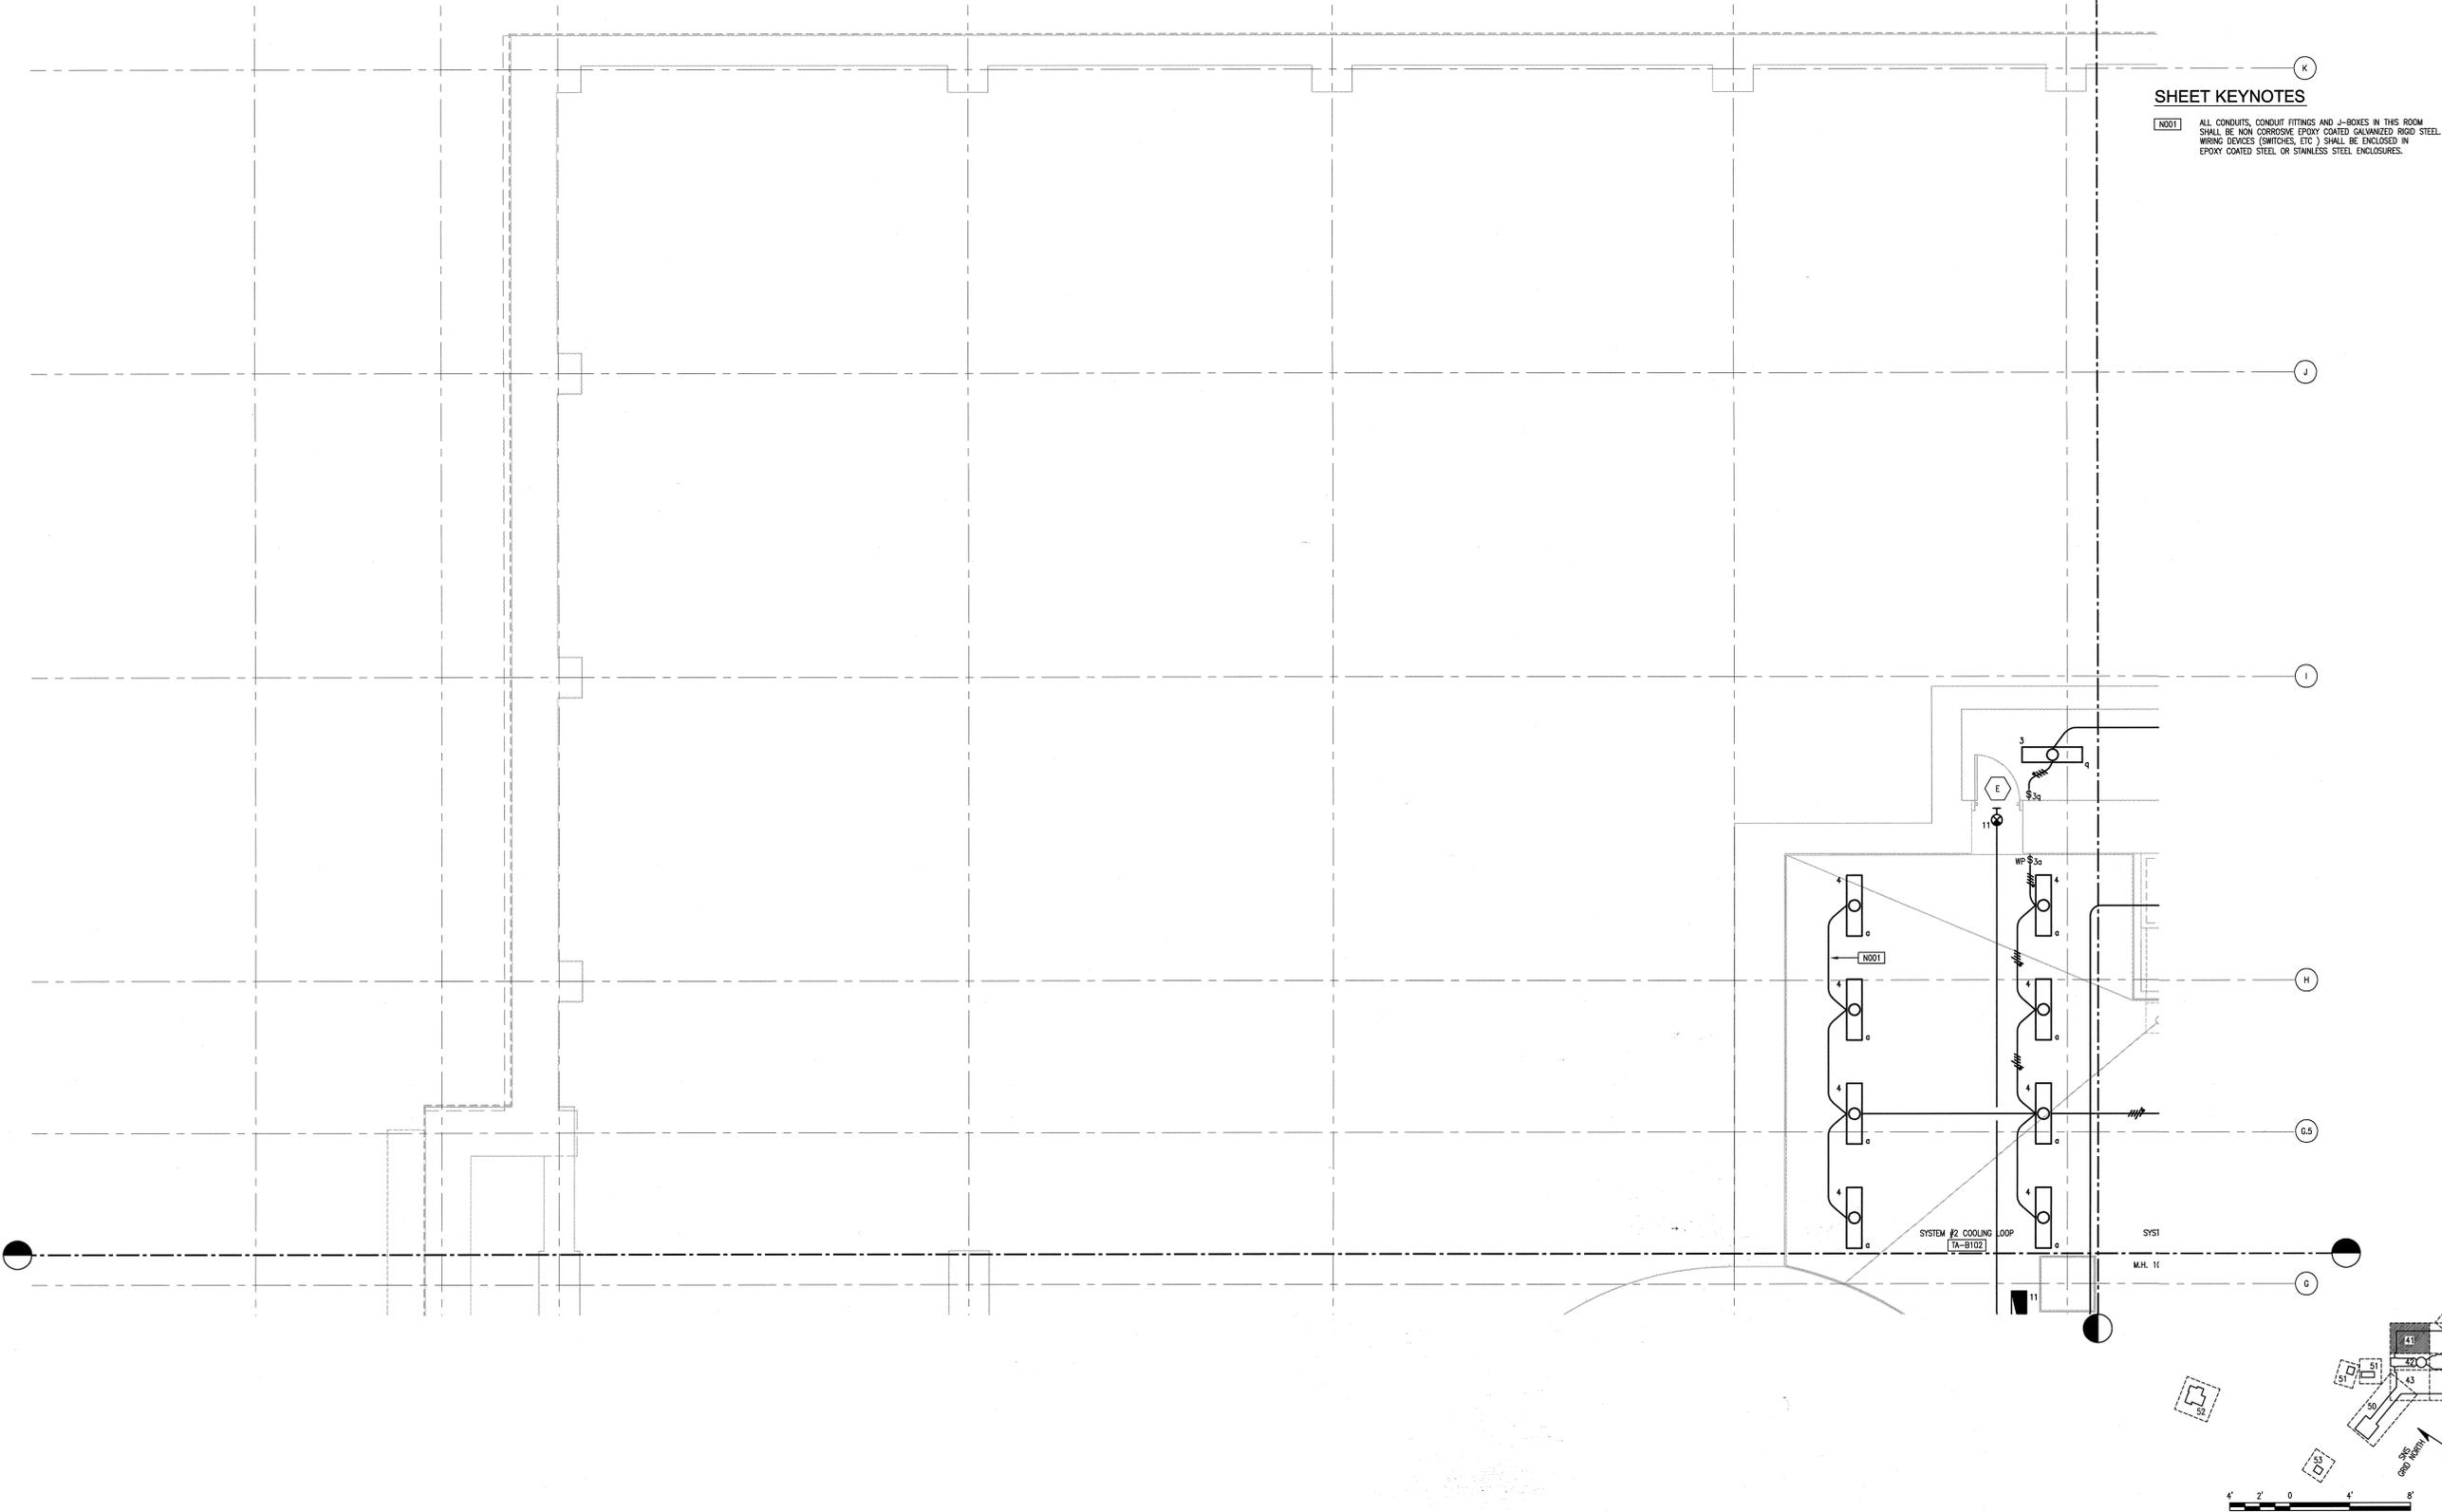

108030700-E8E-8700-A037

	Knight Jacobs Joint Venture 701 Scarborough Road, MS 8253 Oak Ridge, TN 37830 865-241-9433 Fax 865-241-3400	KNIGHT Knight Advanced Technology 148 West Franklin Street Chattanooga, TN 37403
--	---	--

Oak Ridge National Laboratory
 managed for the DEPARTMENT OF ENERGY under
 U.S. GOVERNMENT CONTRACT DE-AC05-00OR22725
 DT-ORNL-LLC, © Oak Ridge, Tennessee

PROJECT NAME:
SPALLATION NEUTRON SOURCE

TARGET BUILDING ELECTRICAL LIGHTING PLAN LEVEL B1, SECTOR 41

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8700		1	1	P	U
51	52	53	WBS	1.8.3.7						
NC	NA									

E3.B1.41 0

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

THIS DOCUMENT CONTROLLED BY
 CHANGE CONTROL SYSTEM
 ENGINEERING PROCEDURE SNS-ENG-0001

SECTION AND DETAIL KEY

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	FJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	SQUAD CHECK
0		CERTIFIED FOR CONSTRUCTION - 10/28/01	HG	VGS																								
1	11-13-01																											

RPE
 DSN H GRIDER 10/28/01
 DRW L MAKOVSKY 10/28/01
 CHK V STEFFEN 10/28/01
 DEPT
 PE L Janner 11/13/01
 PU R J Bean 11/13/01
 REQ
 0 11-13-01
 REV DATE
 LTB J Janner 11/14/01
 DRAWING APPROVALS