




- GENERAL NOTES**
- COORDINATE EXACT LOCATION OF EACH LIGHTING FIXTURE WITH CABLE TRAY LAYOUTS AND AIR DUCT LAYOUTS.
 - FIXTURES SHALL BE LOCATED AT THE SAME ELEVATION IN EACH ROOM, UNLESS NOTED OTHERWISE.
 - FOR LIGHTING PANEL SCHEDULES SEE DWG E9.21.34
 - FOR LIGHTING FIXTURE SCHEDULES SEE DWG E9.20.01
 - PROVIDE 2" RIGID GALVANIZED STEEL SLEEVES FOR ALL CONCRETE CEILING AND WALL CONDUIT PENETRATIONS. LOCATE WALL PENETRATIONS IN THE BASEMENT 12" BELOW CEILING. SEE DETAILS AS NOTED.
 - ALL CONDUITS RUN IN THE CEILING AREA IN THE BASEMENT SHALL BE MINIMUM OF 8'-4" ABOVE THE FINISHED FLOOR.
- SHEET KEYNOTES:**
- NOOT1 SEE DWGS. E8.10.32 & E8.10.33 FOR STAIRS NO.1, 2, 5, 6, 7 & 8 SECTIONS

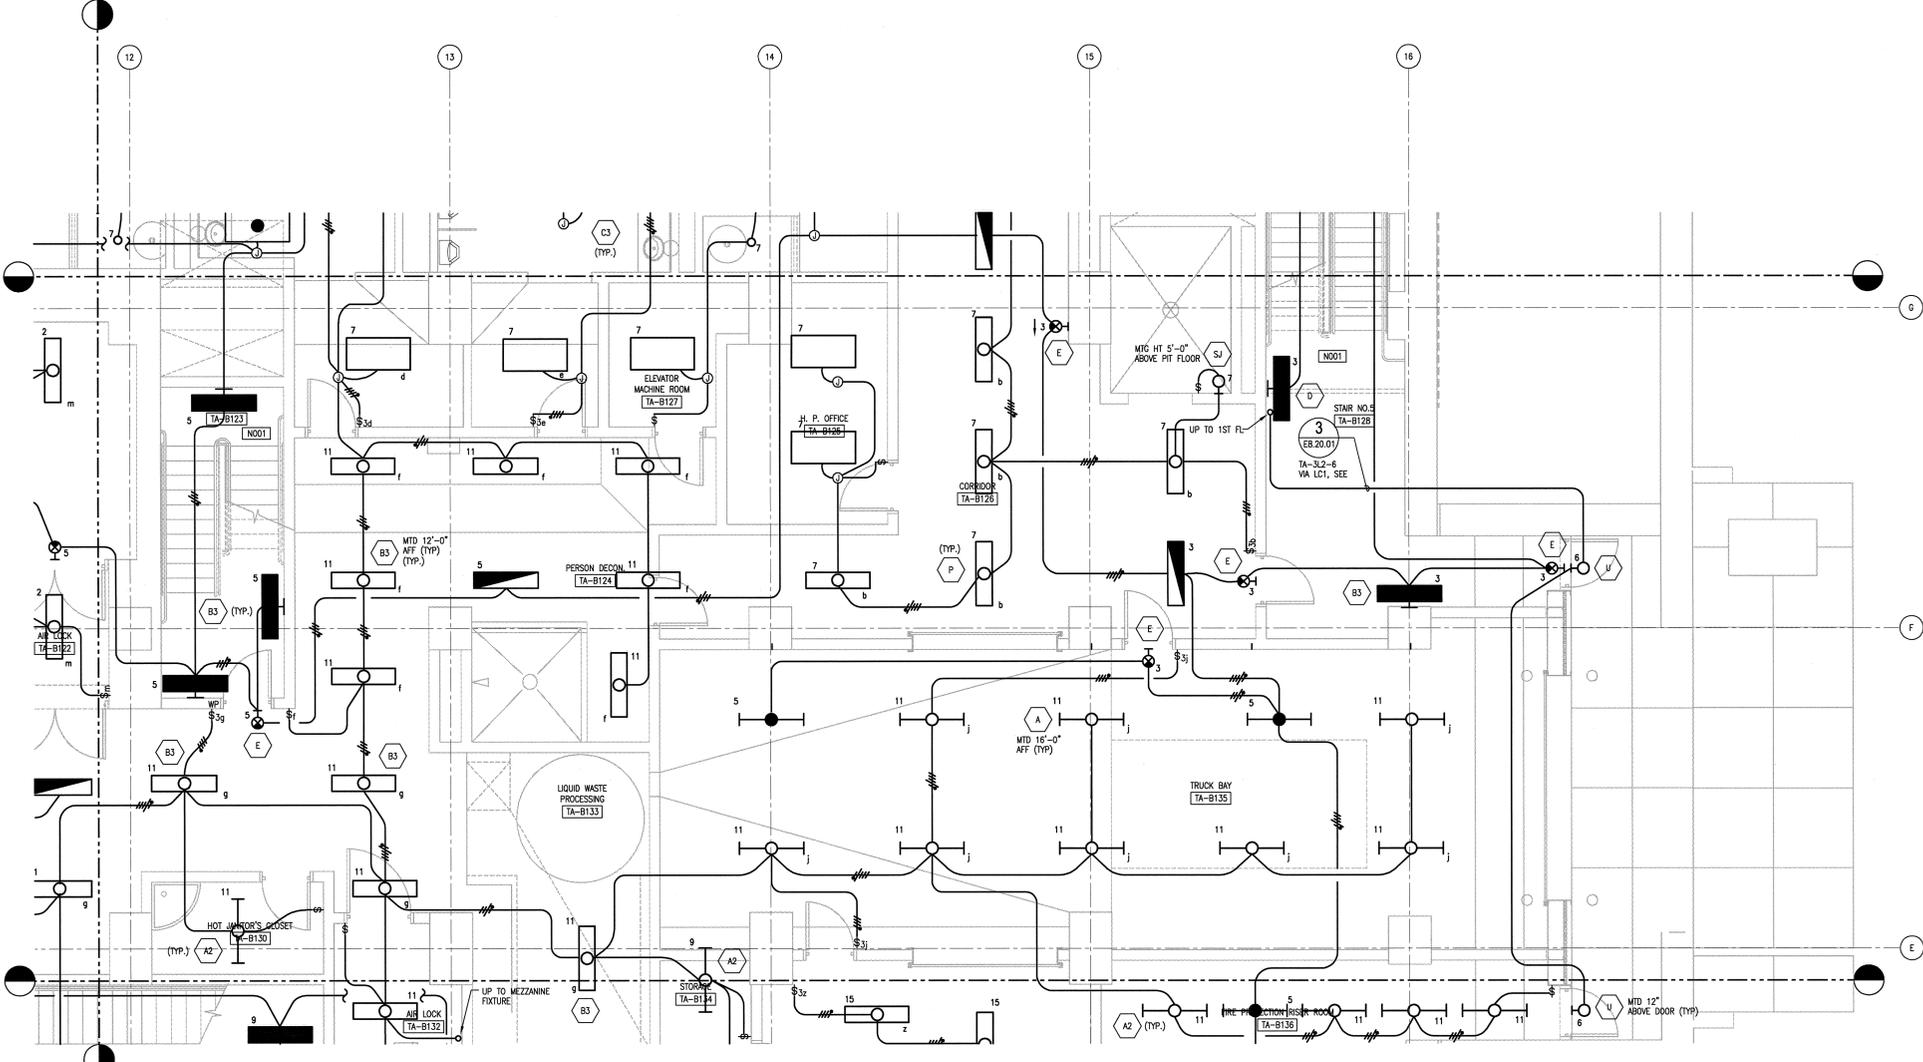

1 SECTOR 48, LEVEL B1 FLOOR PLAN
 SCALE: 1/4"=1'-0"

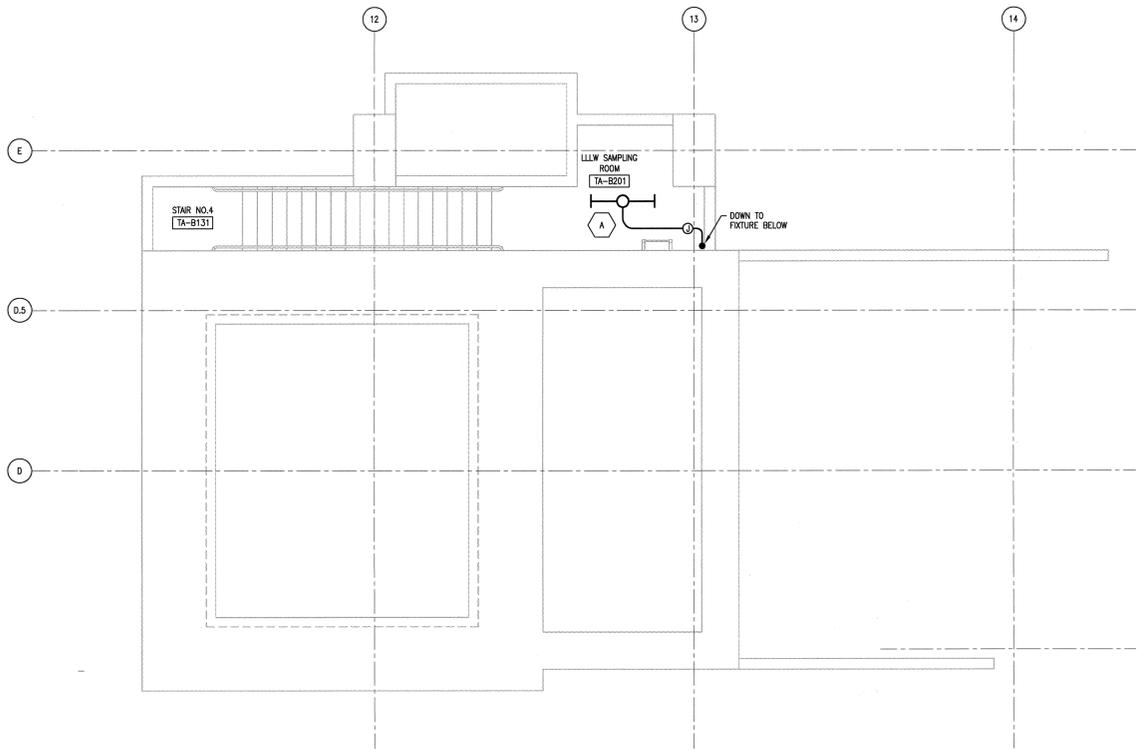

2 MEZZANINE AND STAIR FLOOR PLAN
 SCALE: 1/4"=1'-0"

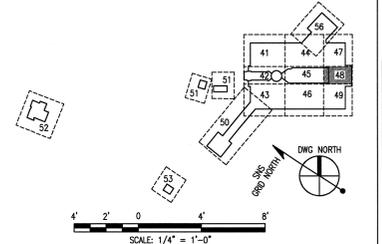

108030700-E8E-8700-A044

Knight Jacobs
 Knight Jacobs Joint Venture
 701 Scoboro Road, MS 8263
 Oak Ridge, TN 37830
 865-241-9433
 Fax 865-241-3400

KNIGHT
 Knight Advanced Technology
 148 West Rutledge Street
 Chicago, IL 60601

UT-BATTELLE
 Oak Ridge National Laboratory
 managed for the DEPARTMENT OF ENERGY under
 U.S. GOVERNMENT CONTRACT DE-AC05-00OR21400
 UT-BATTELLE, LLC • Oak Ridge, Tennessee

PROJECT NAME:
SPALLATION NEUTRON SOURCE

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS MAY NOT INFRINGE PATENT RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FURNISHING CONTRACTOR.

THIS DOCUMENT CONTROLLED BY
 CHANGE CONTROL SYSTEM 3
 ENGINEERING PROCEDURE SNS-ENG-0001

SECTION AND DETAIL KEY
 DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	
0		CERTIFIED FOR CONSTRUCTION - 10/26/01	HG	VGS																				
1	10/26/01	REVISED FOR CONSTRUCTION																						

STATE OF TENNESSEE
 REGISTERED PROFESSIONAL ENGINEER
 LICENSE NO. 11141
 DATE 11-13-01

REVISION APPROVALS

DRAWING APPROVALS

DRN	H. GRIDER	10/28/01
DRW	L. MAKOVSKY	10/28/01
CHK	V. STEFFEN	10/28/01
DEPT		
PE	R. A. BEAN	11/16/01
PJ	R. A. BEAN	11/16/01
REQ		

1	48	49	50	PLANT	BLDG	FL	SH.	OF TYPE	CLASS
3	E	X	X	8	8700		1	1	P
51	52	53	WBS						
NC	NA		1.8.3.7						

AutocAD