
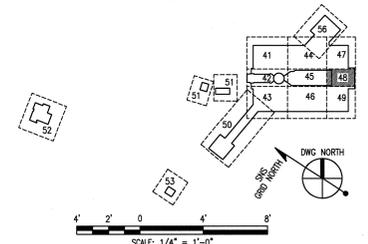


**GENERAL NOTES:**

- SEE DWG E8.10.30, E8.10.31, E8.10.32 & E8.10.33 FOR MCC SCHEDULES, E2.10.30, E2.10.31, E2.10.32 FOR SINGLE LINES DIAGRAM AND E9.21.30 THRU 37 FOR PANEL SCHEDULES.
- CONDUIT ADJACENT OR CONDUIT TO CABLE TRAY #1, #2 OR #3, ETC. \* - DENOTES CABLE TRAY LAYER #1 - TOP LAYER TRAY #2 - SECOND LAYER TRAY #3 - THIRD LAYER TRAY
- ALL TRAYS ARE LADDER TYPE. PROVIDE VENTILATED TRAY COVER AT VERTICAL RISER TRAY.
- SEE DWG H9.10.30 & H9.30.31 FOR HVAC SCHEDULES.
- TA-XX SYMBOL DENOTES FEEDER TAG NO. SEE DWG E9.40.30 FOR FEEDER/CONDUIT SIZES.
- ⊕ SYMBOL DENOTES WALL AND FLOOR PENETRATION. REFER TO DWG E9.40.30 FOR PENETRATION SCHEDULE.
- SYMBOL DENOTES CONDUIT/CABLE TRAY SUPPORT FROM WALL/CEILING. REFER TO DETAILS 13, 14, 15, 26, 35 & 43. NOT ALL SUPPORTS ARE SHOWN. THIS DESIGNATION ONLY SHOWS THE CONCEPT TO BE USED BY THE CONTRACTOR TO DESIGN AND PROVIDE CABLE TRAY SUPPORTS.

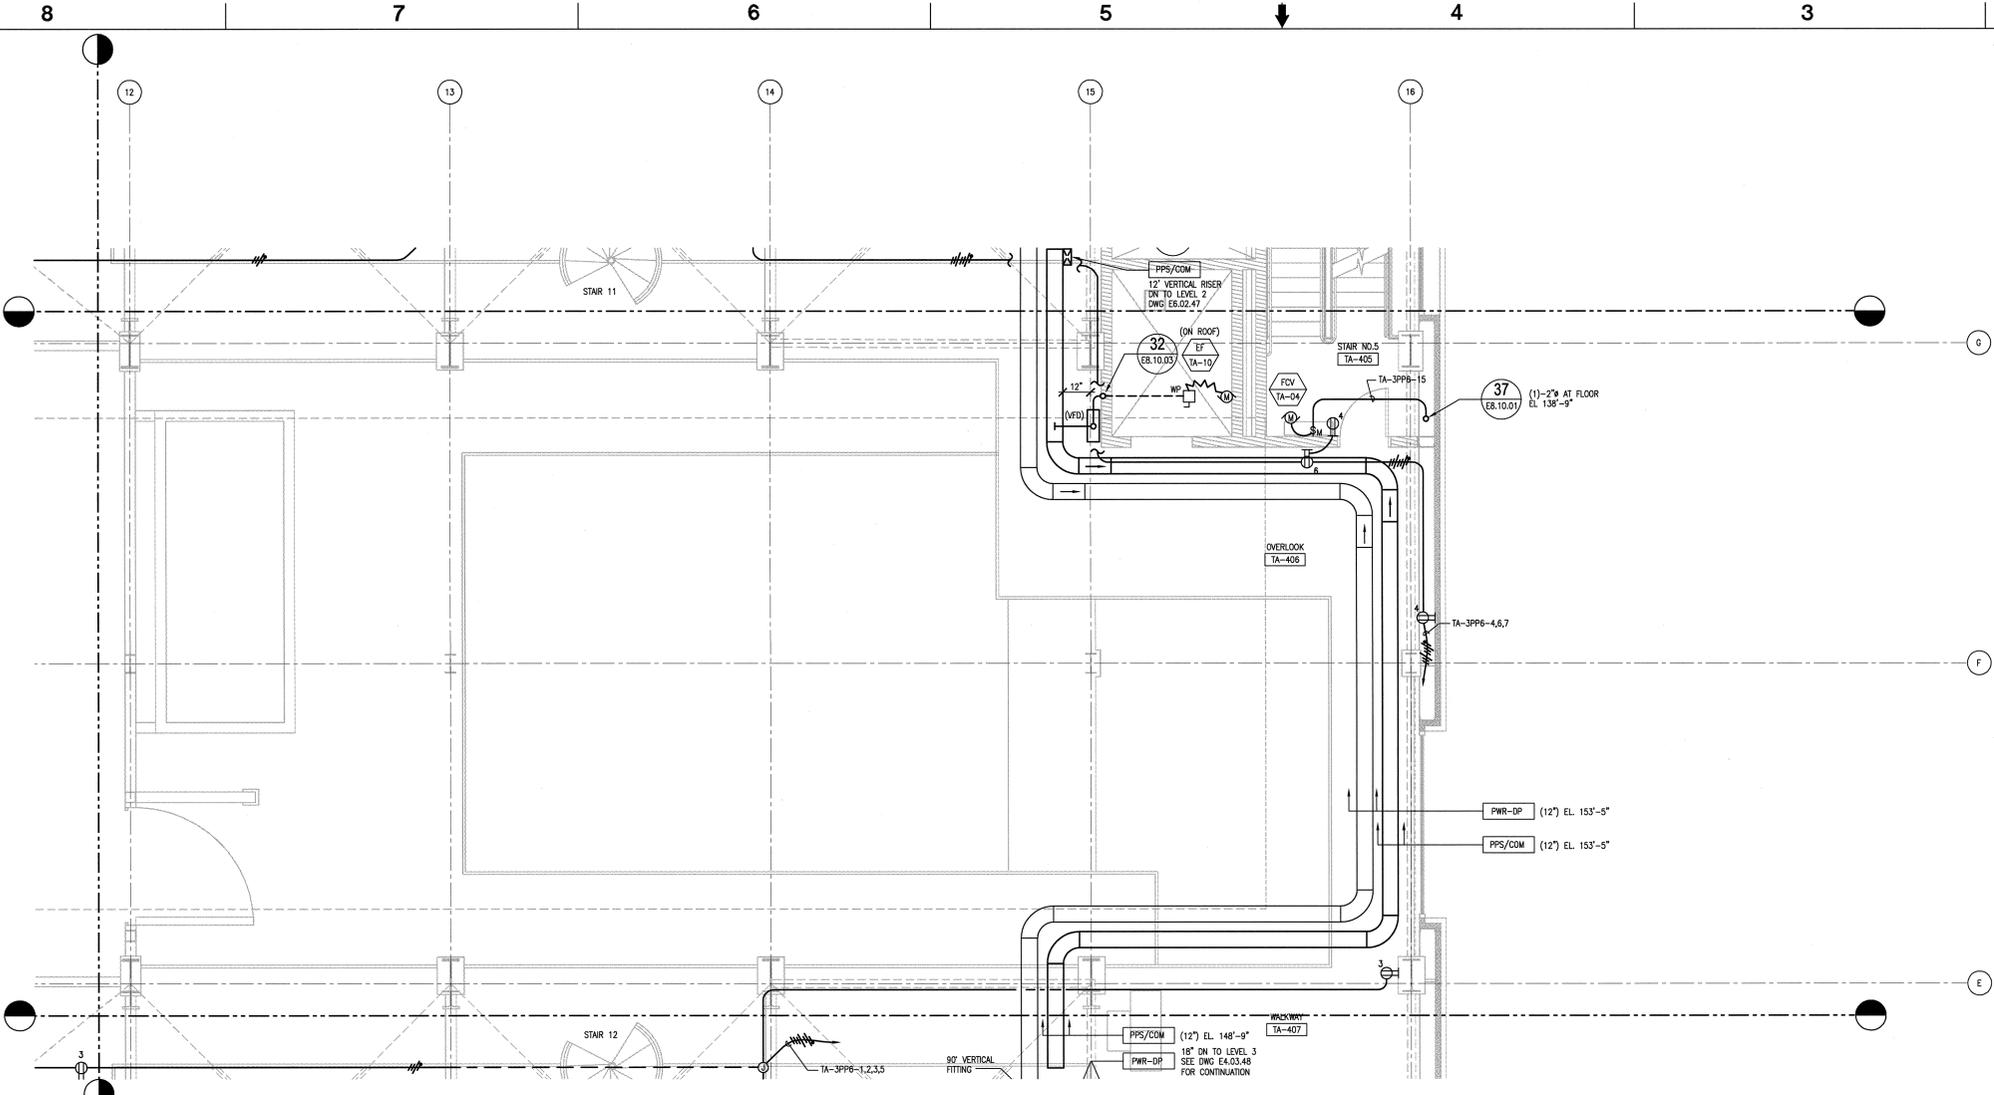

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORMING CONTRACTOR.

SECTION AND DETAIL KEY

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

THIS DOCUMENT CONTROLLED BY

CHANGE CONTROL SYSTEM 3

ENGINEERING PROCEDURE SNS-ENG-0001

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	
0		CERTIFIED FOR CONSTRUCTION - 10/26/01																						
1	11/14/01																							

REVISION APPROVALS

DATE: 11-13-01

REVISION APPROVALS

DATE: 11/14/01

108030700-E8E-8700-A069

KNIGHT  
Knight Advanced Technology

108030700-E8E-8700-A069

Ok Ridge National Laboratory  
managed for the DEPARTMENT OF ENERGY under  
U.S. GOVERNMENT contract DE-AC05-00OR22725

PROJECT NAME:  
**SPALLATION NEUTRON SOURCE**

**TARGET BUILDING ELECTRICAL POWER PLAN LEVEL 4, SECTOR 48**

1	48	48	80	8	8700	FL	SH.	OF	TYPE	CLASS
3	E	X	X	X	8		1	1	P	U
51					5.3					
NC					1.8.3.7					E4.04.48
										REV 0

AutoCAD

A