
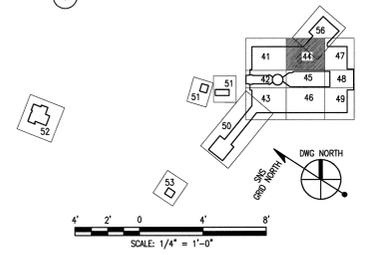


- GENERAL NOTES:**
1. SYMBOL DENOTES CABLE TRAY/CONDUIT SUPPORT FROM WALL/CEILING. REFER TO DWG E8.10.01 FOR TYPICAL DETAILS.
 2. FOR WALL AND FLOOR PENETRATIONS REFER TO CORRESPONDING FLOOR & SECTION POWER PLANS (E4 SERIES) WORK.
 3. SEE POWER PLANS (E4 SERIES) FOR COMPOSITE OF TRAYS FOR ALL SERVICES.
 4. ALL TRAYS SHALL BE LADDER TYPE FOR VERTICAL TRAY RISERS. VENTILATED COVERS SHALL BE PROVIDED.

PWR-SWGR	EL 123'-11" (24")
PWR-DP-1	EL 122'-7" (24")
(12) PWR-DP-2	COM/DAS EL 121'-3" (12)
(12) S-NLL	PPS EL 119'-11" (12)

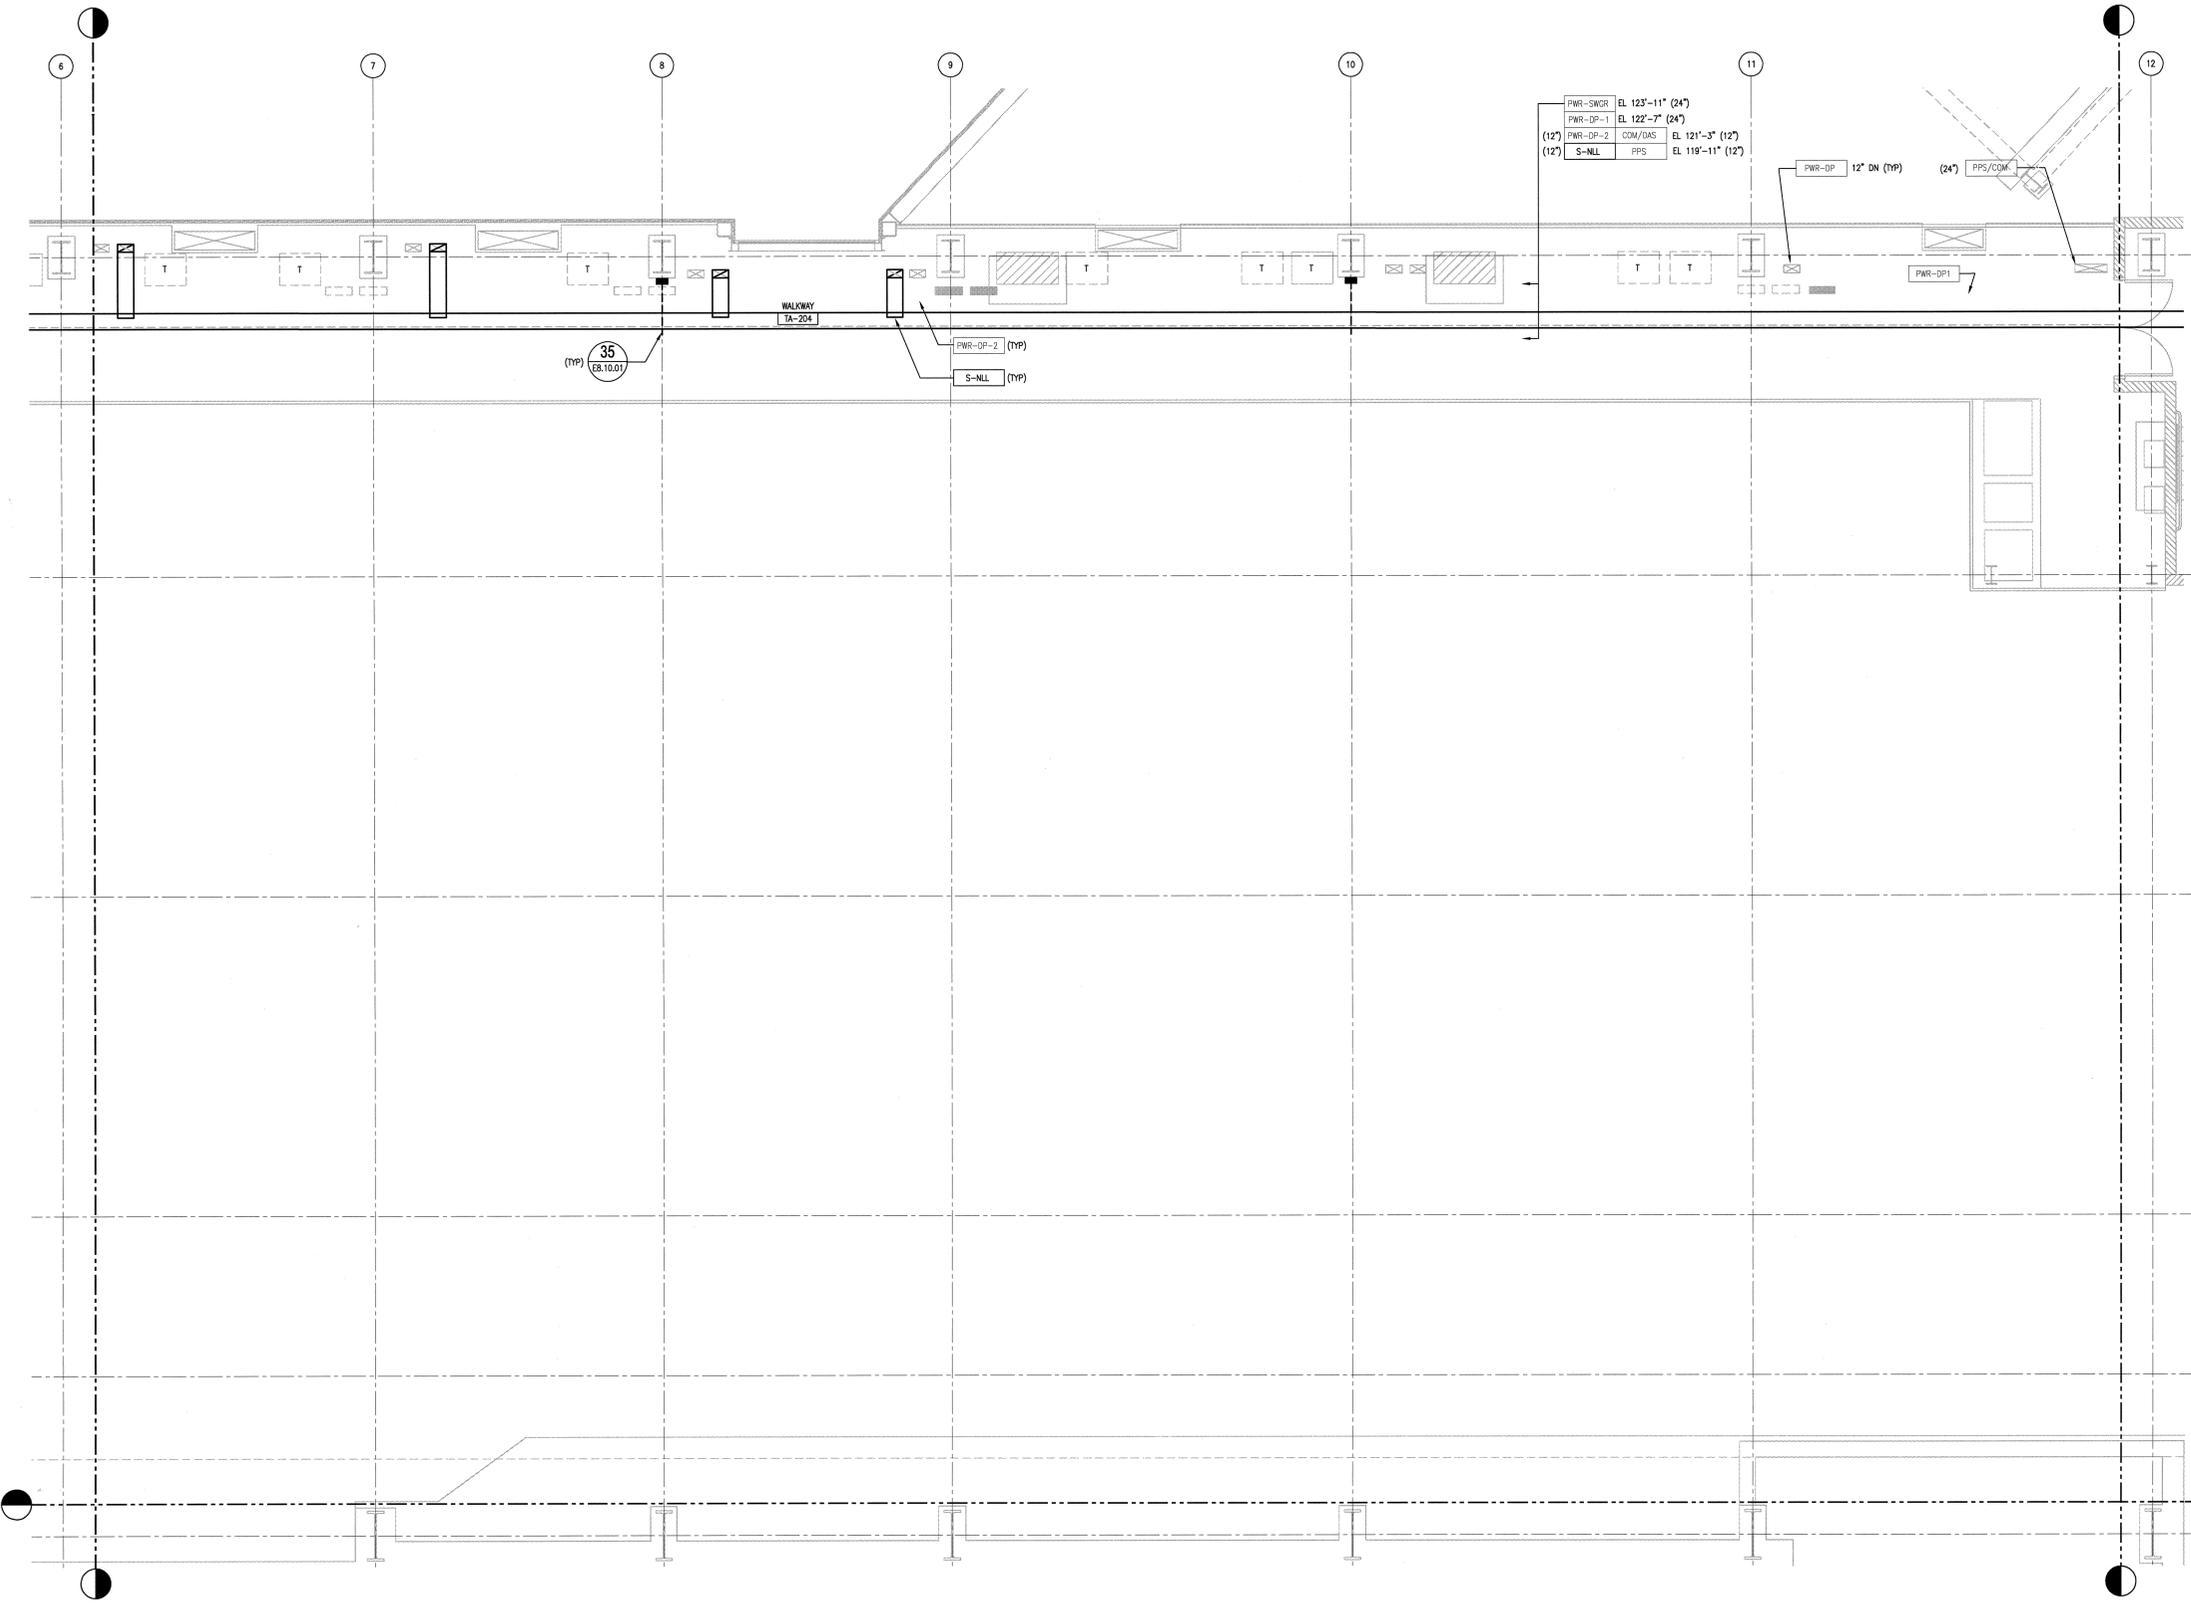

108030700-E8E-8700-A091

KNIGHT
Knight Advanced Technology

865-241-9433
For 865-241-3400

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725

PROJECT NAME:
SPALLATION NEUTRON SOURCE

**TARGET BUILDING
ELECTRICAL AUXILIARY PLAN
LEVEL 2, SECTOR 44**

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8700	1	1	1	P	U
51	NC	52	NA	53	WBS					REV
					1.8.3.7					E5.02.44
										0

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	SQUAD CHECK
0		CERTIFIED FOR CONSTRUCTION - 10/26/01	HG	VCS																								

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSIGNED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO USER ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FURNISHING CONTRACTOR.

SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY

CHANGE CONTROL SYSTEM 3

ENGINEERING PROCEDURE SNS-ENG-0001

AutoCAD