
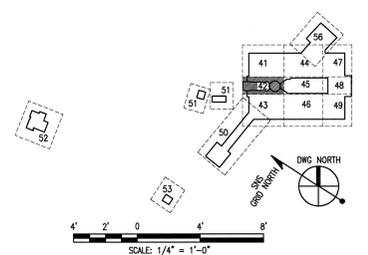


GENERAL NOTES:

- FOR ALL PERSONNEL PROTECTION SYSTEM (PPS) EQUIPMENT, PPS SIGNAL CABLING USED AS PART OF SAFETY SYSTEM MUST BE RUN SEPARATELY FROM NON-SAFETY CABLING. PPS SAFETY CABLING CAN RUN IN SHARED TRAY WITH DNDIE (PPS/COM TRAY) AND SHORT RUN OF CONDUIT FROM EACH DETECTOR LOCATION BACK TO THE NEAREST "PPS TRAY" PPS SIGNAL CABLES AND THE CONDUIT DROPS WILL BE BY OTHERS.
- FOR PPS SYSTEM DEVICES ARE NOTED WITH ELECTRICAL SYMBOLS ON PLAN. EACH DEVICE WILL REQUIRE 120V UPS POWER SOURCE, FEED FROM UPS PANEL TA-307) AS REQUIRED. CABLING CAN BE RUN OF CONDUIT DROPS FROM (PWR-OP TRAY) TO NEARBY DEVICES LOCATION, BY INSTRUMENT SUBCONTRACTOR.
- ALL CONDUITS RUN IN THE CEILING AREA IN THE BASEMENT SHALL BE MINIMUM OF 8"-6" ABOVE THE FINISHED FLOOR.

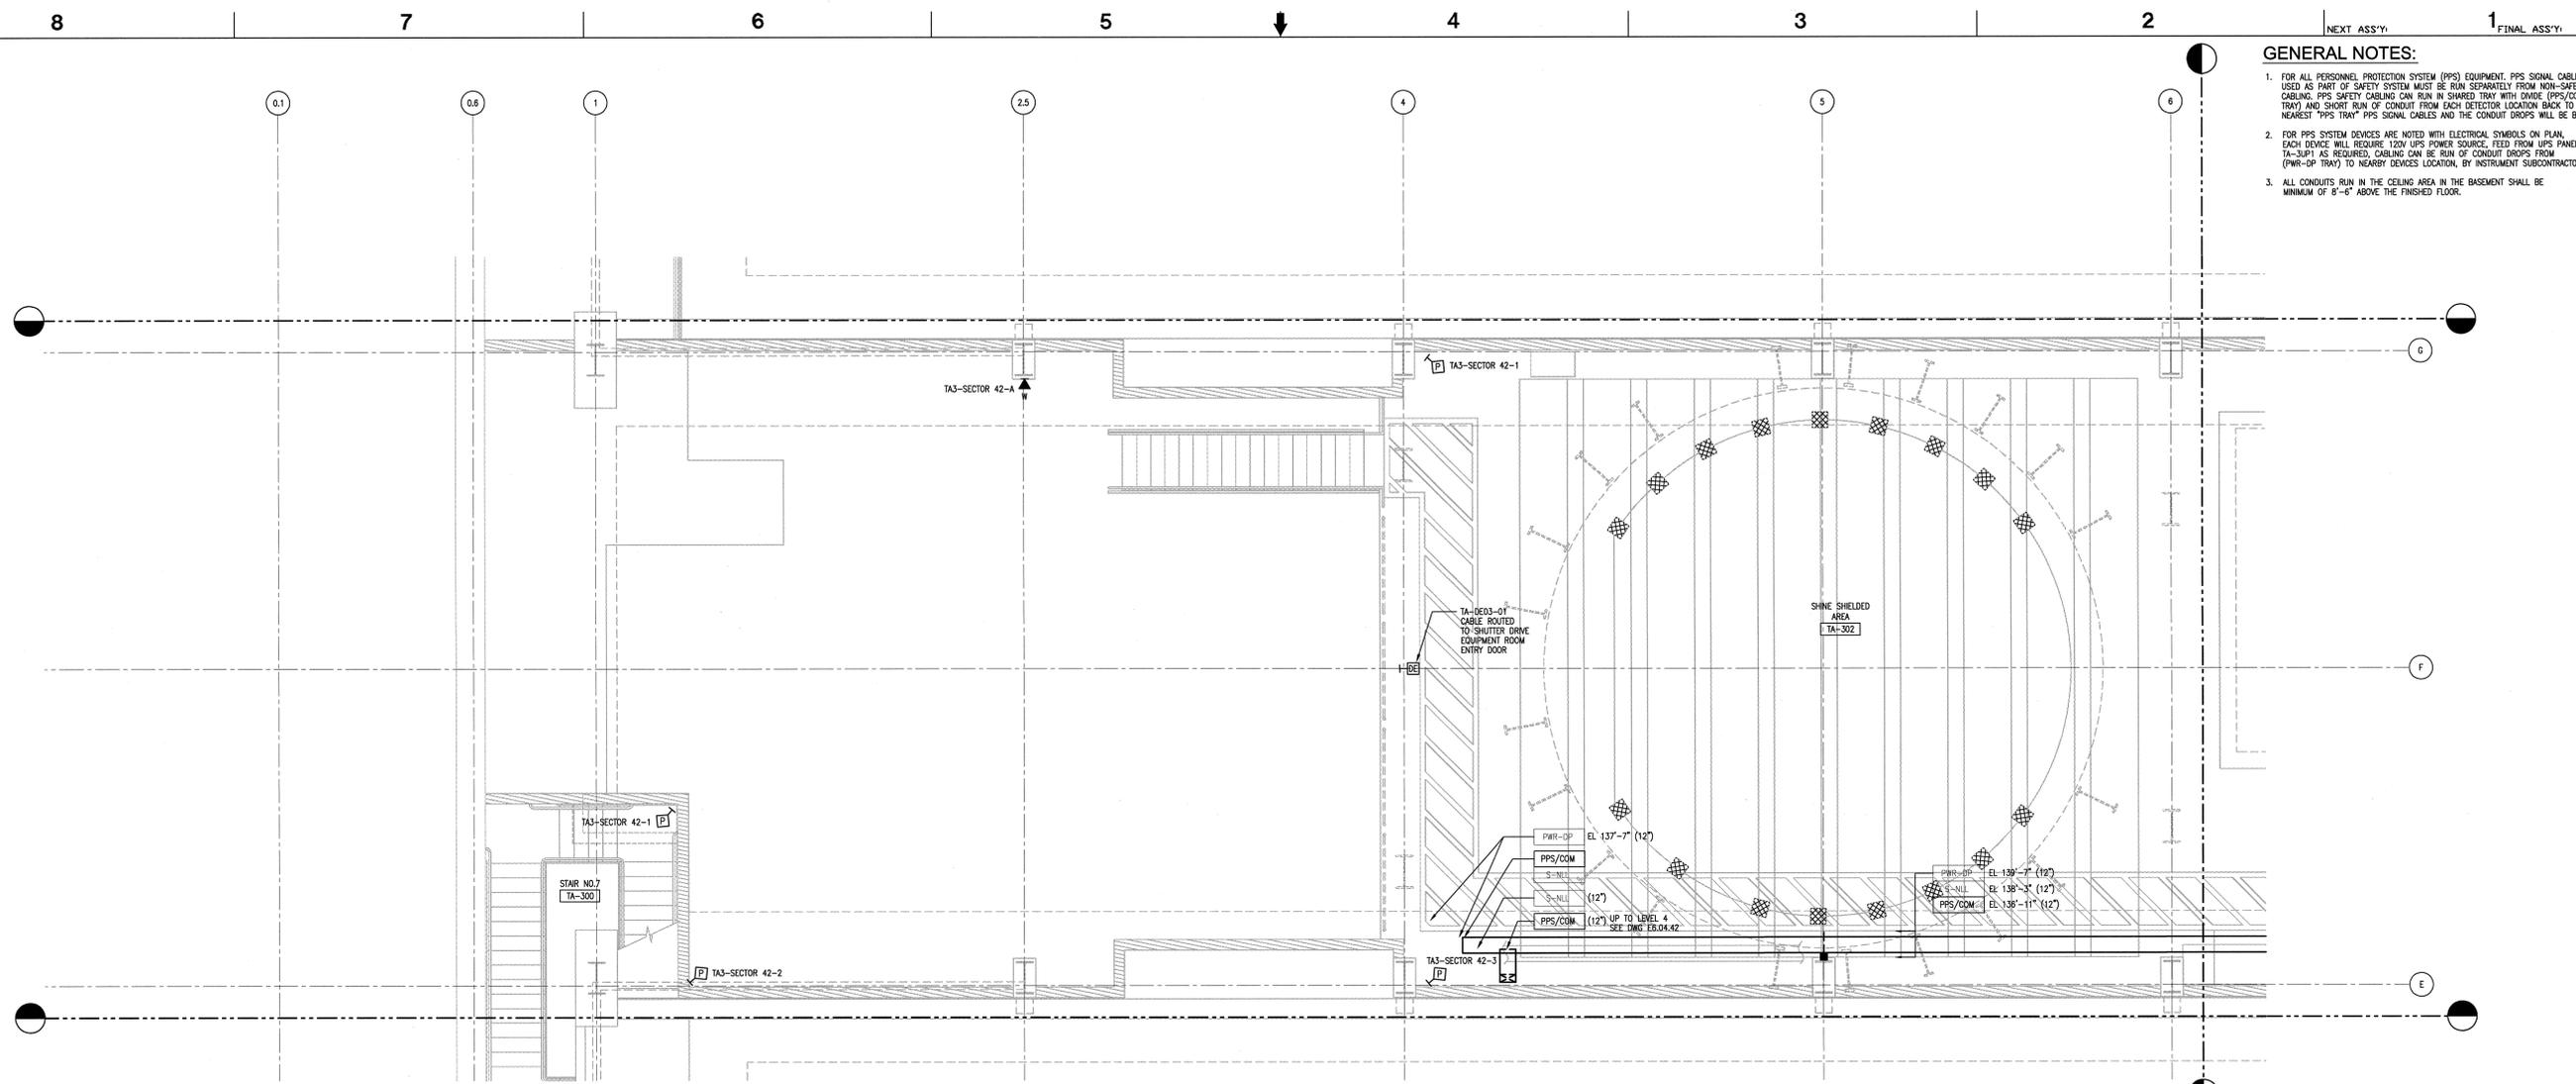

108030700-E8E-8700-A129

KNIGHT
Knight Advanced Technology
448 West Franklin Street
Chattanooga, TN 37403
865-241-9433
Fax: 865-241-3400

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT CONTRACT DE-AC05-00OR22725
© UT-BATTELLE, LLC • Oak Ridge, Tennessee

PROJECT NAME:
**TARGET BUILDING
ELECTRICAL COMMUNICATIONS PLAN
LEVEL 3, SECTOR 42**

1	48	49	50	PLANT	BLDG	FL	SH.	OF TYPE	CLASS
3	E	X	X	8	8700	1	1	P	U
51	52	53	WBS	1.8.3.7					
NC	NA								

E6.03.42

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	
0		CERTIFIED FOR CONSTRUCTION - 10/26/01		HG	VGS			10/26/01																				

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDER ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

THIS DOCUMENT CONTROLLED BY
CHANGE CONTROL SYSTEM
ENGINEERING PROCEDURE SNS-ENG-0001

SECTION AND DETAIL KEY

AutocAD