
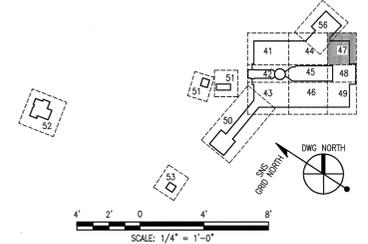


KEYED NOTES:

- 1 VOLUME DAMPERS LOCATED IN RISER (TYP).
- 2 INSULATION OF DUCTWORK TERMINATES ON DUCT DROP.

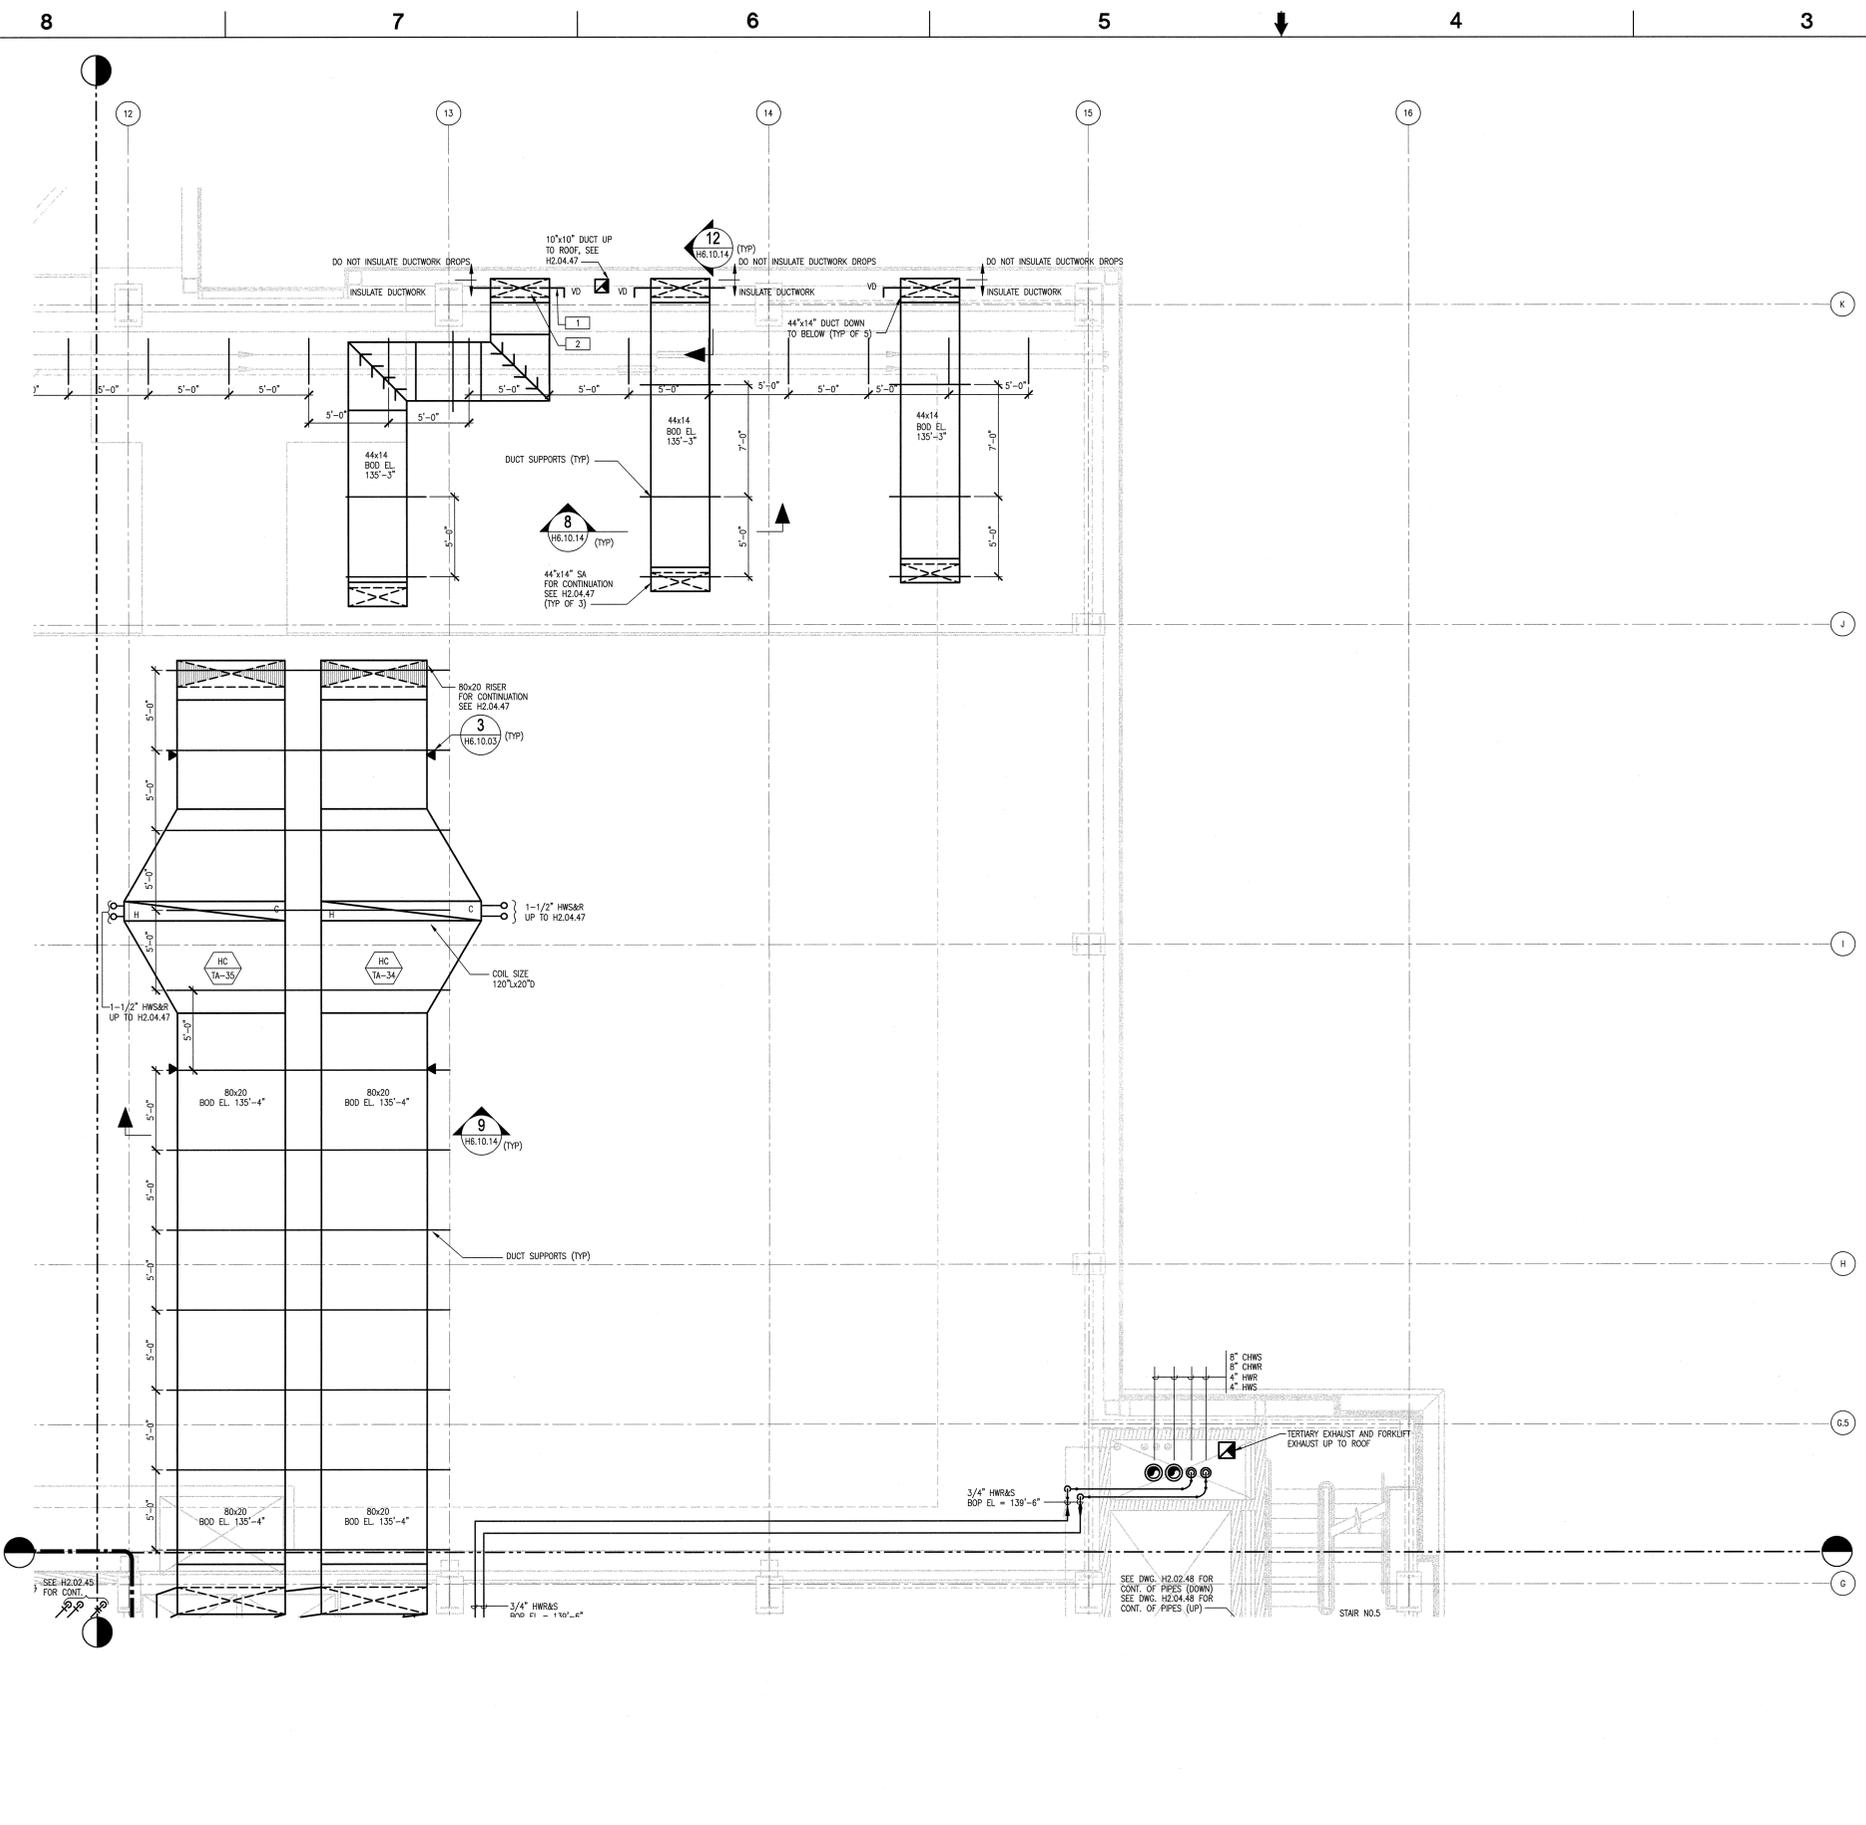

108030700-H8E-8700-A097

Knight Jacobs Knight Jacobs Joint Venture
701 Scorsboro Road, MS 8253
Oak Ridge, TN 37830
865-241-9433
Fax 865-241-3400

KNIGHT
Knight Advanced Technology
548 West Franklin Street
Chattanooga, TN 37403

UT-BATTELLE Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725
©-BATTELLE, LLC. • Oak Ridge, Tennessee

PROJECT NAME:
SPALLATION NEUTRON SOURCE

TARGET BUILDING
HVAC FLOOR PLAN, HIGH BAY
LEVEL 3, SECTOR 47

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	H	X	X	8	8700		1	1	P	U
51	52	53	WBS							
NC	NA	5.3	1.8.3.7						H2.03.47	REV 0

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	
0		CERTIFIED FOR CONSTRUCTION - 11/13/01	MMK	BMJ																								
1	11/13/01	REVISED FOR CONSTRUCTION	MMK	BMJ																								

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSIGNED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY

CHANGE CONTROL SYSTEM

ENGINEERING PROCEDURE SNS-ENG-0001

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	H	X	X	8	8700		1	1	P	U
51	52	53	WBS							
NC	NA	5.3	1.8.3.7						H2.03.47	REV 0