
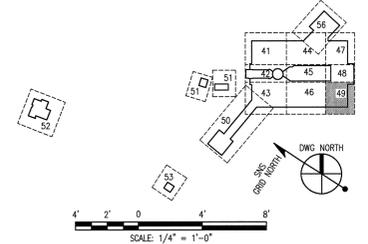


KEYED NOTES:

- 1 VOLUME DAMPERS LOCATED IN RISER (TYP).
- 2 INSULATION OF DUCTWORK TERMINATES ON DUCT DROP.

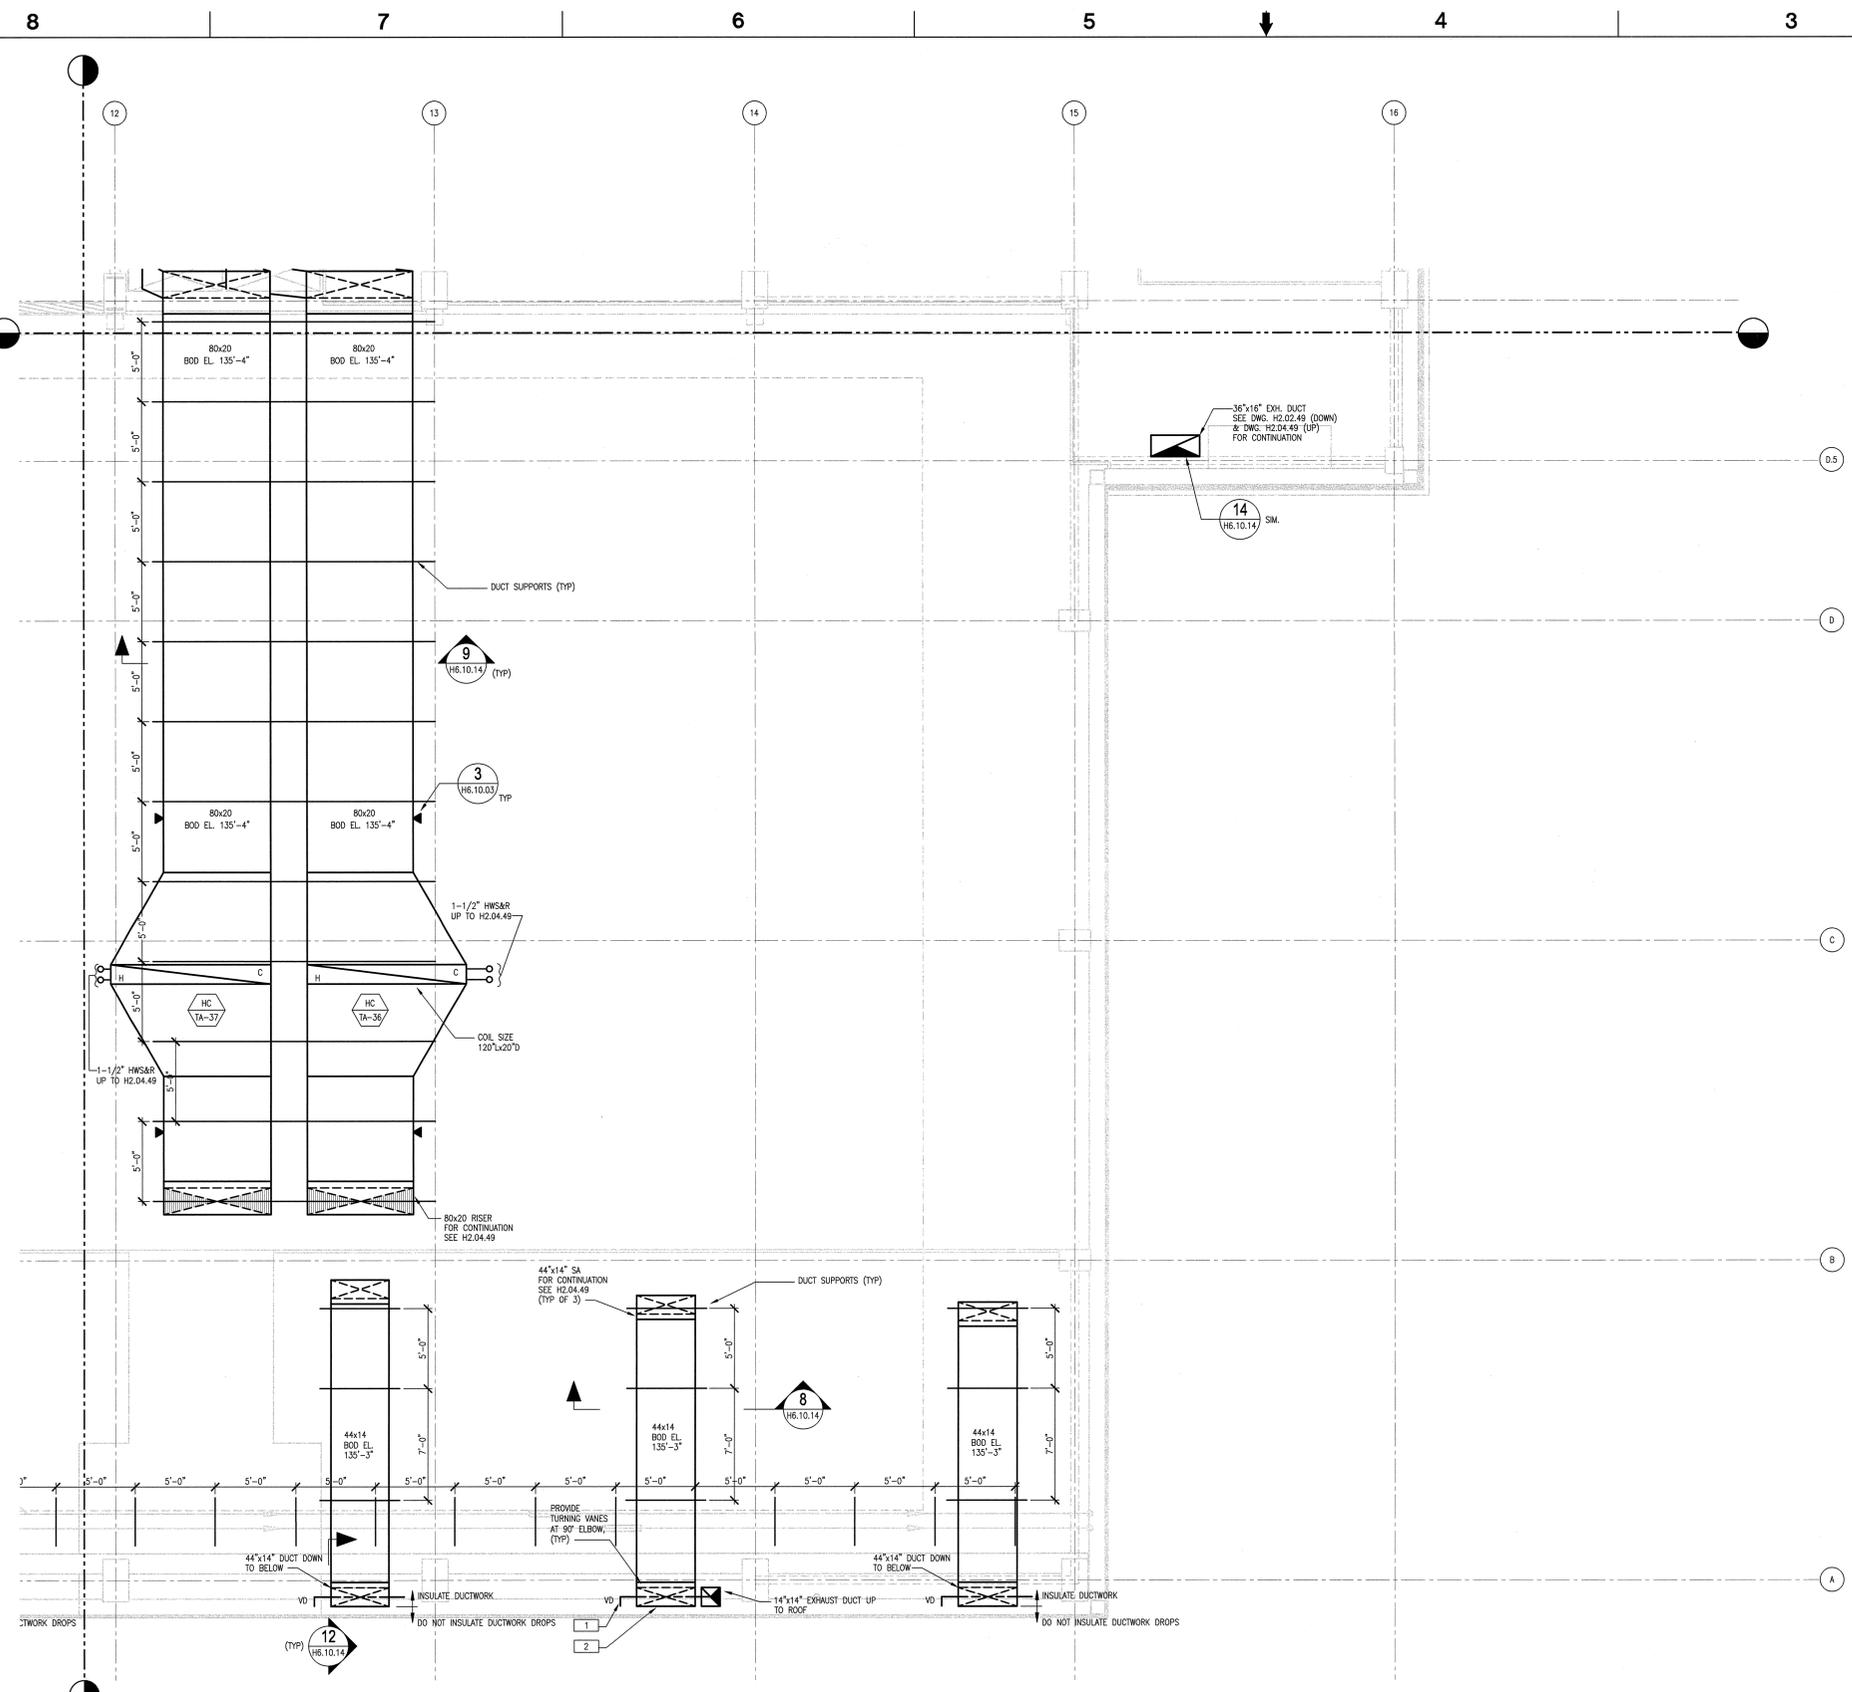

108030700-H8E-8700-A098

Knight Jacobs Knight Jacobs Joint Venture
701 Scarboro Road, MS 8253
Oak Ridge, TN 37830
865-241-8433
865-241-3400

KNIGHT
Knight Advanced Technology
546 West Main Street
Chattanooga, TN 37401

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725
©-BATTELLE, LLC - Oak Ridge, Tennessee

PROJECT NAME:
SPALLATION NEUTRON SOURCE

**TARGET BUILDING
HVAC FLOOR PLAN, HIGH BAY
LEVEL 3, SECTOR 49**

1	48	49	50	PLANT	BLDG	FL	SH.	OF TYPE	CLASS
3	H	X	X	8	8700	1	1	P	U
51	52	53	WBS	1.8.3.7	H2.03.49	0			
NC	NA								

REVISIONS	DATE	BY	DESCRIPTION
0	11/13/01	JST	ISSUED FOR CONSTRUCTION
1	11/13/01	JST	REVISED
2	11/13/01	JST	REVISED

0	CERTIFIED FOR CONSTRUCTION - 11/13/01	MMK	BNJ	11/13/01	105869	11/13/01	REV	WRS	AK	WRS	BNJ	MP	ED														
REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR

THIS DOCUMENT CONTROLLED BY
CHANGE CONTROL SYSTEM
ENGINEERING PROCEDURE - SNS-ENG-0001

SECTION AND DETAIL KEY

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSIGNED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.