NEXT ASS'Y: | FINAL ASS'Y:

NOTES:

1. IF PPS PANEL IS NOT INSTALLED AT TIME OF CONDUIT ROUTING, INSTALL A JUNCTION BOX ABOVE THE FUTURE PPS PANEL LOCATION. SUPPLY 5 FEET EXCESS CABLE FOR FUTURE CONNECTION TO PPS PANEL.

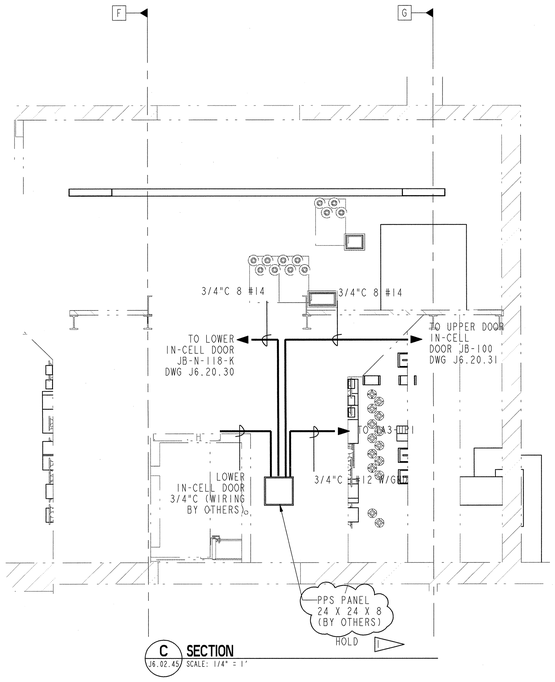

C SECTION
J6.02.45 SCALE: 1/4" = 1'

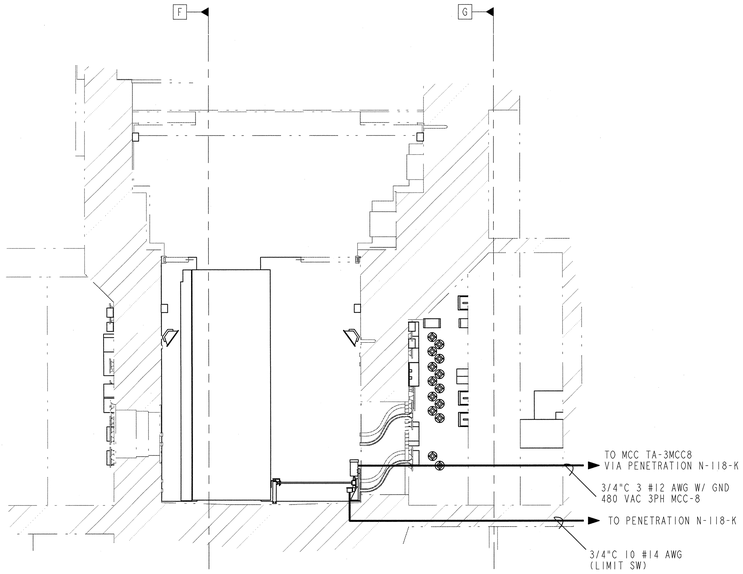

D SECTION
J6.02.45 SCALE: 1/4" = 1'

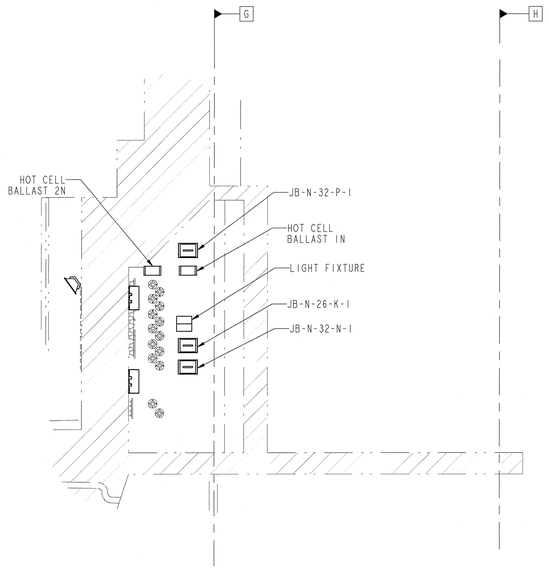

E SECTION
J6.20.30 SCALE: 1/4" = 1'



J6-30-33

108030700-J8E-8700-A261

Knight/Jacobs Joint Venture
701 Scarboro Road, MS 8253
Oak Ridge, TN 37830
865-241-9433
fax 865-241-3400

MERRICK Engineers & Architects

UT-BATTELLE — Oak Ridge National Laboratory, managed by UT-Battelle, LLC, for the U.S. Dept. of Energy under contract DE-AC05-00OR22725

PROJECT NAME:
SPALLATION NEUTRON SOURCE

TARGET BUILDING
POWER ELEVATION
INSTRUMENT LEVEL SECTOR 45

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	J	X	X	8	8700		1	1	P	U

51	52	53	WBS		REV
NC	NA	IN	1.8.3.7	J6.30.33	0

DSN	11/9/01
DRW	11/12/01
CHK	11/14/01
DEPT	
PE	11/15/01
PJ	11/14/01
REQ	
UTB	11/14/01

RPE — JERRY WAYNE HARRIS, STATE OF TENNESSEE

REV. DATE — DRAWING APPROVALS

REV	CHANGE FORM	CONTROL SYSTEM	CONTROL NUMBER	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR
0				CERTIFIED FOR CONSTRUCTION - 10/26/01	LJF	JWH				11/15/01	RAD	11/14/01				11/14/01	JWH	107492	11/13/01										

REVISION OR ISSUE PURPOSE — REVISION APPROVALS — SQUAD CHECK

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF, ANY INFORMATION, APPARATUS, METHOD OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDER ARE NOT TO BE USED FOR OTHER PURPOSES, AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

P THIS DRAWING PRODUCED ON PRO-ENGINEER

THIS DOCUMENT CONTROLLED BY
CHANGE CONTROL SYSTEM 3
ENGINEERING PROCEDURE SNS-ENG-G001