## GENERAL NOTES

1. SEE SPECIFICATION 15130 FOR ACTIVATED COOLING WATER PIPE SYSTEM INSTALLATION, TESTING AND ASSEMBLY REQUIREMENTS.
2. DIMENSION & ELEVATIONS ARE TO CENTERLINE OF PIPE UNLESS OTHERWISE NOTED.
3. SEE DRAWING Nos J8E8700G080 AND J8E8700G081 FOR PIPE SUPPORT DETAILS.
4. SEE DRAWING Nos J8E8700C220 AND J8E8700C320 FOR OTHER FACILITY PIPING IN THE AREA.
5. MINIMUM PIPE SLOPE IS 1/8" PER FT.

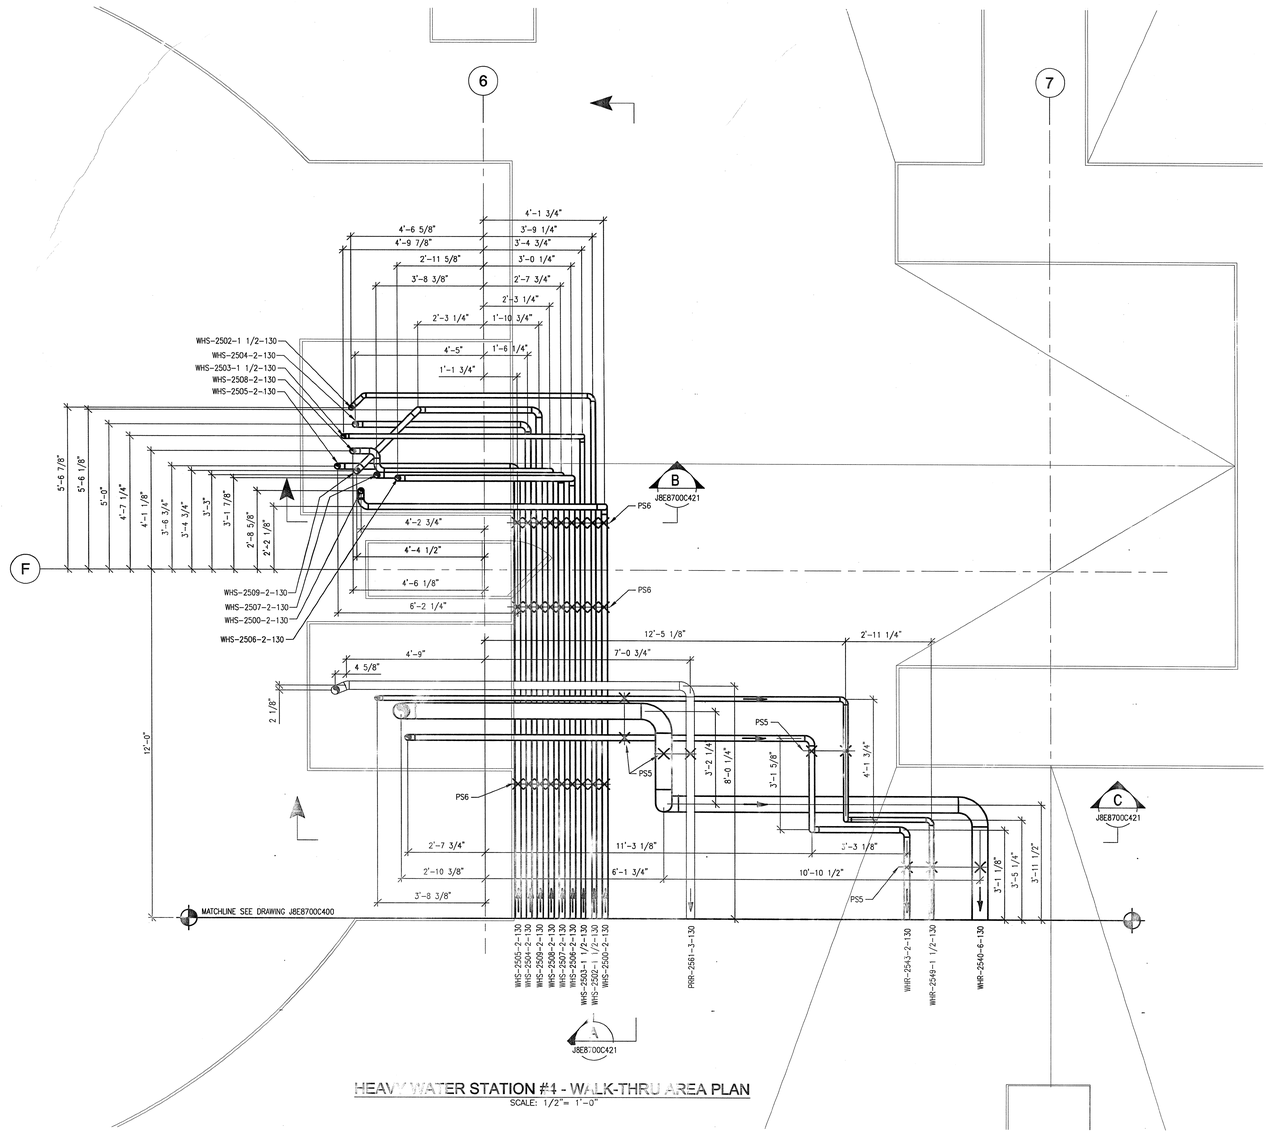


## HEAVY WATER STATION #4 - WALK-THRU AREA PLAN

SCALE: 1/2" = 1'-0"

SCALE 1/2" = 1'-0"

DEVICE DESIGNATOR SEE DWG J8E8700A001 FOR ABBREVIATION LIST

XX / XXXX

DEVICE NUMBER (FOR PLUG)

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ISSUED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDER ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY

CHANGE CONTROL SYSTEM 3

ENGINEERING PROCEDURE SNS-TS-G001

| REV | CHANGE FILE | CHANGE CONTROL SYSTEM | CHANGE REQUEST NUMBER | DESCRIPTION | DSN | CHK | DEPT | DATE | PE | DATE | PJ | DATE | REQ | DATE | UTB | DATE | RPE | RPE NO | DATE | ST | CV | EC | EE | EM | IE | M | PD | SE | AR |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 0 | | | | CERTIFIED FOR CONSTRUCTION - 1/18/02 | JHT | PW | | | | | | | | | | | | 100946 | 1/18/02 | GPR | | | HG | PW | | | | | MBB |

REVISION OR ISSUE PURPOSE — REVISION APPROVALS — SQUAD CHECK

| RPE | | | |
|---|---|---|---|
| | DSN | J.H. TOWNSEND | JHT 10/19/01 |
| | DRW | J.H. TOWNSEND | JHT 10/19/01 |
| | CHK | P. WALLER | 1/5/02 |
| | DEPT | — | |
| | PE | — | |
| | PJ | — | |
| | REQ | — | |
| | UTB | | 1/22/02 |

REV. 0 DATE 1/18/02

DRAWING APPROVALS

106060000-J8E-8700-C420

Knight/Jacobs Joint Venture
701 Scarboro Road, MS 8253
Oak Ridge, TN 37830
865-241-9433
fax 865-241-3400

Sverdrup Technology, Inc.
Tullahoma, TN 37388

UT-BATTELLE

Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under U.S. GOVERNMENT contract DE-AC05-00OR22725
UT-BATTELLE, LLC. • Oak Ridge, Tennessee

PROJECT NAME:

SPALLATION NEUTRON SOURCE

ACTIVATED COOLING WATER SYSTEM
HEAVY WATER STATION #4
WALK-THRU AREA - PLAN VIEW

| 1 | 48 | 49 | 50 | PLANT | BLDG | FL | SH. | OF | TYPE | CLASS |
|---|---|---|---|---|---|---|---|---|---|---|
| 3 | J | X | X | 8 | 8700 | | 1 | 1 | P | U |

| 51 | 52 | 53 | WBS | | REV |
|---|---|---|---|---|---|
| NC | NA | | 106060000 | J8E8700C420 | 0 |

P:\90618\DRAWINGS\ISSUED\MECH\8700\1.6\02-01-18 (EFC)\J8E8700C420.DWN-2002 1:1:12 townsejh