GENERAL NOTES:

1. SEE DRAWINGS E9.21.52 AND E9.21.53 FOR LIGHTING PANEL SCHEDULES.
2. SEE DRAWINGS E9.30.01 AND E9.30.02 FOR FIXTURE SCHEDULES.

KEYED NOTES:

N001	ALL NORMAL LIGHTING FIXTURES ON THIS DRAWING ARE CIRCUITED FROM PANEL 2L6A LOCATED IN ELECTRICAL ROOM 2-3-88.
N002	ALL EMERGENCY LIGHTING FIXTURES AND EXIT SIGNS ON THIS DRAWING ARE CIRCUITED FROM PANEL B1E5A LOCATED IN ELECTRICAL ROOM B1-2-31. LIGHTING IN STAIR NO. 2 TO BE CIRCUITED FROM PANEL B1E3A IN ELECTRICAL ROOM B1-2-31.
N003	ALL FIXTURES ARE MOUNTED 9'-5" A.F.F UNLESS OTHERWISE NOTED.
N004	CORRIDOR FIXTURES (W1) ARE MOUNTED 8'-0" A.F.F
N005	FIXTURES (SU) ARE MOUNTED ON TOP OF ENTRY VESTIBULE, TO ILLUMINATE THE BOTTOM OF ENTRY CANOPY.
N006	FIXTURE (D) IS MOUNTED 1'-0" ABOVE DOOR TO ILLUMINATE STAIRCASE.
N007	CIRCUIT FIXTURE FROM DIMMER PANEL. SEE DWG. E9-21-54-A1.

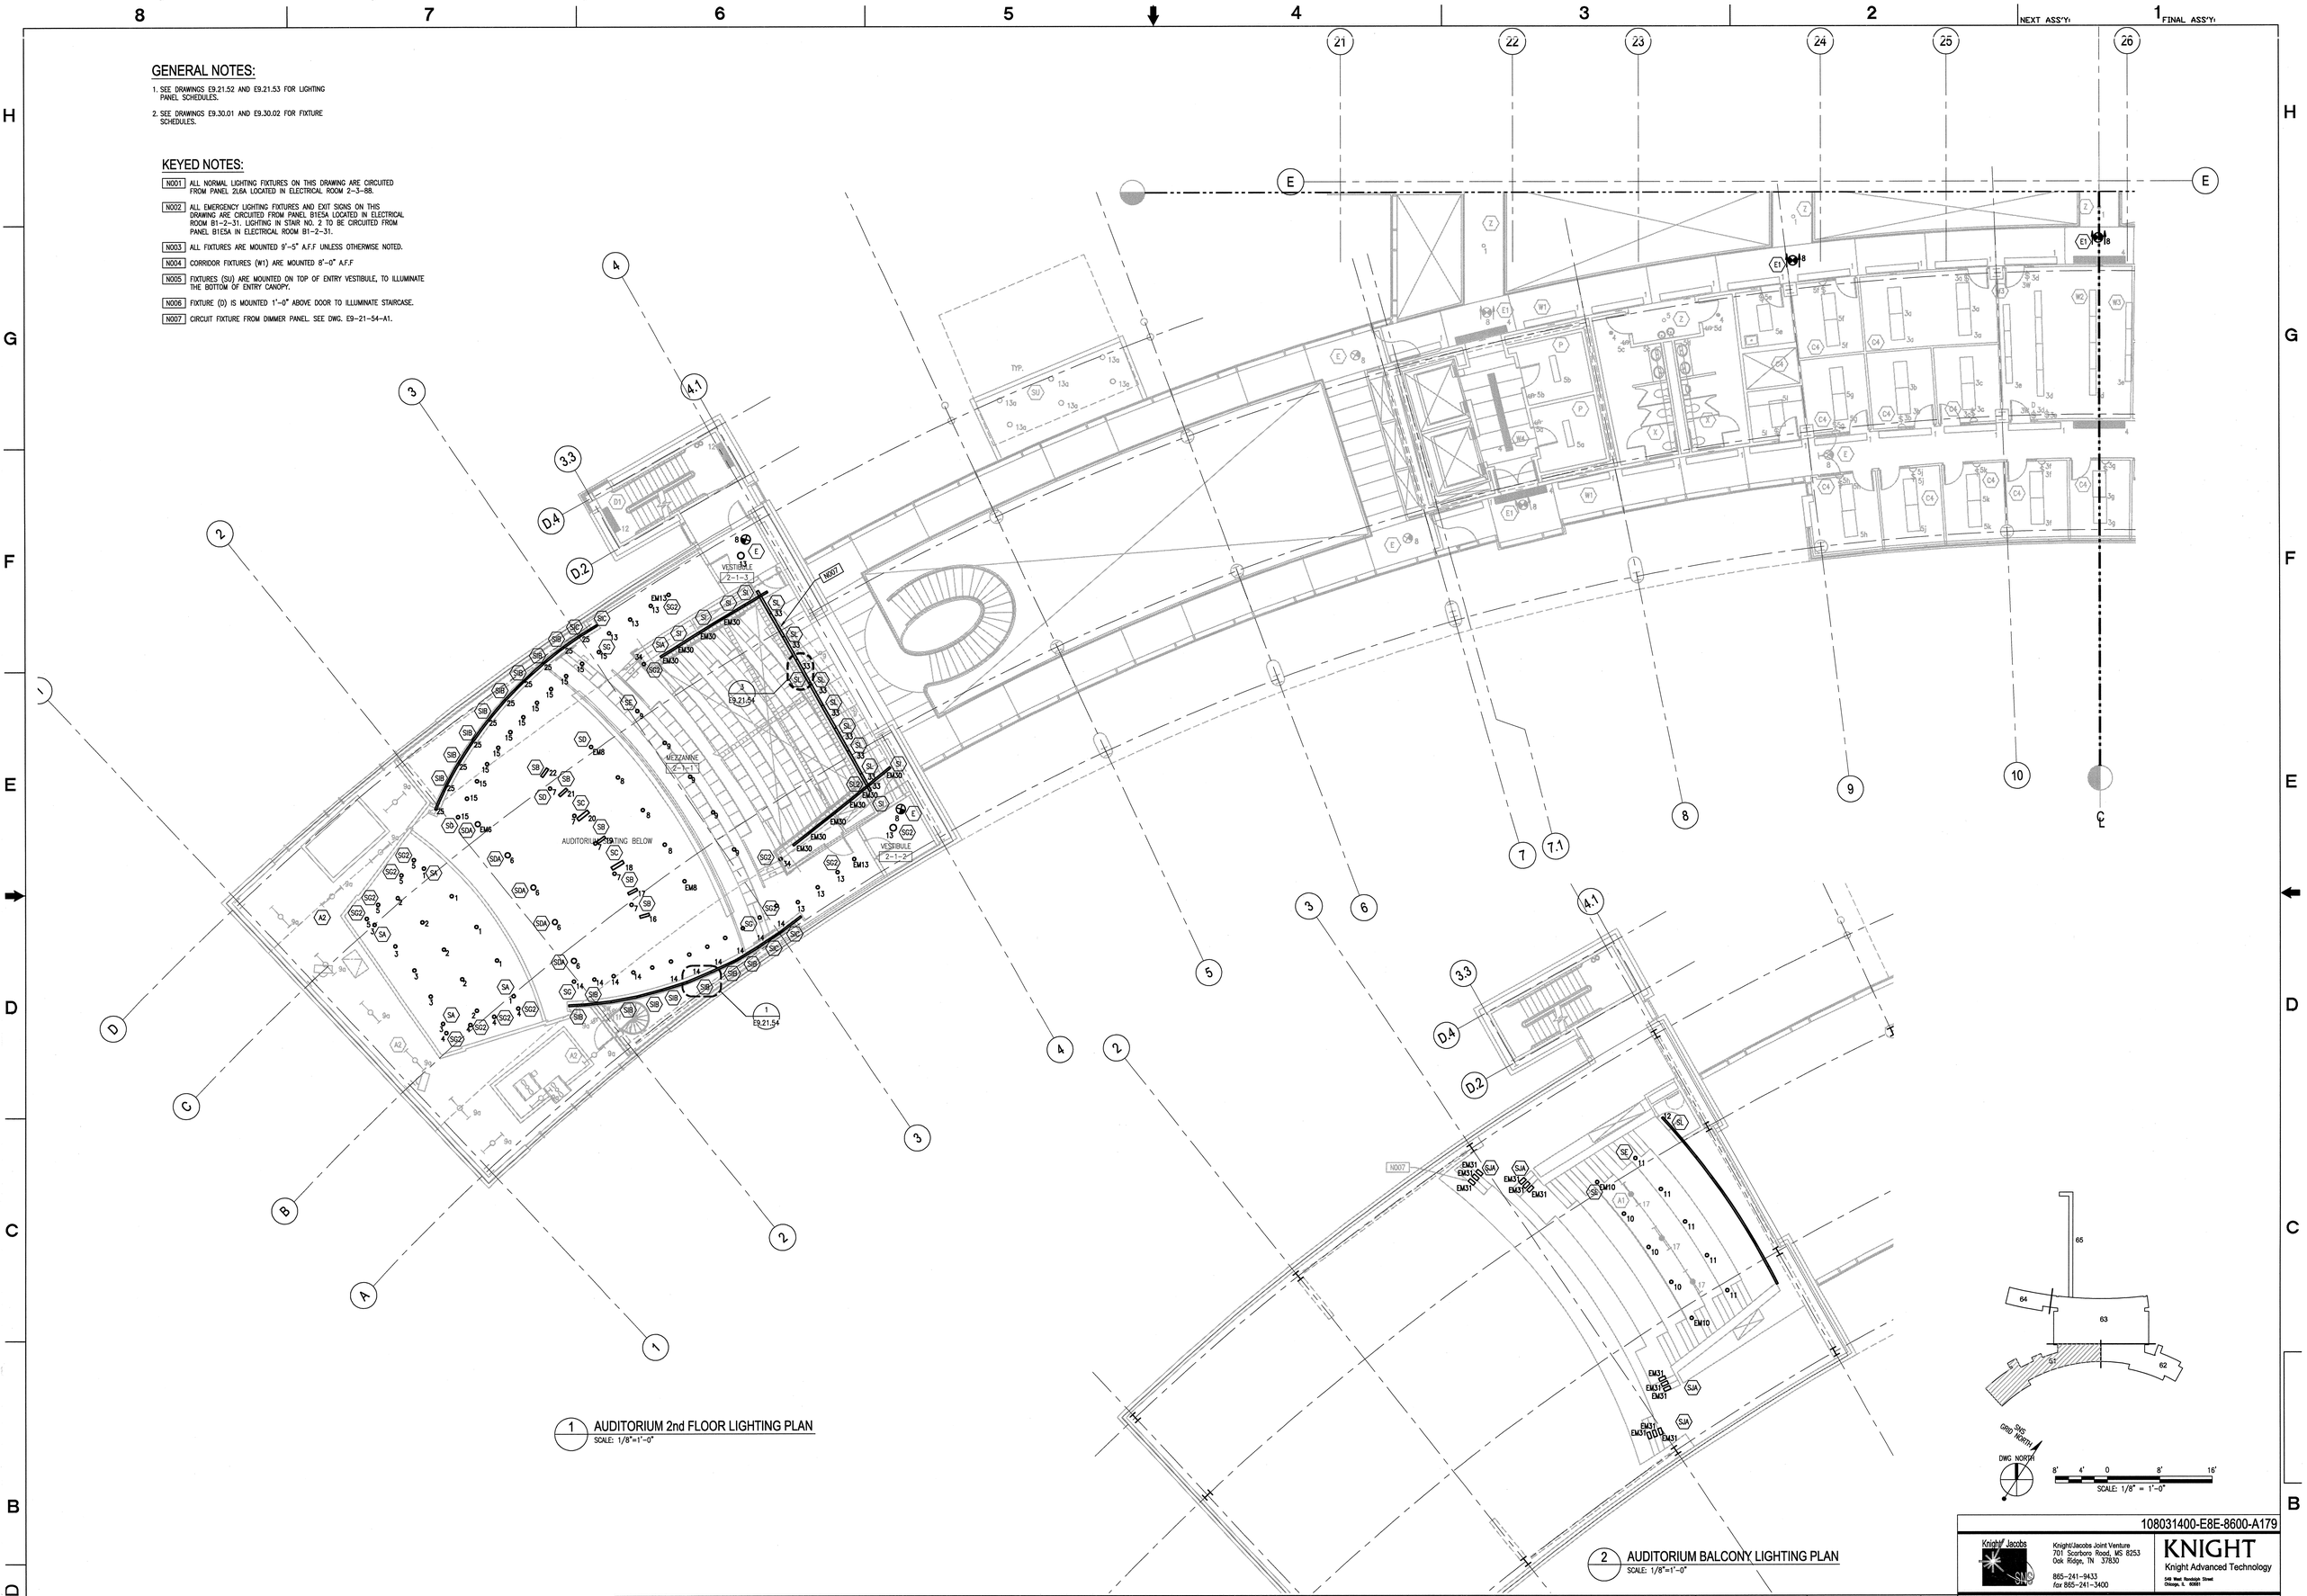

1 AUDITORIUM 2nd FLOOR LIGHTING PLAN
SCALE: 1/8"=1'-0"

2 AUDITORIUM BALCONY LIGHTING PLAN
SCALE: 1/8"=1'-0"

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDER ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

NUMBER OF SECTION OR DETAIL
DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN
SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY
CHANGE CONTROL SYSTEM 4
ENGINEERING PROCEDURE SNS-ENG-0001

REV	CHANGE TYPE	CHANGE CONTROL SYSTEM	CHANGE REQUEST NUMBER	DESCRIPTION	DSN	CHK	DEPT
0				CERTIFIED FOR CONSTRUCTION – 12/20/01	TLW	KJS	

REVISION OR ISSUE PURPOSE

DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE
12/20/01		12/20/01		12/20/01		12/20/01		12/20/01	VGS	106009	12/20/01

REVISION APPROVALS

RW	AW	BWJ	PD	BWJ	BWJ	--	BWJ	--	ED
ST	CV	EC	EE	EM	IE	M	PD	SE	AR

SQUAD CHECK

RPE
VICTOR G. STEFFEN REGISTERED ENGINEER CIVIL No. 00106009 STATE OF TENNESSEE
12-17-01
0 12-17-01
REV. DATE

DSN	T. WHITE	12/20/01
DRW	T. WHITE	12/20/01
CHK	K.SZOT	12/20/01
DEPT		
PE		12/20/01
PJ		12/20/01
REQ		
UTB		12/20/01

DRAWING APPROVALS

108031400-E8E-8600-A179

Knight Jacobs
KnightJacobs Joint Venture
701 Scarboro Road, MS 8253
Oak Ridge, TN 37830
865-241-9433
fax 865-241-3400

KNIGHT
Knight Advanced Technology
345 West Randolph Street
Chicago, IL 60601

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under U.S. GOVERNMENT contract DE-AC05-00OR22725
UT-BATTELLE, LLC. • Oak Ridge, Tennessee

PROJECT NAME:
SPALLATION NEUTRON SOURCE
CENTRAL LAB AND OFFICE BUILDING
ELECTRICAL LIGHTING PLAN
LEVEL 02, SECTOR 61 - ALTERNATE #1E

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8600		1	1	P	U

51	52	53	WBS		REV
NC	NA		1.8.3.14	E3.02.61.A1	0

Date: 12/13/2001 Time: 11:33:04
File: E:\PROJECTS\CAD\E8E8600\A179\E3.02.61.A1.DWG
CAD-V7_CSLD-PROJECTS_1600V_FBI_CAD00_NAVI_LIB_1V1_PLOT_E-ED-61-A1.DWG

AutoCAD