

NOTE: INTERIOR FINISHED FLOOR TO BE 1/2" (13MM) ABOVE EXTERIOR FINISHED FLOOR WITH TRANSITION AT ENTRANCE DOOR


THERMAL BREAK TO BE PRESSURE TREATED HARDWOOD 3"(75MM) WIDE (ACTUAL NET) X REQ'D DEPTH TO PLACE TOP 1/2" (13MM) BELOW FINISHED INTERIOR SURFACE. DRILL 1/2" (13MM) HOLE THROUGH 2" (50MM) FROM TOP & BOTTOM, 24" (600MM) O.C. INSERT 1/2" (13MM) REBAR TO STABILIZE FOR SEISMIC CONDITIONS PRIOR TO BACKFILLING & SUBSTRATE POUR.

SECTION AT BUILDING WALL

- A. 4" (100MM) URETHANE PANEL WITH METAL FACING BY K.E.C.
- B. 1-1/2" (40MM) AIRSPACE
- C. CONCRETE BACKFILL AFTER THERMAL BREAK IS SET IN PLACE, OR PART OF WEARING SLAB BY G.C.
- D. THERMAL BREAK BY G.C.
- E. LAG 2" X 2" X 2" X 1/8" (50MM X 50MM X 50MM X 3MM) STEEL ANGLE TO THERMAL BREAK AND SLAB 24"(600MM) O.C. BY G.C.
- F. ASPHALT PAPER OR 8 MIL POLYETHYLENE WITH SEALED JOINTS, BY G.C.
- G. URETHANE FLOOR INSULATION BY G.C. (MINIMUM INSULATION VALUE OF R-30)
- H. 15 LB. FELT SLIP SHEET BY G.C.
- I. WEARING SLAB BY G.C.
- J. 1" (25MM) SQ. WIRE CLOTH 20 GA. (.9MM) ZINC COATED STEEL BY G.C.
- K. SUBSTRATE BY G.C.
- L. INTERIOR BASE & FLOOR BY G.C.
- M. FASTEN THRU SCREED MINIMUM 3"(75MM) INTO THERMAL BREAK 24" O.C. BY G.C.
- N. METAL LATH BY G.C. FASTEN TO PANEL WITH NO. 10 X 3/4" (20MM) LONG S/S OVAL HEAD SHEET METAL SCREW WITH WASHER

NOTE: BUILT-IN INSULATED FLOOR BY GENERAL CONTRACTOR (G.C.). VERTICAL WALK-IN WALLS BY KITCHEN EQUIPMENT CONTRACTOR (K.E.C.)

APPROVED: 08-01-01

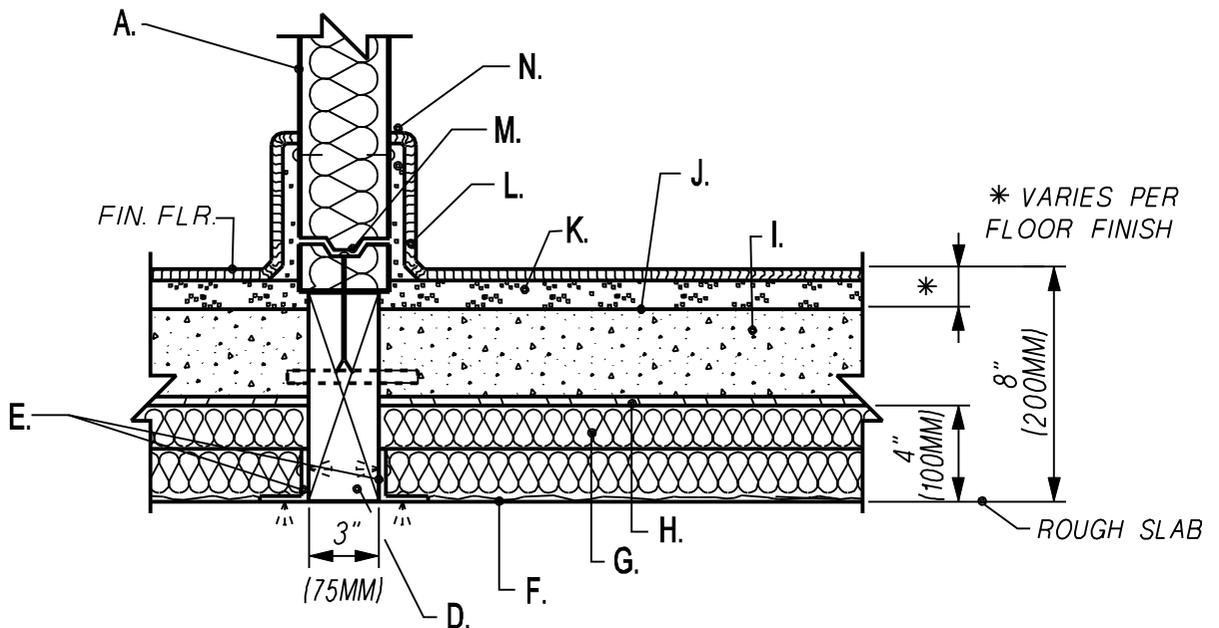

THERMAL BREAK TO BE PRESSURE TREATED HARDWOOD. 3"(75MM) WIDE (ACTUAL NET) X REQ'D DEPTH TO PLACE TOP 1/2" (13MM) BELOW FINISHED INTERIOR SURFACE. DRILL 1/2" (13MM) HOLE THROUGH 2" (50MM) FROM TOP, 24" (600MM) O.C. INSERT 1/2" (13MM) REBAR TO STABILIZE FOR SEISMIC CONDITIONS PRIOR TO WEARING SLAB POUR.

SECTION AT INTERIOR PARTITION

- A. 4" (100MM) URETHANE PANEL WITH METAL FACING BY K.E.C.
- B. NOT USED
- C. NOT USED
- D. THERMAL BREAK BY G.C.
- E. LAG 2" X 2" X 2" X 1/8" (50MM X 50MM X 50MM X 3MM) STEEL ANGLE TO THERMAL BREAK AND SLAB 24"(600MM) O.C. BY G.C.
- F. ASPHALT PAPER OR 8 MIL POLYETHYLENE WITH SEALED JOINTS, BY G.C.
- G. URETHANE FLOOR INSULATION BY G.C. (MINIMUM INSULATION VALUE OF R-30)
- H. 15 LB. FELT SLIP SHEET BY G.C.
- I. WEARING SLAB BY G.C.
- J. 1" (25MM) SQ. WIRE CLOTH 20 GA. (.9MM) ZINC COATED STEEL BY G.C.
- K. SUBSTRATE BY G.C.
- L. INTERIOR BASE & FLOOR BY G.C.
- M. FASTEN THRU SCREED MINIMUM 3"(75MM) INTO THERMAL BREAK 24" O.C. BY G.C.
- N. METAL LATH BY G.C. FASTEN TO PANEL WITH NO. 10 X 3/4" (20MM) LONG S/S OVAL HEAD SHEET METAL SCREW WITH WASHER

NOTE: BUILT-IN INSULATED FLOOR BY GENERAL CONTRACTOR (G.C.). VERTICAL WALK-IN WALLS BY KITCHEN EQUIPMENT CONTRACTOR (K.E.C.)

APPROVED: 08-01-01

CINI•LITTLE


BUILT-IN INSULATED FLOOR BY G.C.

NO SCALE

SEE ALSO 7.01

STANDARD DETAIL

7.01.1

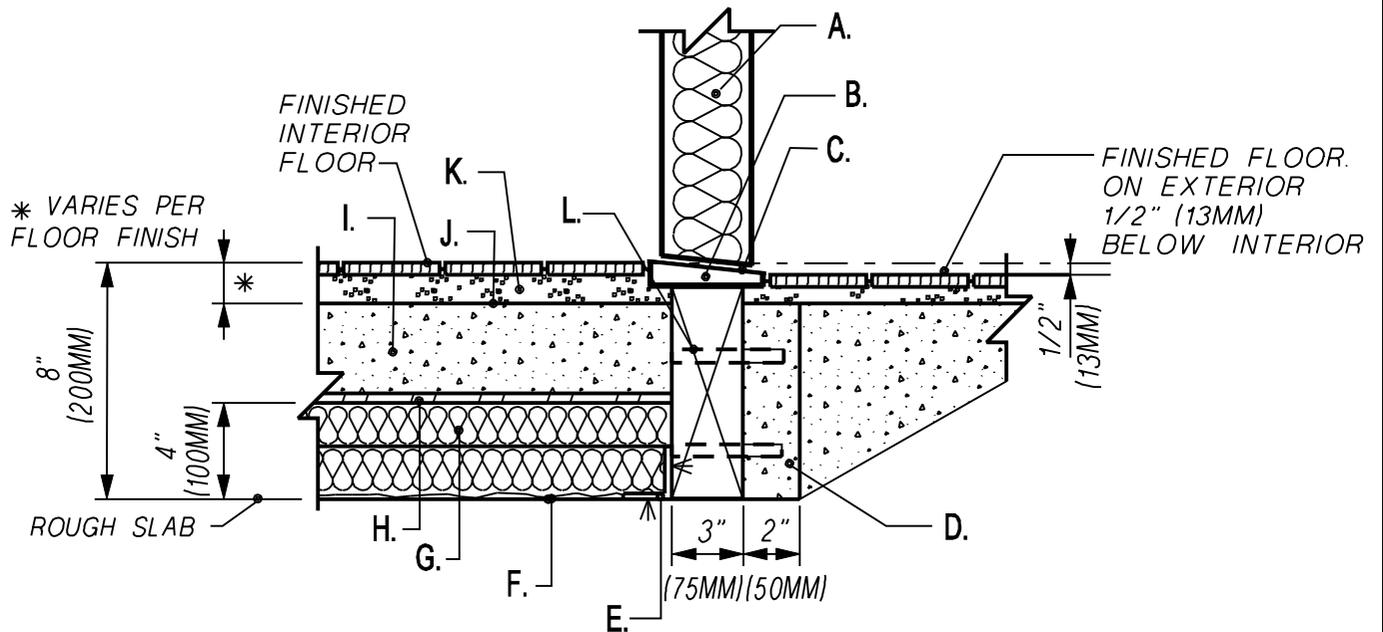

THERMAL BREAK TO BE PRESSURE TREATED HARDWOOD. 3"(75MM) WIDE (ACTUAL NET) X REQ'D DEPTH TO PLACE TOP 1/2" (13MM) BELOW FINISHED INTERIOR SURFACE. DRILL 1/2" (13MM) HOLE THROUGH 2" (50MM) FROM TOP & BOTTOM, 24" (600MM) O.C. INSERT 1/2" (13MM) REBAR TO STABILIZE FOR SEISMIC CONDITIONS PRIOR TO BACKFILLING & SUBSTRATE POUR.

SECTION AT ENTRANCE DOOR FROM EXTERIOR OF WALK-IN

- A. WALK-IN REFRIGERATOR DOOR BY K.E.C.
- B. THRESHOLD ANCHOR AND HEATER STRIP FURNISHED BY KEC & INSTALLED BY G.C.
- C. THRESHOLD BY WALK-IN MFG. SLOPED 1/2" (13MM) DOWN FROM INTERIOR TO EXTERIOR
- D. CONCRETE BACKFILL AFTER THERMAL BREAK IS SET IN PLACE, OR PART OF WEARING SLAB BY G.C.
- E. LAG 2" X 2" X 2" X 1/8" (50MM X 50MM X 50MM X 3MM) STEEL ANGLE TO THERMAL BREAK AND SLAB 24"(600MM) O.C. BY G.C.
- F. ASPHALT PAPER OR 8 MIL POLYETHYLENE WITH SEALED JOINTS, BY G.C.
- G. URETHANE FLOOR INSULATION BY G.C. (MINIMUM INSULATION VALUE OF R-30)
- H. 15 LB. FELT SLIP SHEET BY G.C.
- I. WEARING SLAB BY G.C.
- J. 1" (25MM) SQ. WIRE CLOTH 20 GA. (.9MM) ZINC COATED STEEL BY G.C.
- K. SUBSTRATE BY G.C.
- L. THERMAL BREAK BY G.C.

NOTE: NO THRESHOLD AT INTERIOR DOORS

NOTE: BUILT-IN INSULATED FLOOR BY GENERAL CONTRACTOR (G.C.). VERTICAL WALK-IN WALLS BY KITCHEN EQUIPMENT CONTRACTOR (K.E.C.)

APPROVED: 08-01-01

CINI•LITTLE

BUILT-IN INSULATED FLOOR BY G.C.

NO SCALE

SEE ALSO 7.01

STANDARD DETAIL

7.01.2