MATCHLINE - SEE SHEET NO. UEL2.61.J4

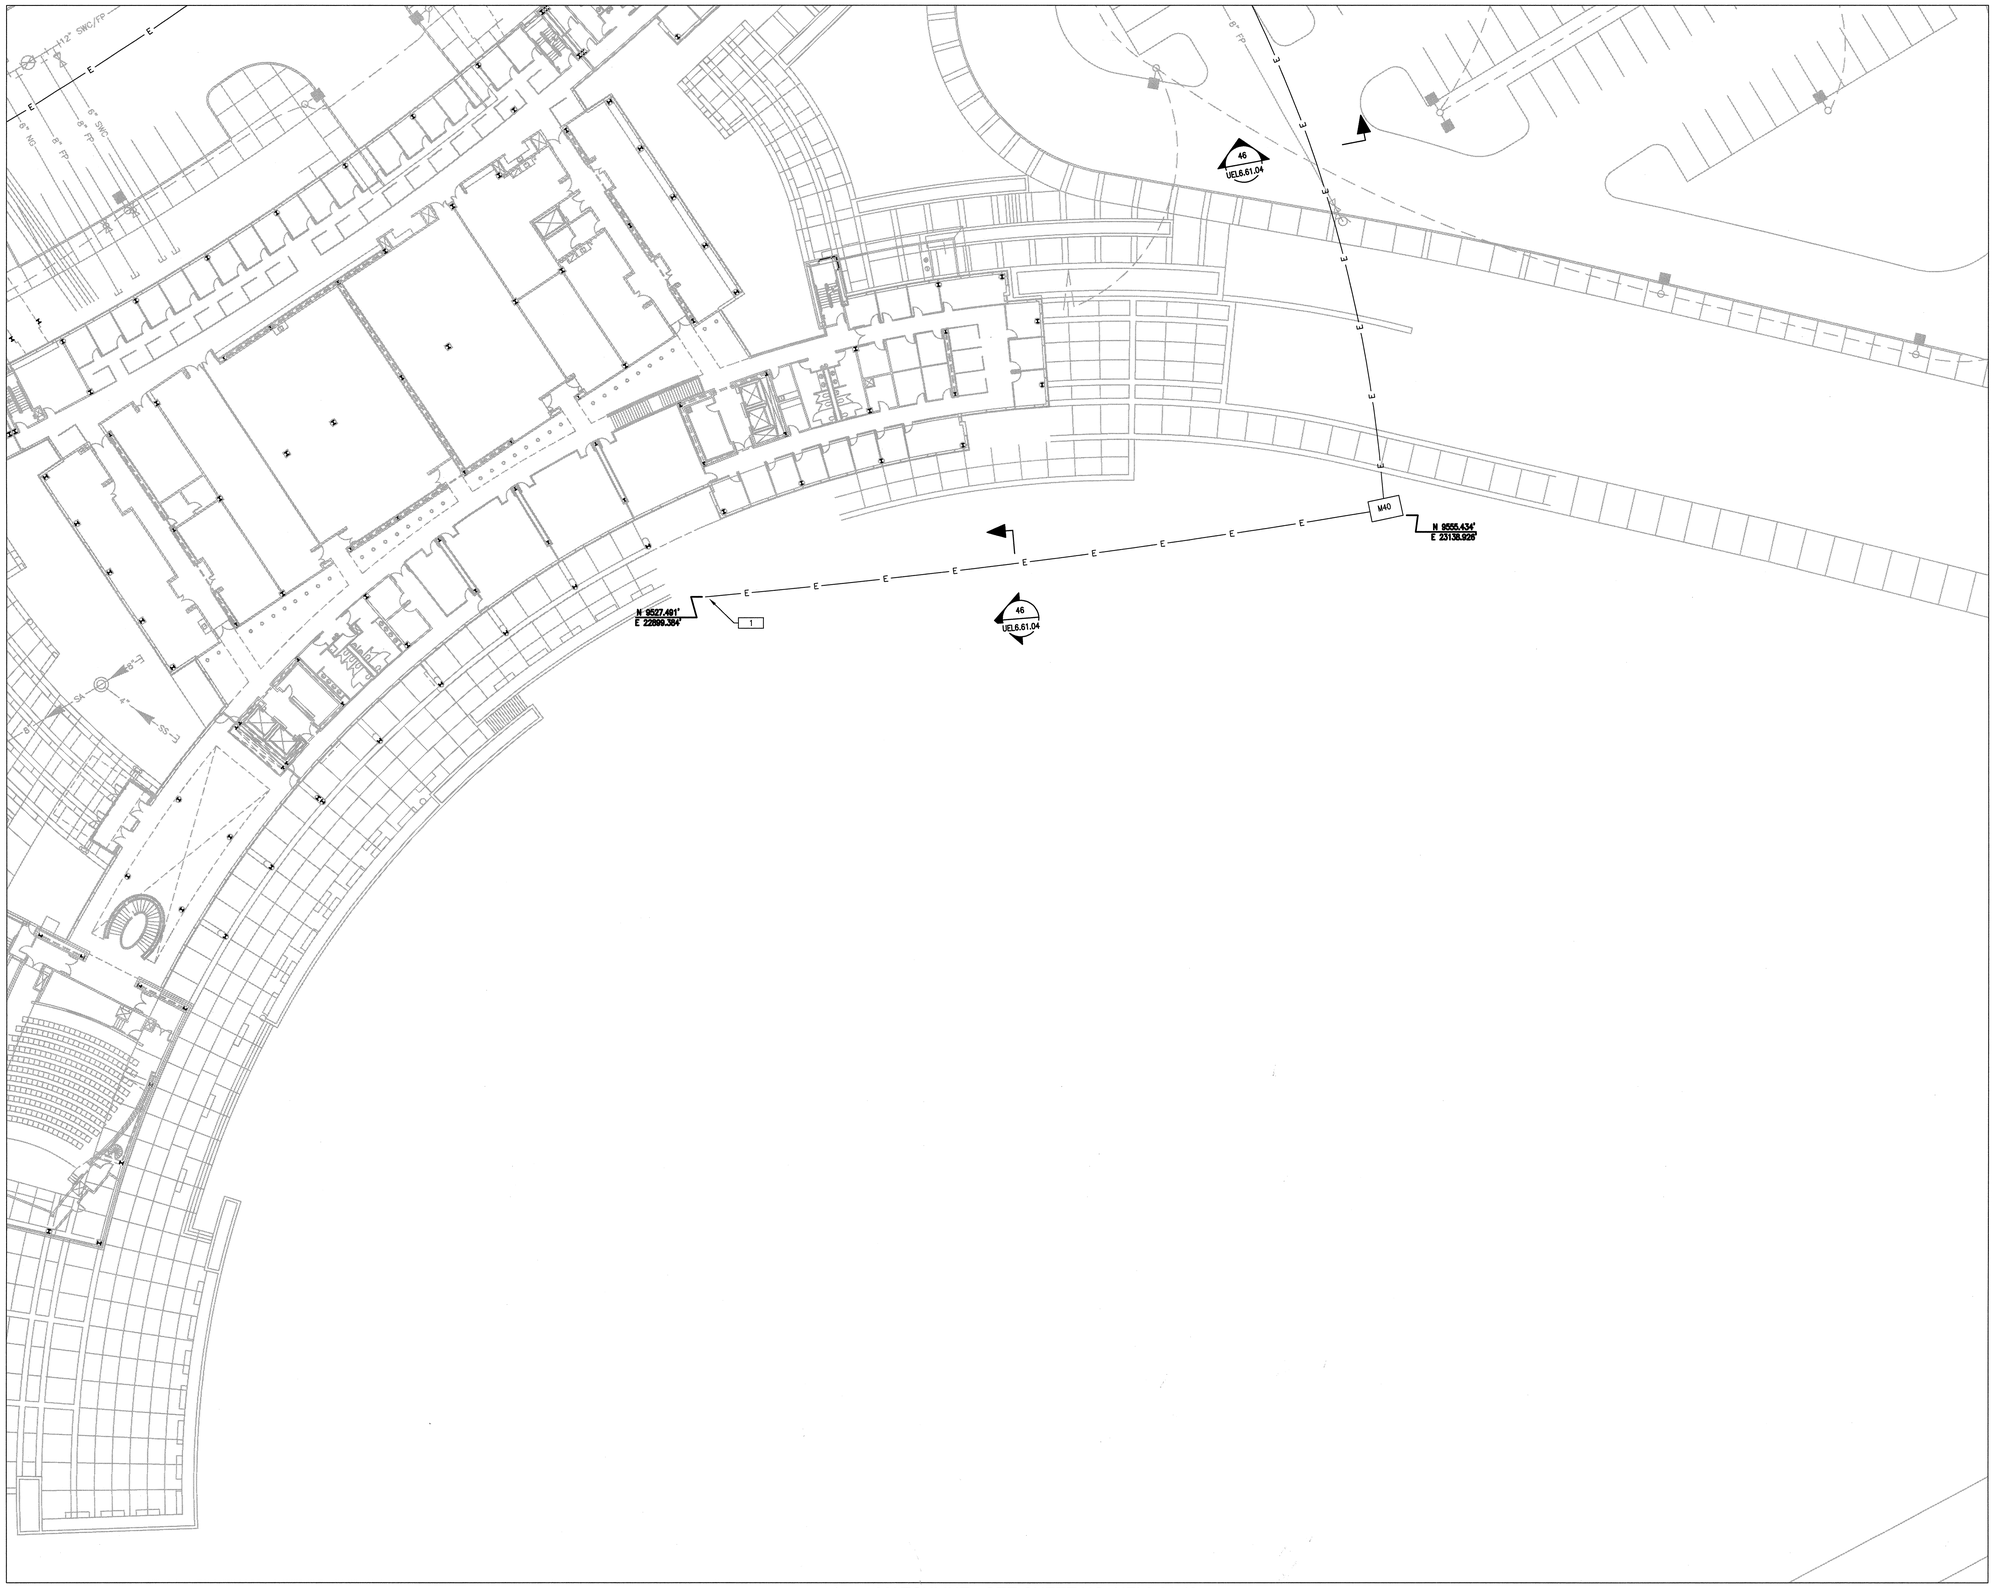

MATCHLINE - SEE SHEET NO. UEL2.61.H5

MATCHLINE - SEE SHEET NO. UEL2.61.J6

GENERAL NOTES:

1. ALL POWER CONDUITS ARE 5" AND COMMUNICATION CONDUITS ARE 4" UNLESS NOTED OTHERWISE.
2. SEE DRAWINGS UEL6.61.08, UEL6.61.09 FOR MANHOLE, HANDHOLE, PULL BOX AND DUCTBANK REINFORCEMENT DETAILS.
3. CONTRACTOR SHALL COORDINATE WITH CONSTRUCTION MANAGER THE INSTALLATION OF DUCTBANKS WITH BUILDING LAYOUTS.
4. CONTRACTOR SHALL MAKE NO SPLICES IN THE MANHOLE UNLESS NOTED OTHERWISE.
5. COMMUNICATION CABLE INSTALLATION SHALL BE COORDINATED WITH THE CONSTRUCTION SCHEDULE AND CABLE SHALL BE COILED UP IN THE NEAREST MANHOLE TO BE PULLED INTO THE BUILDING WHEN REQUIRED.
6. PROVIDE 2" DRAIN PIPE FROM THE MANHOLE SUMP UPTO THE DAYLIGHT AREA.

KEY NOTES:

1 NOT USED.

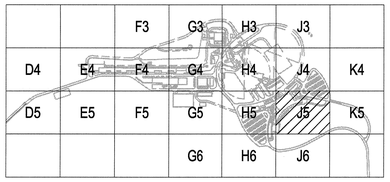

KEY PLAN



108040000-U8E-8000-A170

Knight/Jacobs
Knight/Jacobs Joint Venture
701 Scarboro Road, MS 8253
Oak Ridge, TN 37830
865-241-9433
fax 865-241-3400

KNIGHT
Knight Advanced Technology
4710 E. Elwood, Bldg. 1, 2F
Phoenix, AZ 85040

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725
UT-BATTELLE, LLC. • Oak Ridge, Tennessee

PROJECT NAME:
SPALLATION NEUTRON SOURCE

SITE UTILITIES
ELECTRICAL PLAN
BLOCK J5

RPE		
DSN	P.DESHMUKH	10/30/01
DRW	J.BROWN	10/30/01
CHK	P.DESHMUKH	10/30/01
DEPT		
PE		11/15/01
PE		11/15/01
REQ		
UTB		11/5/01

VICTOR G. STEELE, REGISTERED ENGINEER, No. 00108(6/93), STATE OF TENNESSEE

0 REV. 11-5-01 DATE

DRAWING APPROVALS

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	U	X	X	8	8000		1	1	P	U
51		52		53	WBS					REV
NC		NA			1.8.4		UEL2.61.J5			0

REV	CHANGE TYPE	CHANGE CONTROL SYSTEM	CHANGE REQUEST NUMBER	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR
0				CERTIFIED FOR CONSTRUCTION + BASIS OF AWARD - 10/30/2001	PD	PD			11/15/01		11/15/01				11/15/01	VGS	106009	10/30/01	RW	AW	BS	AK	BS	BJ	--	BS	--	WS

REVISION OR ISSUE PURPOSE — REVISION APPROVALS — SQUAD CHECK

THIS DOCUMENT CONTROLLED BY

CHANGE CONTROL SYSTEM 4

ENGINEERING PROCEDURE SNS-ENG-G001

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

SECTION AND DETAIL KEY

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDER ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

AutoCAD

Date: 10/24/2001 Time: 11:41:48
Drawing: UEL2.61.J5
PW-F:_OLD\PROJECTS\1000\100_0400\UEL_1\1U_PLOT\UEL2-61-J5.DWG