


- KEYNOTES**
- ① 1/2" SH, 1/2" SW & 1-1/4" DOWN INSIDE WALL TO COFFEE STATION. FIXTURES TO INCLUDE SINK AND FAUCET SET.
 - ② 1/2" PW, 1/2" PH & 1-1/2" DOWN INSIDE WALL TO LAB SINK. 1/2" PW & 1/2" PH DOWN TO FUME HOOD. HOOD CAP SINK AND FAUCETS FURNISHED BY HOOD VENDOR. LAB SINK & EYE WASH FURNISHED BY LAB CASEWORK VENDOR. PROVIDE GOOSENECK LAB SINK FAUCET SET EQUAL TO CHICAGO FAUCET MODEL #943 QD29B WITH INTEGRAL VACUUM BREAKER & WRIST HANDLES. ROUTE HORIZONTAL PIPING IN CASEWORK PIPE CHASE ON UNRESTRICTED SUPPORTS.
 - ③ 1-1/2" DOWN INSIDE WALL TO EMERGENCY EYEWASH AND SHOWER. EYEWASH & SHOWER STATION SHALL BE EQUAL TO GUARDIAN MODEL 1950 WITH BALL VALVE & PULL RING. SEE DETAIL 11/P6.10.01
 - ④ 1/2" PW, 1/2" PH, 1/2" DIS, 1/2" DR & 1-1/4" DOWN INSIDE WALL TO LAB SINK. LAB SINK & HAND EYEWASH FURNISHED BY CASEWORK VENDOR. FOR PW & PH, PROVIDE GOOSENECK LAB SINK FAUCET SET EQUAL TO CHICAGO FAUCET MODEL #943 QD29B WITH INTEGRAL VACUUM BREAKER & WRIST HANDLES. FOR DIS, PROVIDE GOOSENECK FAUCET EQUAL TO CHICAGO FAUCET MODEL 8708

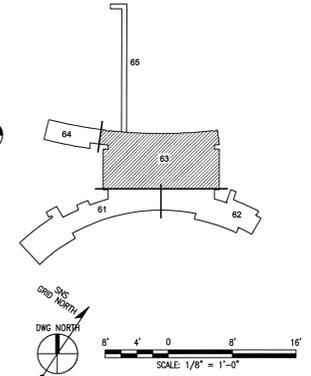

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSIGNED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO RECORD ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FURNISHING CONTRACTOR.

SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY
CHANGE CONTROL SYSTEM 4
ENGINEERING PROCEDURE SNS-ENG-0001

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR
0		CERTIFIED FOR CONSTRUCTION - 12/20/01	EB	KJH		12/20/01											RW	AW	BNJ	PD	BNJ	BNJ		BNJ		ED
1	12/20/01																									

RPE

DSN M. WITHROW 12/20/01
DRW T. WHITE JR. 12/20/01
CHK B. JOHNSON 12/20/01

DEPT
PE
P.J. *M. Withrow*
REQ

REV. 0 12/20/01
DATE

UTB *B. Johnson* 12/26/01
DRAWING APPROVALS

108031400-P8E-8600-A084

KNIGHT
Knight Advanced Technology
201 Scarborough Road, MS 8253
Oak Ridge, TN 37830
865-241-9433
For 865-241-3400

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT CONTRACT DE-AC05-00OR22725
UT-BATTELLE, LLC • Oak Ridge, Tennessee

PROJECT NAME:
**SPALLATION NEUTRON SOURCE
CENTRAL LAB AND OFFICE BUILDING
LEVEL 2, SECTOR 63 - ALTERNATE #1D**

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	P	X	X	8	8800		1	1	P	U
51	52	53	WBS	1.8.3.14						
NC	NA									

P2.02.63.A1 REV 0