


- SHEET KEYNOTES**
- N002 FINISHED SLAB ELEVATION OF SERVICE YARD IS 1037.75
 - N003 PW/PCW LINES SHALL BE RUN AT A ELEVATION OF 1048.0. PIPING SHALL PENETRATE THE FOUNDATION WALL AND BE FLANGED APPROXIMATELY 6" INCHES FROM THE INTERIOR FACE OF THE WALL. EXTERIOR PIPING SHALL EXTEND 5 FEET AND BE CAPPED.
 - N006 EXTERIOR PIPING SHALL EXTEND 5' FEET FROM BUILDING AND BE CAPPED.
 - N007 PIPES TO BE STUBBED 12" AFF WITH BLIND FLANGE FOR FUTURE CONNECTION.
 - N008 SLUMP BASIN: 30" DIA. X 5'-0" DEEP. THE POLYFIBER BASIN SHALL BE ENCASED IN CONCRETE PIT (50" LD W/ 6" WIDE WALLS). STEEL BASE PLATES TO BASIN TO PIT.
 - N009 GREASE INTERCEPTOR: 23"W X 32-1/4"LONG X 53-1/2" DEEP. INLET INVERT AT -2'-10" (1053.69) BELOW FINISHED FLOOR. INTERCEPTOR TO BE ENCASED IN 6" THICK CONCRETE ENCASEMENT PIT. ALLOW 2"+/- GROUT TO SET FLUSH WITH FLOOR.
 - N010 BACKFLOW PREVENTER SHALL BE OF THE REDUCED PRESSURE TYPE
 - N011 PROVIDE LOCKABLE BALL VALVE PER SPECIFICATION 15100

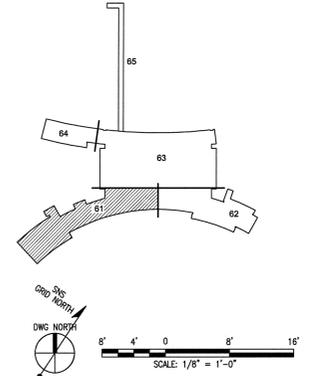

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPROPRIATE METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSIGNED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY CHANGE CONTROL SYSTEM ENGINEERING PROCEDURE SNS-ENG-0001

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	LTB	DATE	RPE	RPE NO	DATE
1		CERTIFIED FOR CONSTRUCTION - 12/20/01	EB	KJH													
0		CERTIFIED FOR CONSTRUCTION - MAY 15, 2001	EB	KJH													

REV	DATE	DESCRIPTION	UTB	J.R. LAWSON	DATE
1	12/20/01				

108031400-P8E-8600-A005

KNIGHT
Knight Advanced Technology

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT CONTRACT DE-AC05-00OR22725

PROJECT NAME:
**SPALLATION NEUTRON SOURCE
CENTRAL LAB AND OFFICE BUILDING
PLUMBING FLOOR PLAN
LEVEL B1, SECTOR 61**

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	P	X	X	8	8800		1	1	P	U
51	52	53	WBS	1.8.3.14						
NC	NA									

P2.B1.61
REV 1

AutoCAD