
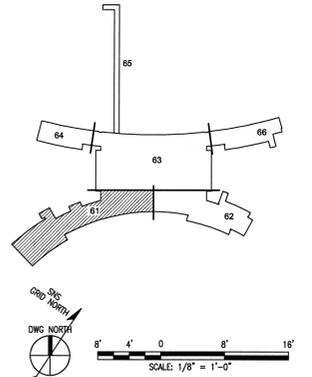


**KEYNOTES:**

**N001** FURNISH AND INSTALL: (4) - 2" PVC UNDERGROUND EMPTY SPARE CONDUITS WITH PULL WIRE AND EXTEND 5'-0" OUTSIDE OF BLDG. AND CAP. REFER TO BNSC.DWG ULTS.35.04 FOR CONTINUATION OF OUTDOOR LIGHTING REQUIREMENTS.

**N002** STUB CONDUITS UP 24" ABOVE GRADE.

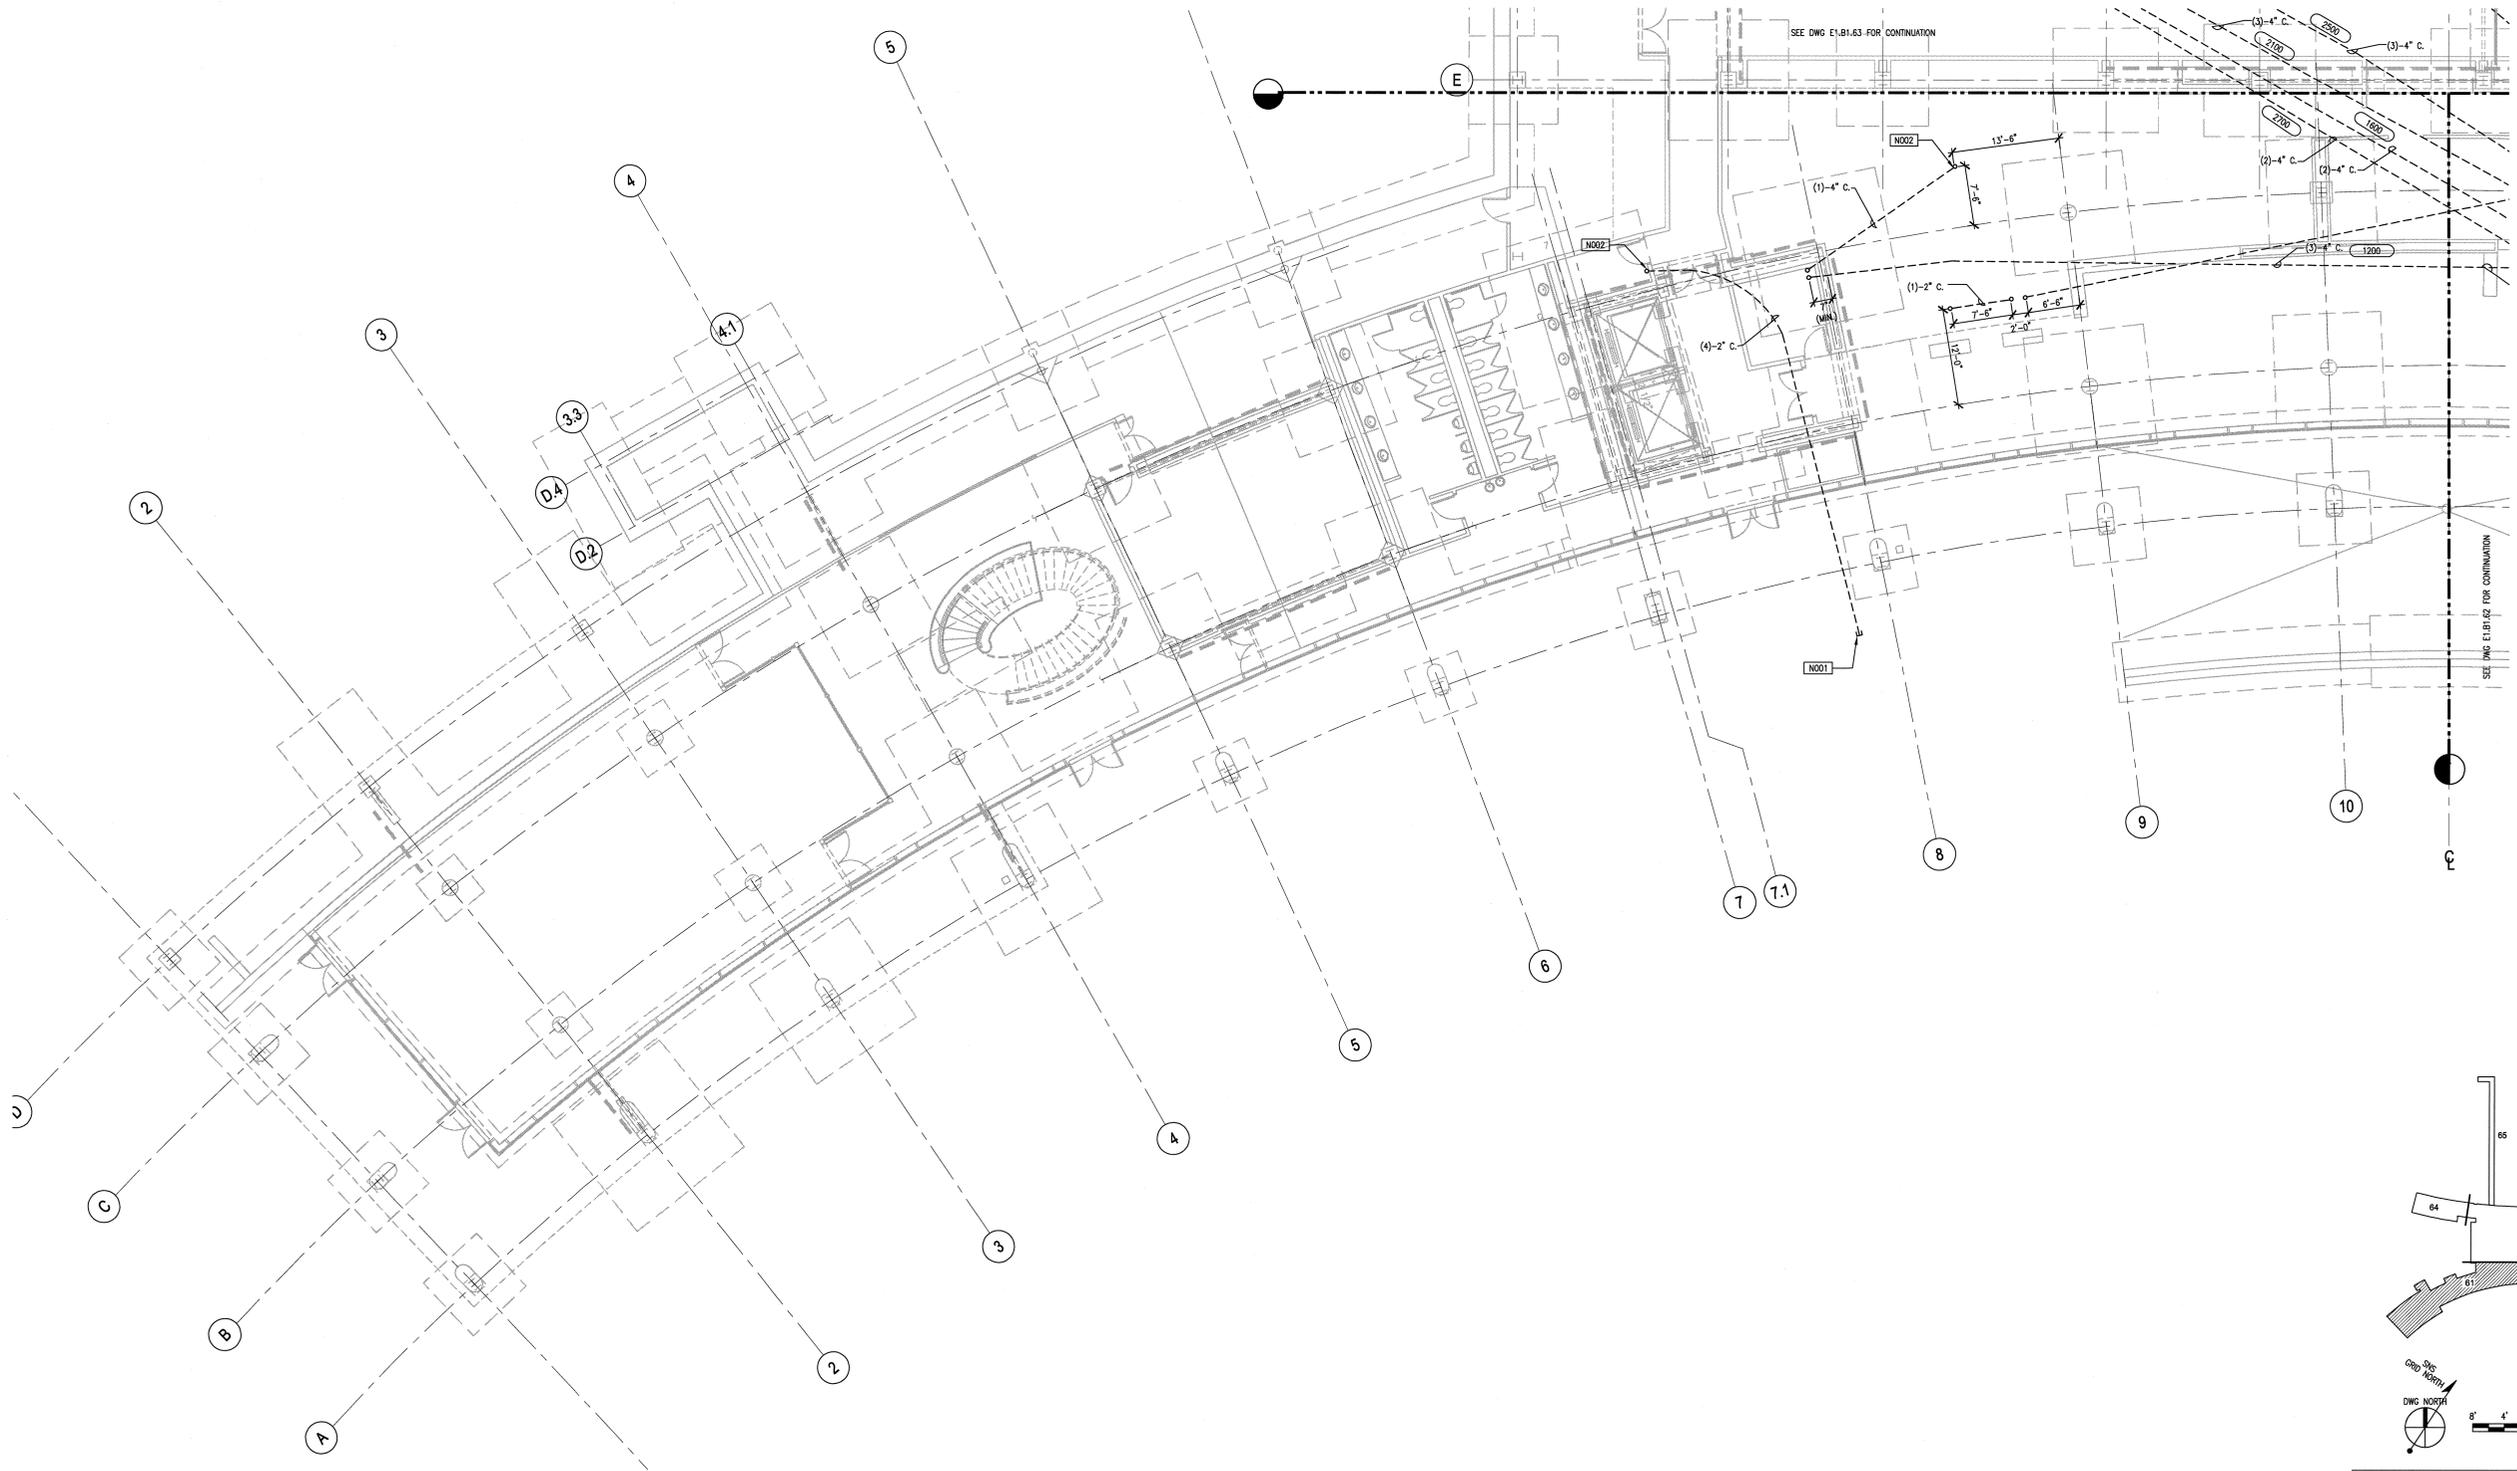

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS MAY NOT VIOLATE PATENT RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DESCRIBED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS AND NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

**SECTION AND DETAIL KEY**

THIS DOCUMENT CONTROLLED BY

CHANGE CONTROL SYSTEM

ENGINEERING PROCEDURE SIS-ENG-0201

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE	NO	DATE
1		CERTIFIED FOR CONSTRUCTION - 05/15/2001	RO	RL			05/15/01	05/15/01									
0		CERTIFIED FOR CONSTRUCTION - 10/25/2001	RO	RL			10/25/01	10/25/01									

RPE

DSN ROLAPOUR 51501

DRW S. BARRETT 51501

CHK RLENNIG 51501

DEPT

PE

PJ

REQ

UTB

REV 1 5-11-01

DATE

DRAWING APPROVALS

108031400-E8E-8600-A011

**KNIGHT**  
Knight Advanced Technology

Oak Ridge National Laboratory  
managed for the DEPARTMENT OF ENERGY under  
U.S. GOVERNMENT contract DE-AC05-00OR22725  
UT-BATTELLE, LLC • Oak Ridge, Tennessee

**PROJECT NAME:**  
SPALLATION NEUTRON SOURCE  
CENTRAL LAB AND OFFICE BUILDING  
LEVEL B1, SECTOR 61

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8600		1	1	P	U
51	52	53	WBS							
NC	NA		1.8.3.14						E1.B1.61	1

AutoCAD

A

8