
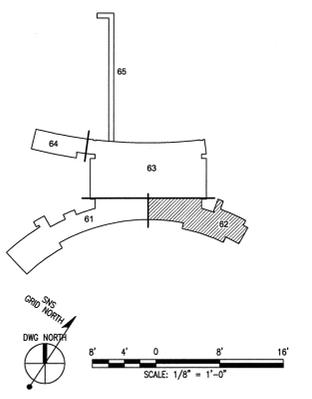


GENERAL NOTES:
 1. FURNISH AND INSTALL UNDERGROUND DUCT BANKS AND EMPTY CONDUITS AS SHOWN ON THIS DRAWING AND DESCRIBED IN SPECIFICATIONS.
 2. FIELD VERIFY THE EXACT LOCATION OF ALL THE STUB-OUTS, DUCT BANKS AND CONDUIT ROUTINGS. COORDINATE WITH OTHER TRADES.

KEYNOTES:
 N001 FURNISH AND INSTALL (4) - 4" PVC CONCRETE ENCASED UNDERGROUND DUCT BANK ALL WORK SHOWN BEYOND 5'-0" OF BLDG. EXTERIOR IS NOT PART OF THE SCOPE. FURNISH AND INSTALL #4/0 BARE GROUND AS PART OF THE CONCRETE DUCT BANK. ALLOW 5' GROUND WIRE ABOVE FINISHED GRADE AND COIL WIRE ON BOTH ENDS.
 N002 FURNISH AND INSTALL (2) 1" SPARE PVC CONDUITS.
 N003 FURNISH AND INSTALL (4) - 2" PVC UNDERGROUND EMPTY SPARE CONDUITS WITH PULL WIRE AND EXTEND 5'-0" OUTSIDE OF BLDG. AND CAP.
 N004 STUB CONDUITS UP 24" ABOVE GRADE.
 N005 FURNISH AND INSTALL (4) - 4" PVC CONCRETE ENCASED UNDERGROUND DUCT BANK. ALL WORK BEYOND 5'-0" OF BUILDING EXTERIOR IS NOT PART OF SCOPE.

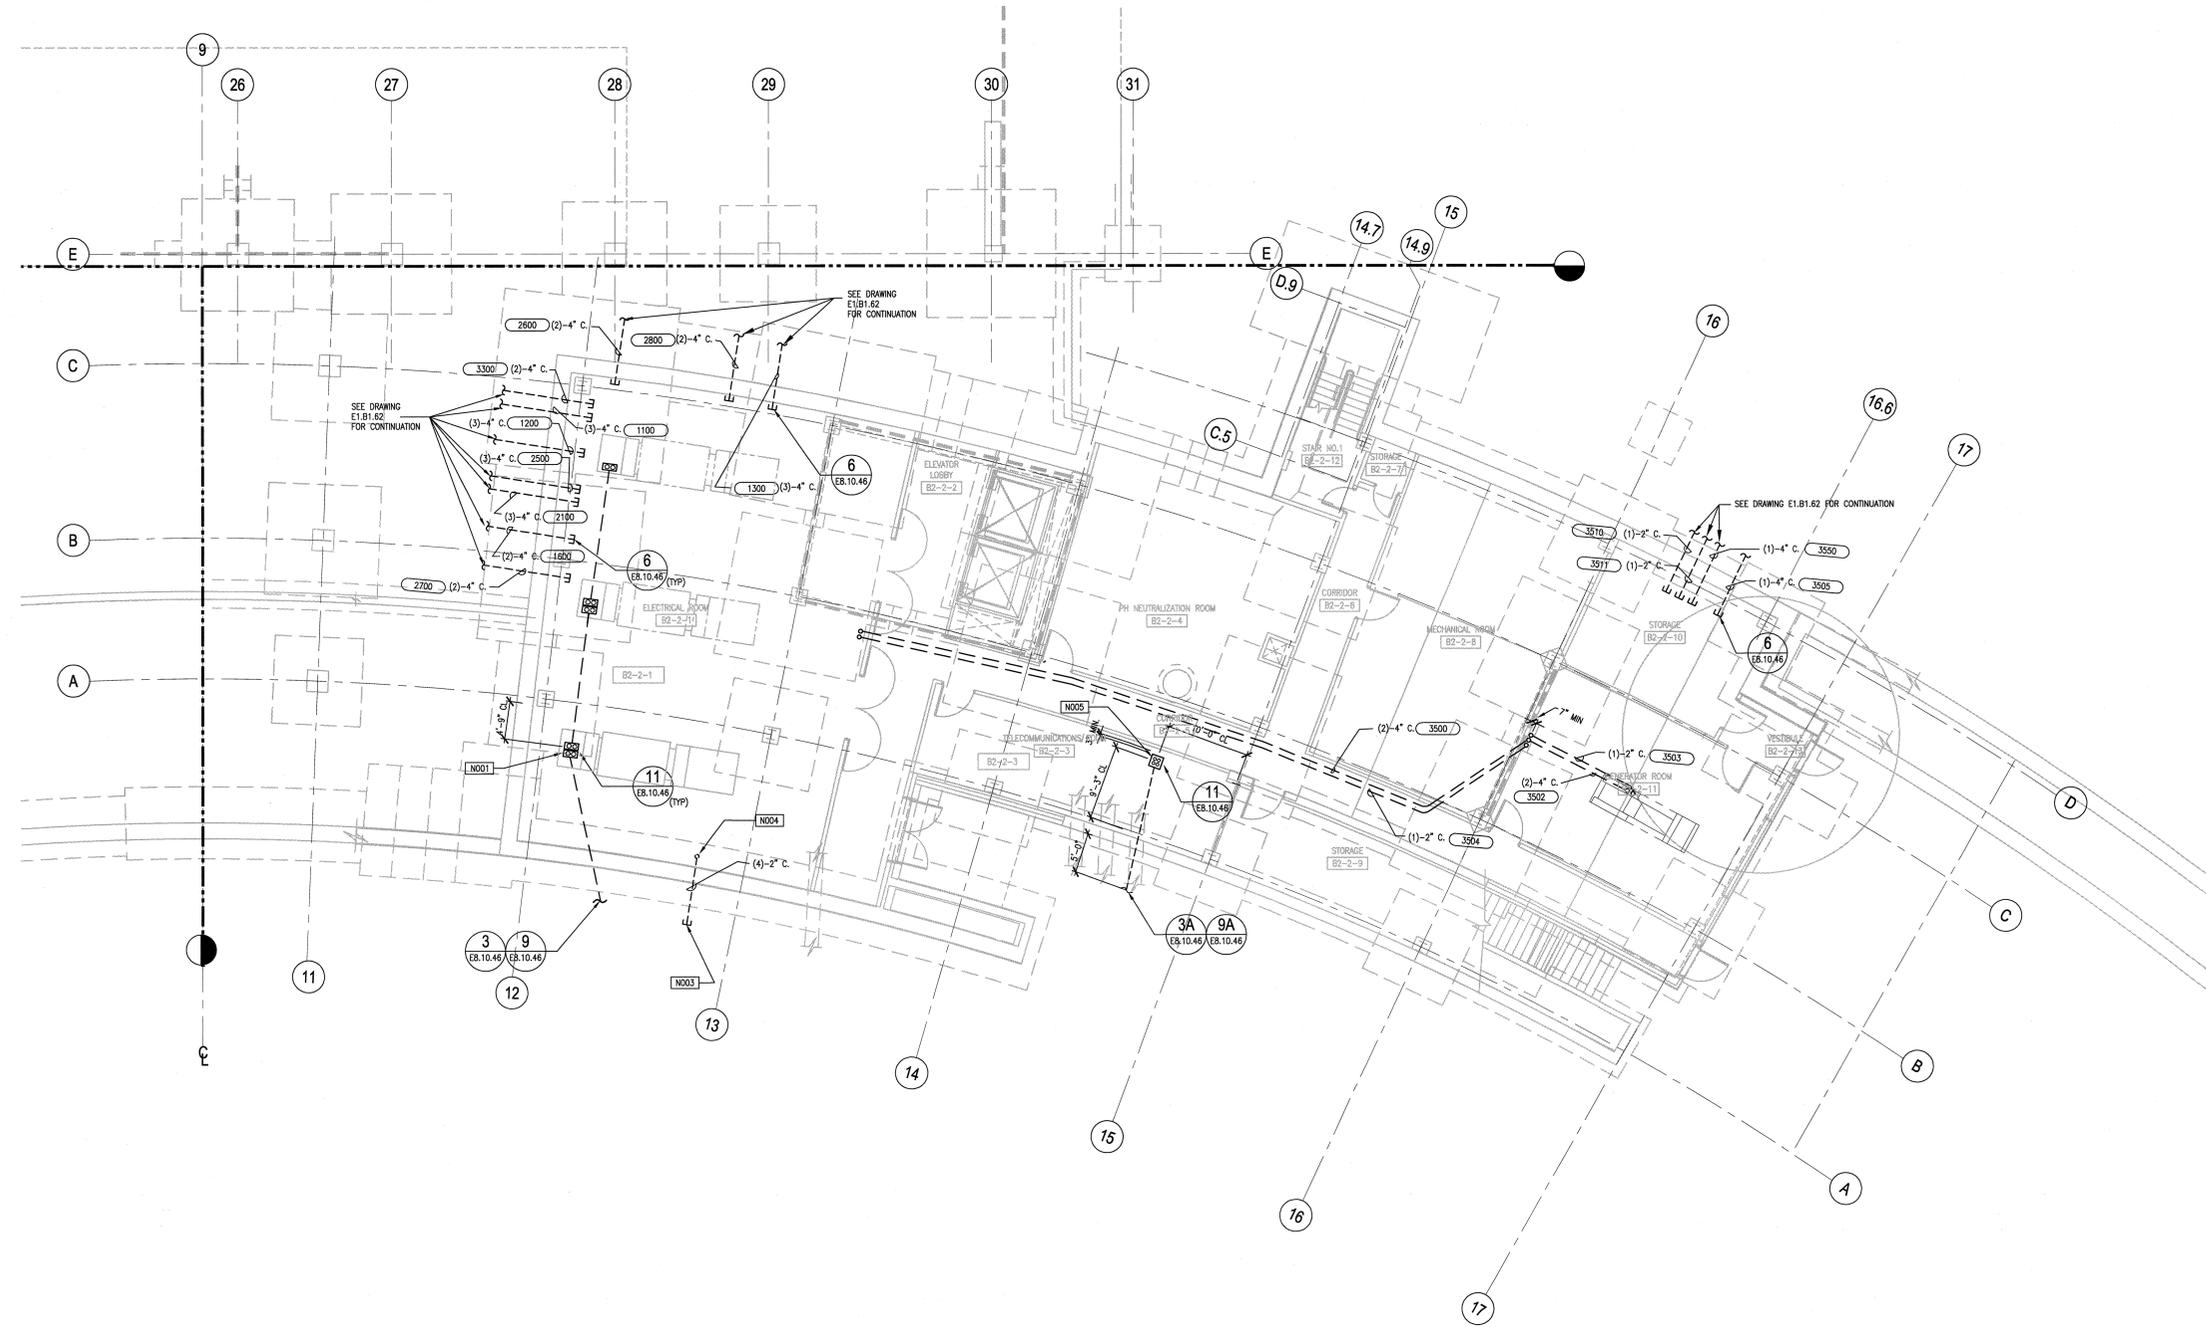

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSIGNED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST.

NUMBER OF SECTION OR DETAIL
 DRAWING ON WHICH SECTION

THIS DOCUMENT CONTROLLED BY
 CHANGE CONTROL SYSTEM

2	CERTIFIED FOR CONSTRUCTION - 12/20/01	DO	RL	10/1/01	12/20/01	VCS	106009	12/20/01	RW	AW	BMJ	PD	BMJ	BMJ	ED
1	CERTIFIED FOR CONSTRUCTION - 05/15/2001	DO	RL	10/1/01	08/21/01	VCS	106009	5/15/01	---	---	---	---	---	---	---



DSN	D.DANIELSON	5/15/01
DRW	S. BARNETT	5/15/01
CHK	R.LENNG	5/15/01
DEPT		
PE	C.GARREN	10/1/01
P.J.	J. STELLERN	8/21/01
REQ		

108031400-E8E-8600-A016

KNIGHT
 Knight Advanced Technology
 701 Scoboro Road, MS 8253
 Oak Ridge, TN 37830
 865-241-9433
 For 865-241-3400

UT-BATTELLE
 Oak Ridge National Laboratory
 managed for the DEPARTMENT OF ENERGY under
 U.S. GOVERNMENT contract DE-AC05-00OR22725
 UT-BATTELLE, LLC, a 50% State, 50% Federal

PROJECT NAME:
SPALLATION NEUTRON SOURCE
CENTRAL LAB AND OFFICE BUILDING
BUILDING UTILITY PLAN
LEVEL B2, SECTOR 62

1 | 48 | 49 | 50 | PLANT | BLDG | FL | SH. | OF | TYPE | CLASS