
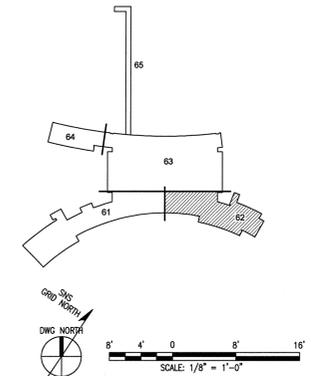


GENERAL NOTES:

- SEE DRAWINGS E9-21-52 AND E9-21-53 FOR LIGHTING PANEL SCHEDULES.
- SEE DRAWINGS E9-30-01 AND E9-30-02 FOR FIXTURE SCHEDULES.

KEYNOTES:

- N001** ALL NORMAL LIGHTING FIXTURES ON THIS DRAWING ARE CIRCUITED FROM PANEL B1L2A LOCATED IN ELECTRICAL ROOM B1-1-8.
- N002** ALL EMERGENCY LIGHTING FIXTURES AND EXIT SIGNS ON THIS DRAWING ARE CIRCUITED FROM PANEL B1ESA LOCATED IN ELECTRICAL ROOM B1-2-31.
- N003** ALL FIXTURE MOUNTING HEIGHTS ARE 9'-5" A.F.F. UNLESS OTHERWISE NOTED.
- N004** FIXTURE TYPE "W1" LOCATED IN CORRIDORS B1-2-27,29,20 ARE MOUNTED AT 12'-7" A.F.F.
- N005** FIXTURES ARE MOUNTED ON MULLIONS 6'-6" BELOW SOFFIT AND ARE CIRCUITED FROM B1L2A VIA LCP-B1-61.
- N006** W1 FIXTURE IN LOCKER ROOM AREA IS MOUNTED AT 9'-5" A.F.F.
- N007** W2 FIXTURE IN LOCKER ROOM AREA IS MOUNTED AT 9'-5" A.F.F.
- N008** FIXTURE TYPE (W1) LOCATED IN CORRIDORS BETWEEN COLUMNS 8 AND COLUMN 13 ARE MOUNTED 13'-1" A.F.F.
- N009** FIXTURE TYPE (W7) IS MOUNTED 12'-1" A.F.F. IN LIGHTSHELF.

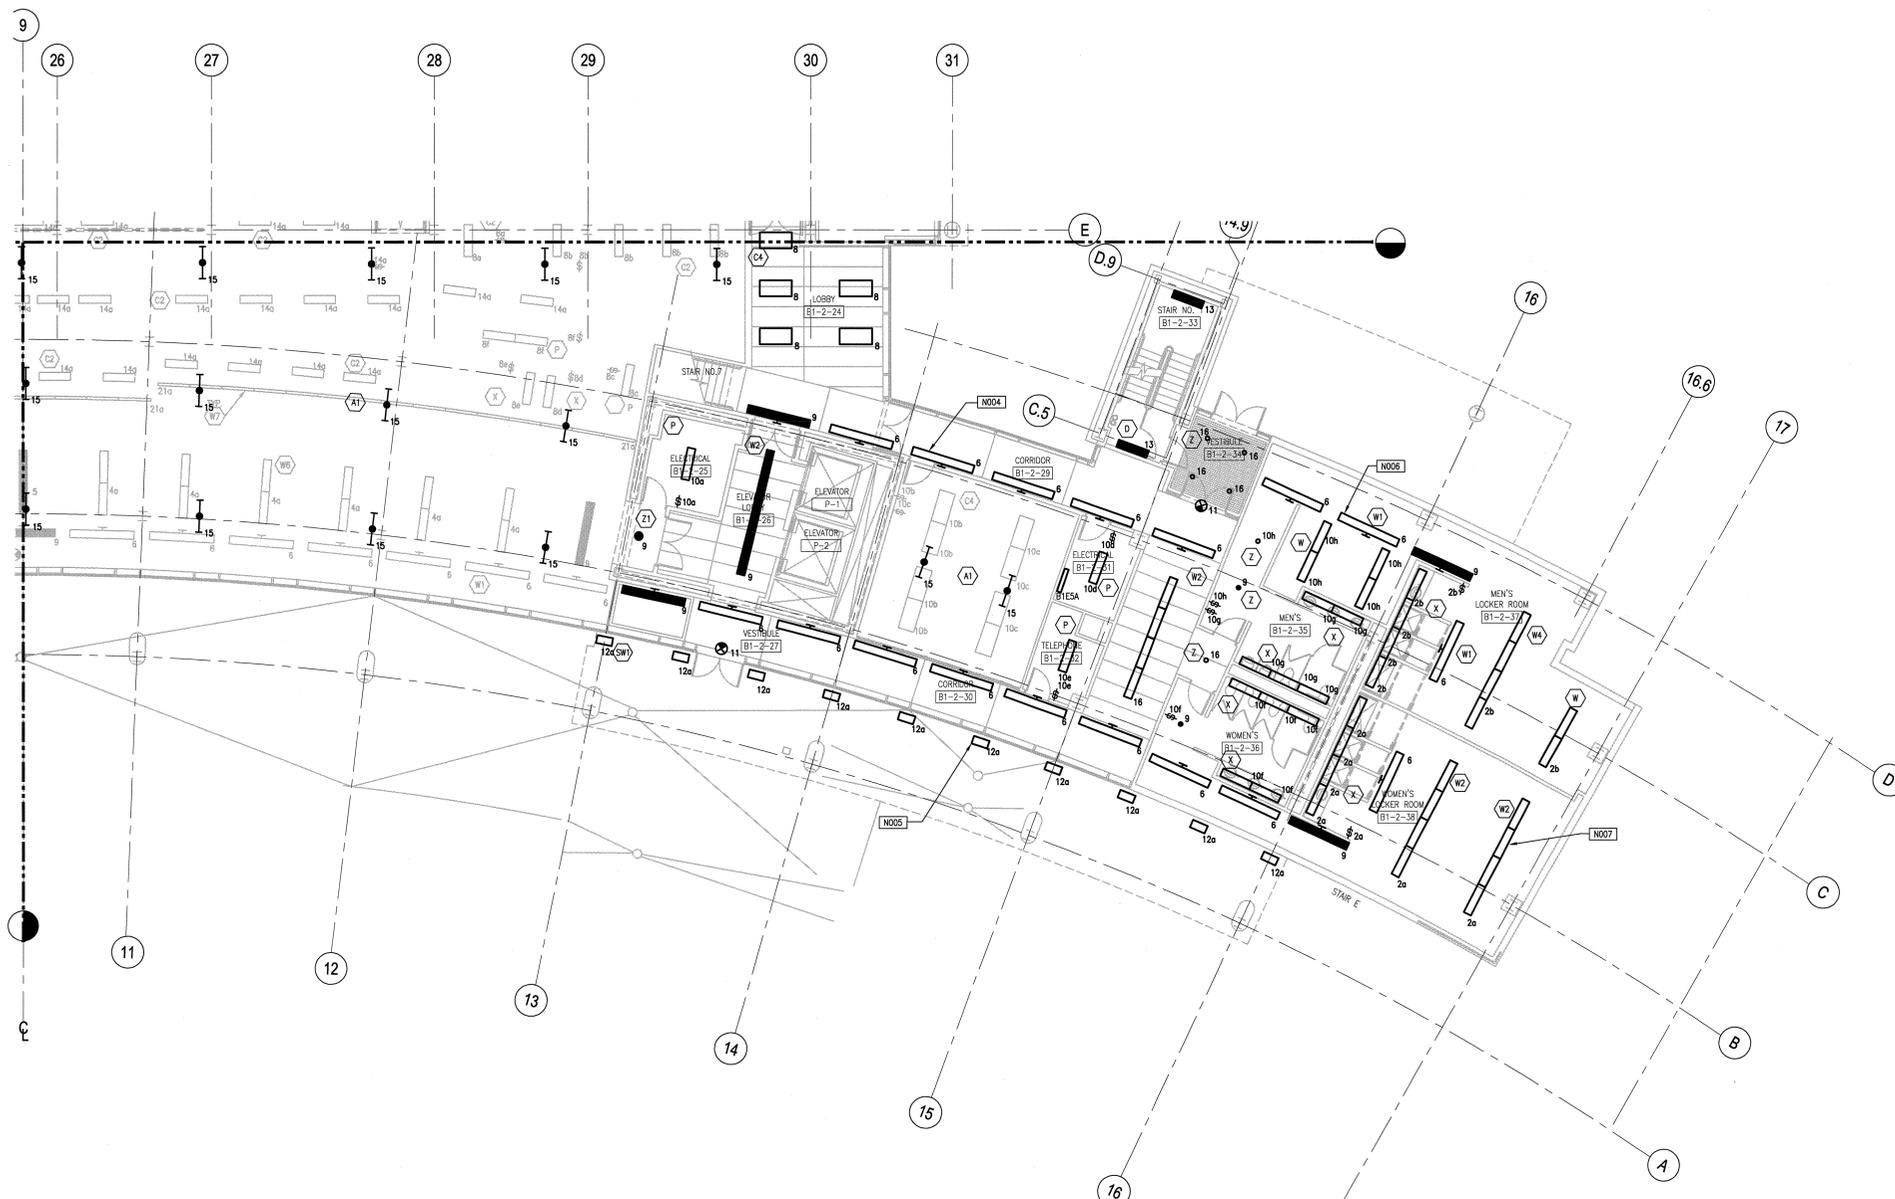

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF, ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDORS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORMING CONTRACTOR.

NUMBER OF SECTION OR DETAIL
DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN
SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY
CHANGE CONTROL SYSTEM
ENGINEERING PROCEDURE SNS-ENG-0001

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	
1		CERTIFIED FOR CONSTRUCTION - 12/20/01	TLW	KJS																								
0		CERTIFIED FOR CONSTRUCTION - 5/15/01	TLW	KJS																								

REV	DATE	DESCRIPTION	UTB	DATE	RPE	NO	DATE
1	12-17-01						

108031400-E8E-8600-A039

KNIGHT
Knight Advanced Technology
500 West Paddock Street
Chattanooga, TN 37417

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725

PROJECT NAME:
SPALLATION NEUTRON SOURCE
CENTRAL LAB AND OFFICE BUILDING
LEVEL B1, SECTOR 62

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8600		1	1	P	U
51	NC	52	NA	53	WBS					
					1.8.3.14					E3.B1.62

REV 1