
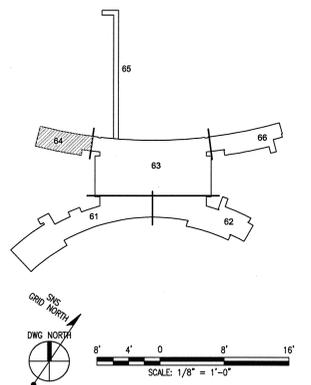


GENERAL NOTES:

1. CONNECT ALL CIRCUITS TO PANEL 2SR1B UNLESS NOTED OTHERWISE.

KEYNOTES:

- N001 SEE DRAWING E8.10.42 FOR ELECTRICAL ROOM ENLARGED PLAN.
- N002 CONNECT ALL CIRCUITS FOR FAN POWERED HOT WATER TERMINAL UNITS TO PANEL 2R1A. (TYP. 2)
- N003 LEAVE CIRCUITS COILED-UP IN J-BOX FOR FUTURE USE. (TYP.)

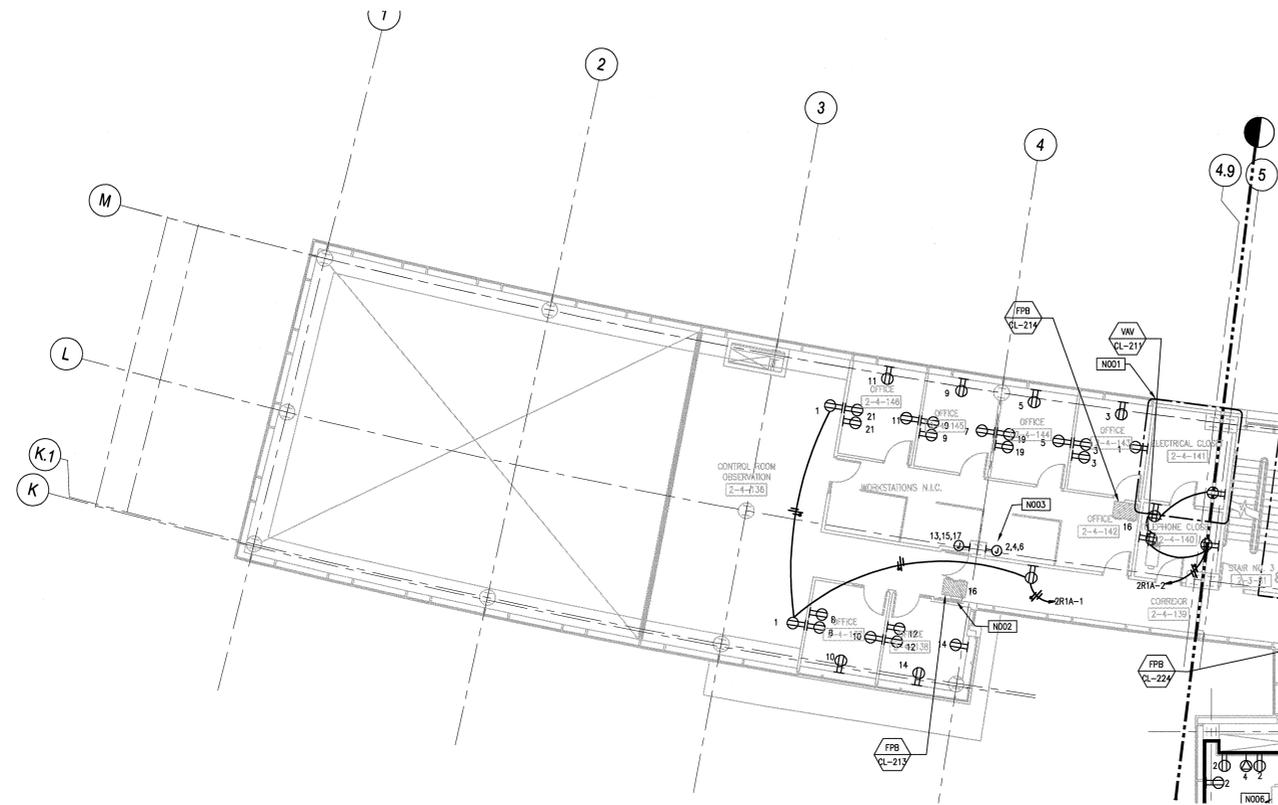


108031400-E8E-8600-A052

KNIGHT
Knight Advanced Technology
475 Oak Street, Suite 200
Plymouth, NJ 08054

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725
UT-BATTELLE, LLC, a Oak Ridge, Tennessee

PROJECT NAME: SPALLATION NEUTRON SOURCE
CENTRAL LAB AND OFFICE BUILDING
ELECTRICAL POWER PLAN
LEVEL 2, SECTOR 64

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8600		1	1	P	U
51	52	53	WBS							
NC	NA	5.3	1.8.3.14							E4.02.64
										REV 0



DSN	R.O. LAPOUR	5/15/01
DRW	S. BARNETT	5/15/01
CHK	R. LENNING	5/15/01
DEPT		
PE	<i>[Signature]</i>	5/15/01
PJ	<i>[Signature]</i>	5/15/01
REQ		

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	NO	DATE
0		CERTIFIED FOR CONSTRUCTION - 05/15/2001															

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS ENCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS ENCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY CHANGE CONTROL SYSTEM 4

ENGINEERING PROCEDURE SNS-ENG-0201