
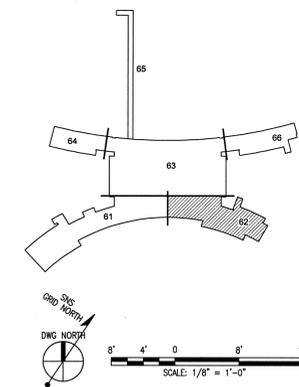


GENERAL NOTES:

- 1. CONNECT ALL RECEPTACLES TO PANEL SRSA UNLESS NOTED OTHERWISE.
- 2. SEE DRAWINGS 2.10.44 AND E3.10.45 FOR 480VAC MECHANICAL EQUIPMENT FEEDER SIZES.
- 3. MOTORS ARE PROVIDED WITH MECHANICAL EQUIPMENT AND SHOWN FOR CLARITY ONLY.

KEYNOTES:

- ND001 CONNECT ALL CIRCUITS FOR HOT WATER CABINET HEATERS TO PANEL SRSA. (TYP.)

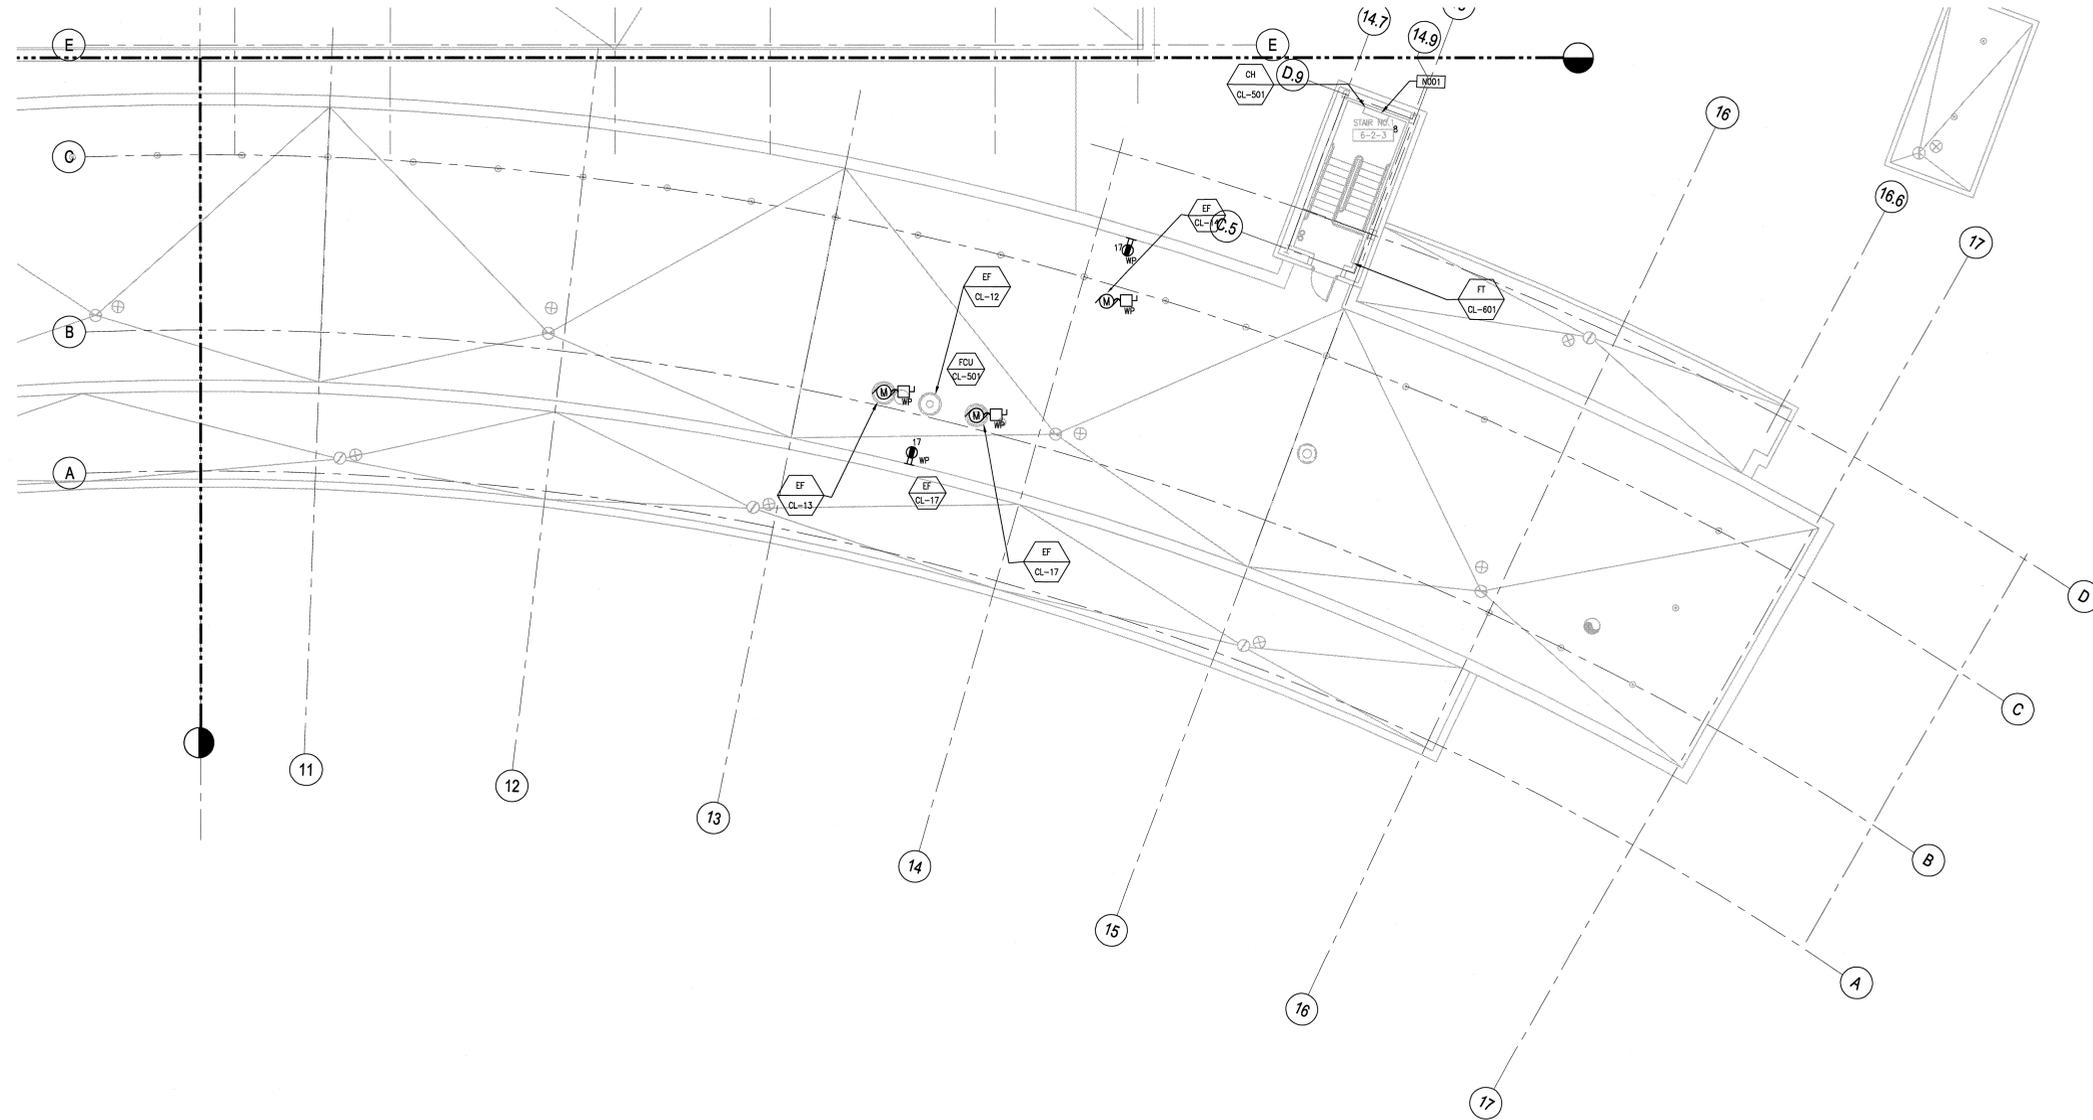

108031400-E8E-8600-A065

**KNIGHT**  
Knight Advanced Technology  
4711 East Dyer, Suite 100  
Memphis, TN 38118

**UT-BATTELLE**  
Oak Ridge National Laboratory  
managed for the DEPARTMENT OF ENERGY under  
U.S. GOVERNMENT contract DE-AC05-00OR22725  
UT-BATTELLE, LLC, Oak Ridge, Tennessee

PROJECT NAME:  
**SPALLATION NEUTRON SOURCE  
CENTRAL LAB AND OFFICE BUILDING  
ELECTRICAL POWER PLAN  
ROOF LEVEL, SECTOR 62**

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8600	1	1	P	U	
51	NC	52	NA	53	WBS	1.8.3.14			E4.09.62	REV 0

REV	DATE	DESCRIPTION	DSN	CHK	DEPT	PE	DATE	PJ	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE
0		CERTIFIED FOR CONSTRUCTION - 05/15/2001	DD	RL												
1	05/15/01	ISSUED FOR CONSTRUCTION	DD	RL												

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

THIS DOCUMENT CONTROLLED BY  
CHANGE CONTROL SYSTEM 4  
ENGINEERING PROCEDURE SNS-ENG-0201

SECTION AND DETAIL KEY

AutoCAD