
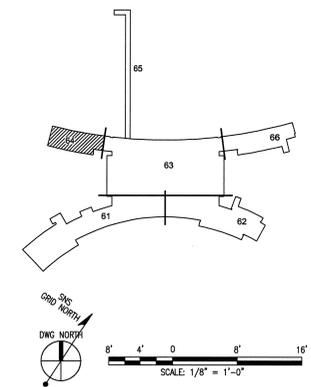
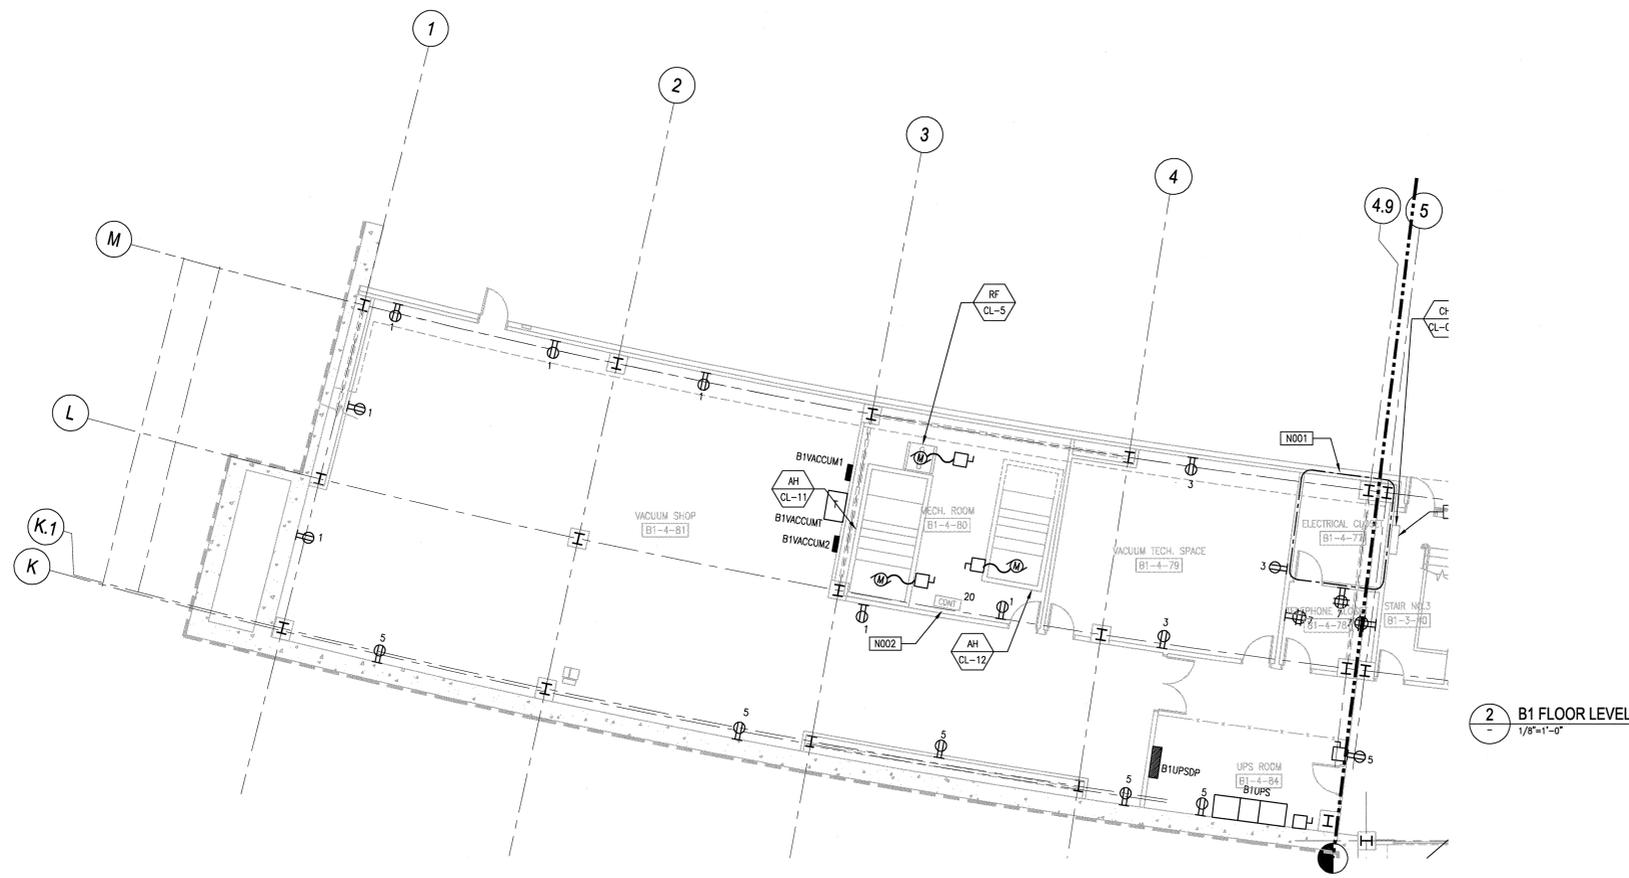


GENERAL NOTES:

- CONNECT ALL CIRCUITS TO PANEL B1R1A UNLESS NOTED OTHERWISE.
- REFER TO DRAWING E2.10.44 AND E2.10.45 FOR 480VAC MECHANICAL EQUIPMENT FEEDER SIZES UNLESS NOTED OTHERWISE.
- MOTORS ARE PROVIDED WITH MECHANICAL EQUIPMENT AND SHOWN FOR CLARITY ONLY.

KEYNOTES:

- N001 SEE DRAWING E8.10.40 FOR ENLARGED PLAN OF THE ELECTRIC ROOM.
- N002 CONNECT 120VAC, 20A 1 PH CIRCUIT FOR EACH MECHANICAL CONTROL ENCLOSURE FROM PANEL B1R1A. (ENCLOSURE PROVIDED BY OTHERS)

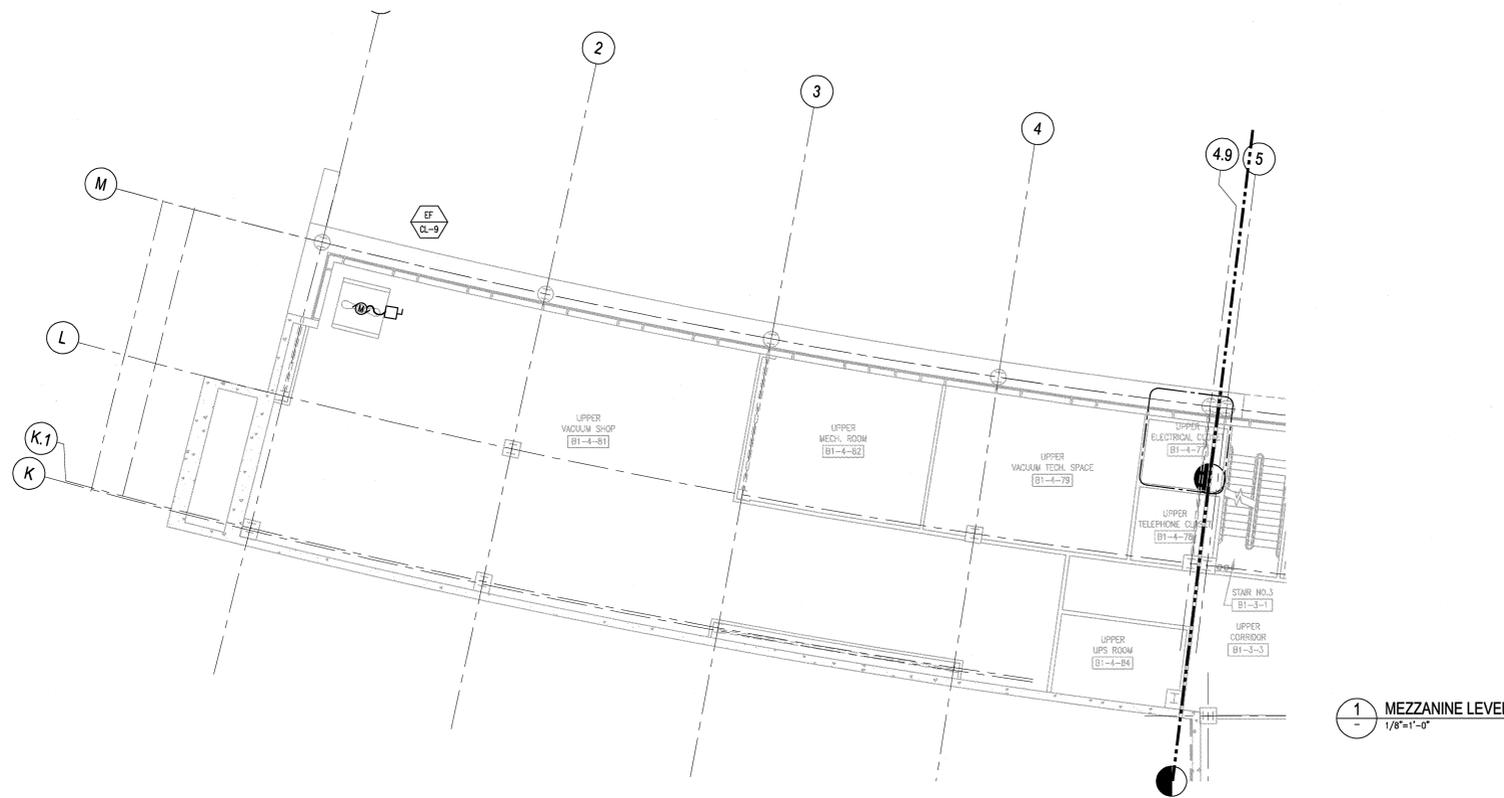

108031400-E8E-8600-A073

KNIGHT
Knight Advanced Technology
4712 Oak Forest, Suite 100
Phone: 865-241-3400

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725
UT-BATTELLE, LLC • Oak Ridge, Tennessee

PROJECT NAME:
**SPALLATION NEUTRON SOURCE
CENTRAL LAB AND OFFICE BUILDING
ELECTRICAL POWER PLAN
LEVEL B1, SECTOR 64**

1	4B	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8600	1	1	1	P	U
51	52	53	WBS	1.8.3.14						
NC	NA									E4.B1.64

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO BIDDERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FURNISHING CONTRACTOR.

SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY CHANGE CONTROL SYSTEM ENGINEERING PROCEDURE SNG-ENG-0001

REV	DATE	BY	CHK	DEPT	DATE	REQ	DATE	UTB	DATE	RPE	NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR	
0																							

RPE

DSN D.DANIELSON 5/15/01
DRW S.BARNETT 5/15/01
CHK R.LENNING 5/15/01

DEPT
PE
PJ
REQ

0 5-10-01

REV. DATE

UTB
DRAWING APPROVALS

