
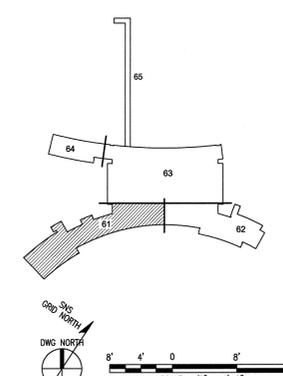


GENERAL NOTES:

- 1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E.0.00.01
- 2. CABLE TRAY FOR VOICE/DATA WIRING ONLY. MOUNT BOTTOM OF TRAY 1'-0" ABOVE FINISHED CEILING.
- 3. PROVIDE SLEEVED OPENING FOR ALL TELEPHONE ROOM FLOOR PENETRATIONS. REFER TO DWG. E8.20.40 FOR CONDUIT QTY AND SIZE AND DWG. E8.10.47 DETAIL 5.

KEYNOTES:

- NO01** SEE SHEN, MILSON & WILKE CONSULTS DWG. N3.01.61 FOR AUDIO SYSTEMS REQUIREMENTS IN THIS AREA.
- NO02** CENTER THE FLOOR MOUNT VOICE/DATA BOX WITHIN ROOM. (TYP)
- NO03** CONNECT P.A. SPEAKERS TO AMPLIFIER 1-PA2 LOCATED IN TELEPHONE ROOM 1-1-23.

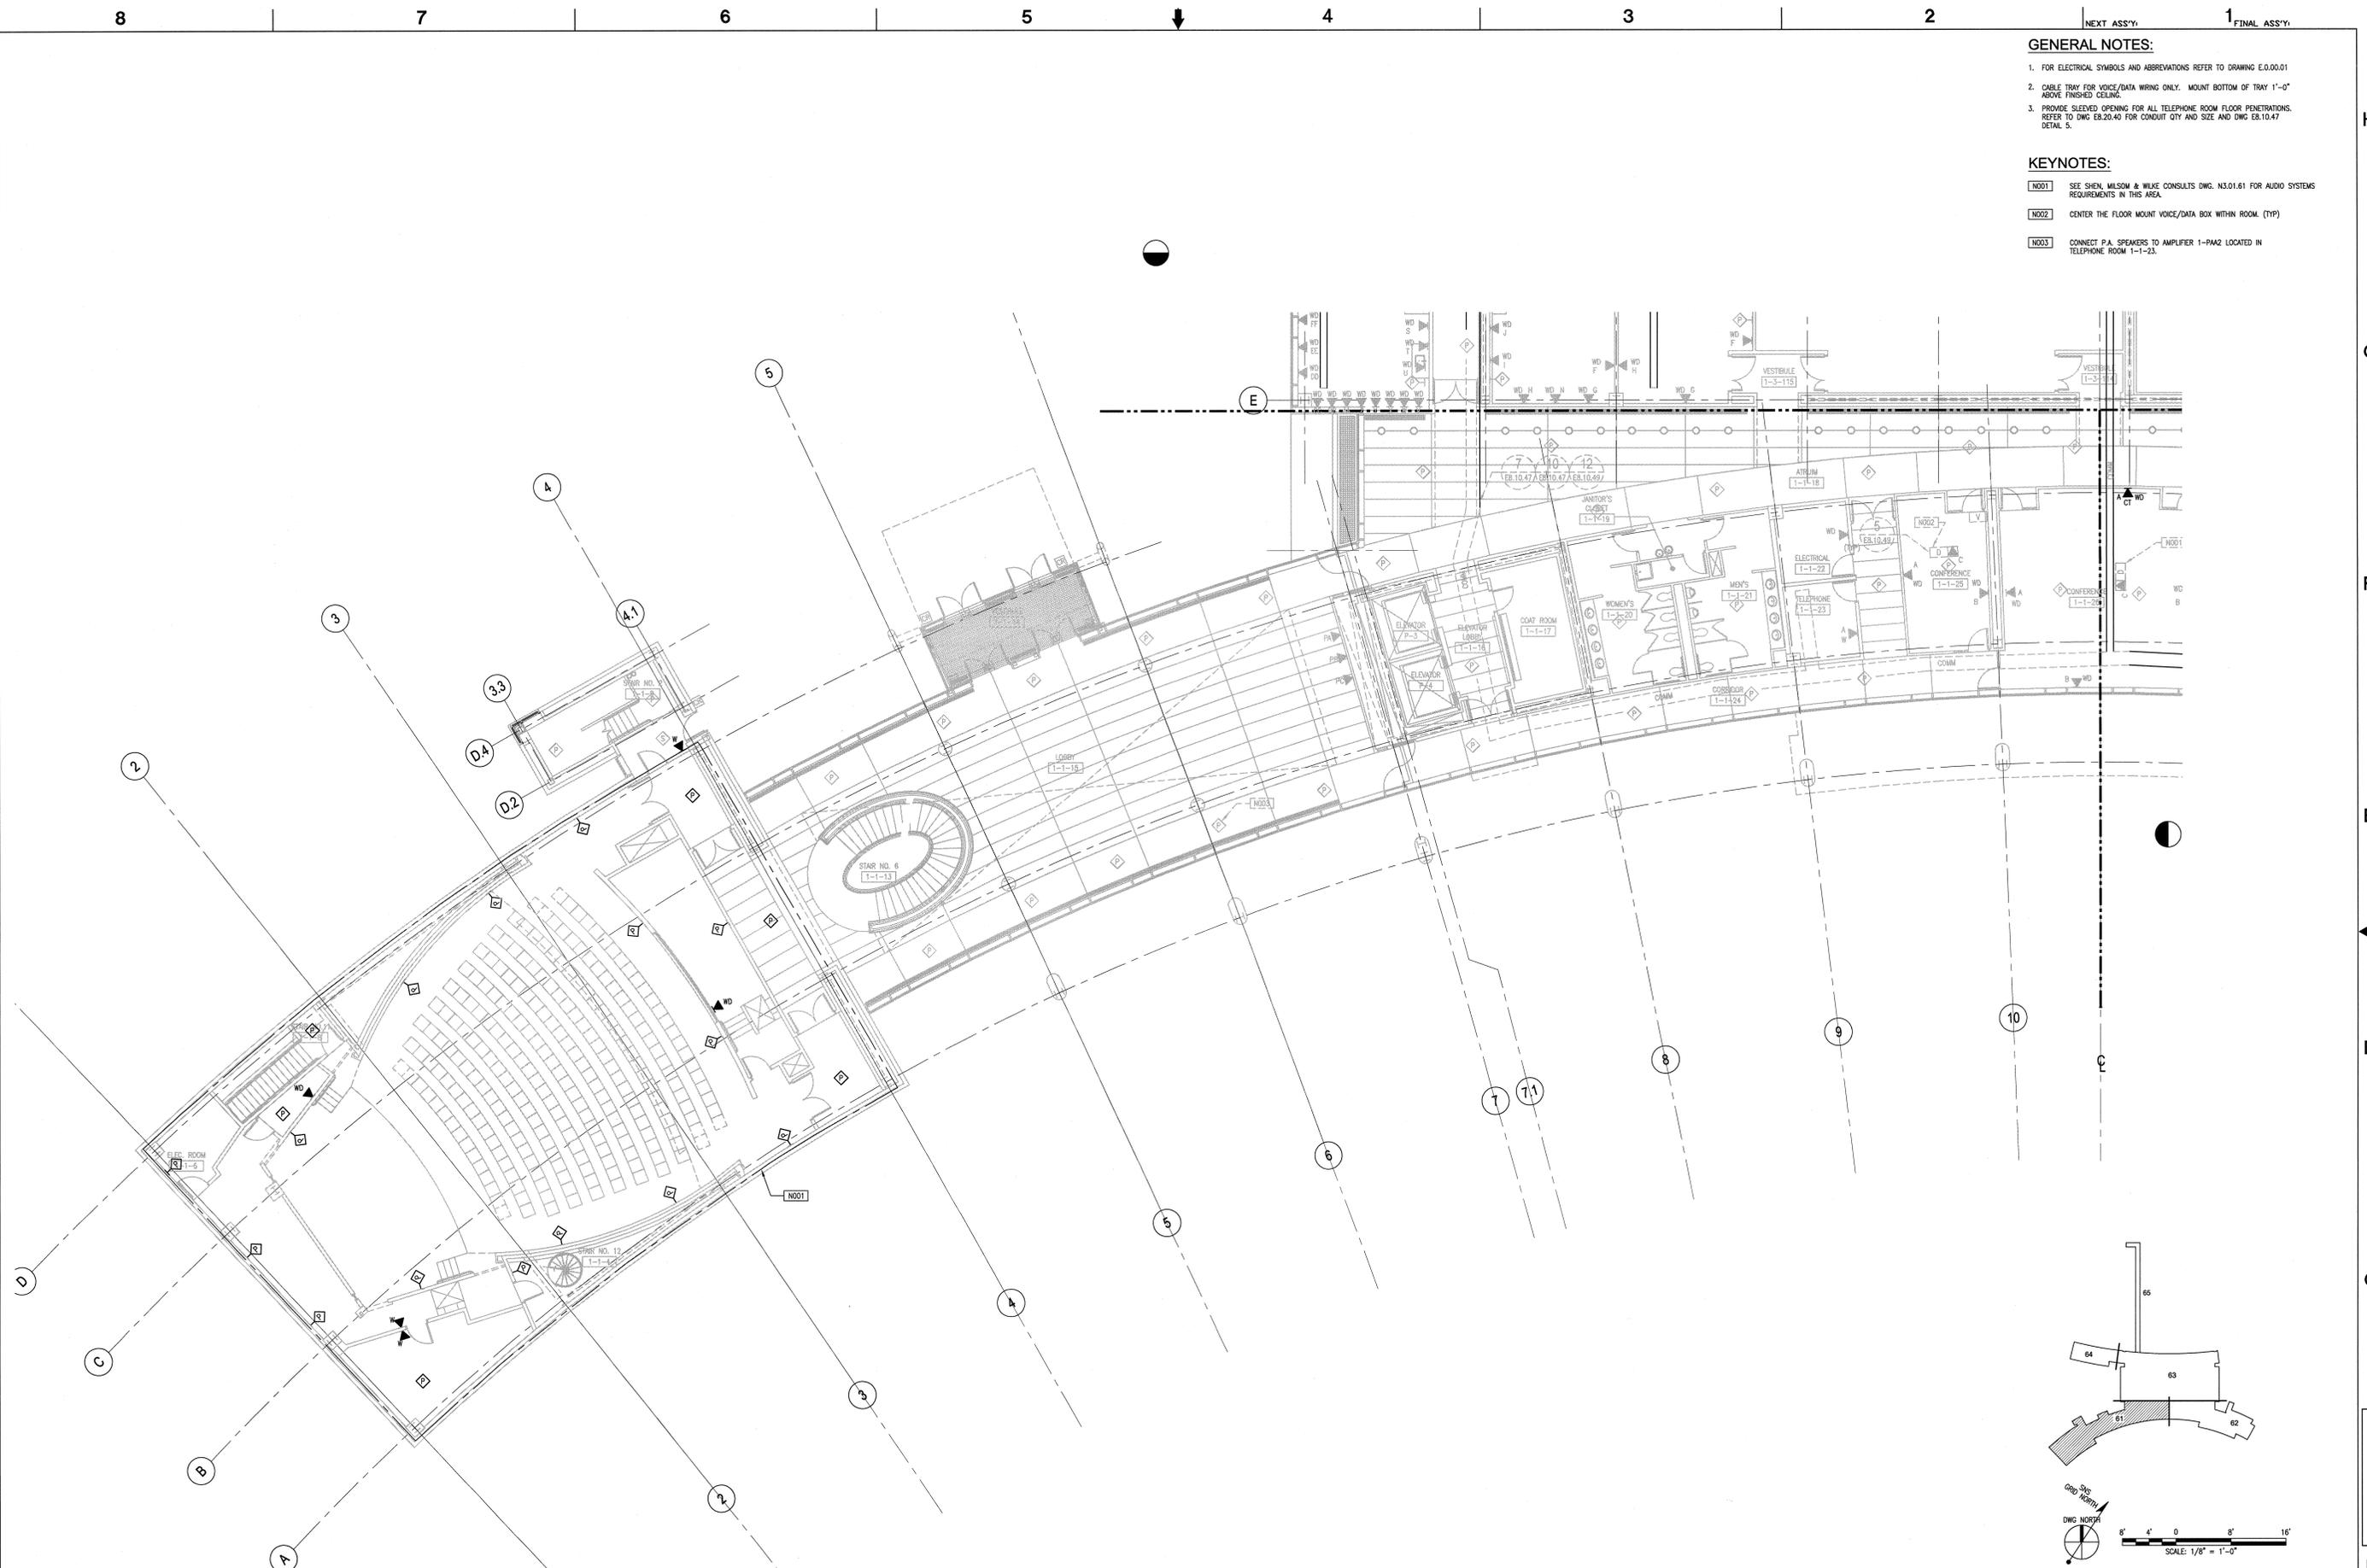

108031400-E8E-8600-A207

	Knight Jacobs Joint Venture 701 Scarbora Road, MS 8253 Oak Ridge, TN 37830 865-241-9433 Fax 865-241-3400	KNIGHT Knight Advanced Technology <small>©19 East, Ahead, Bold #1 Memphis, TN</small>
	Knight Advanced Technology Oak Ridge National Laboratory	