



**GENERAL NOTES:**

- FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E.0.00.01
- CABLE TRAY FOR VOICE/DATA WIRING ONLY. MOUNT BOTTOM OF TRAY 1'-0" ABOVE FINISHED CEILING.
- PROVIDE SLEEVED OPENING FOR ALL TELEPHONE ROOM FLOOR PENETRATIONS. REFER TO DWG EB.20.40 FOR CONDUIT QTY AND SIZE AND DWG EB.10.47 DETAIL 5.

**KEYNOTES:**

**ND001** CENTER THE FLOOR MOUNT VOICE/DATA BOX WITHIN ROOM. (TYP)

**ND002** CONNECT ALL P.A. SPEAKERS TO AMPLIFIER 2-PA42 LOCATED IN TELEPHONE ROOM 2-1-8.

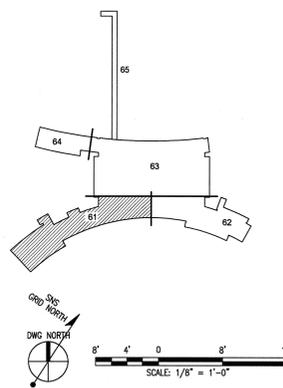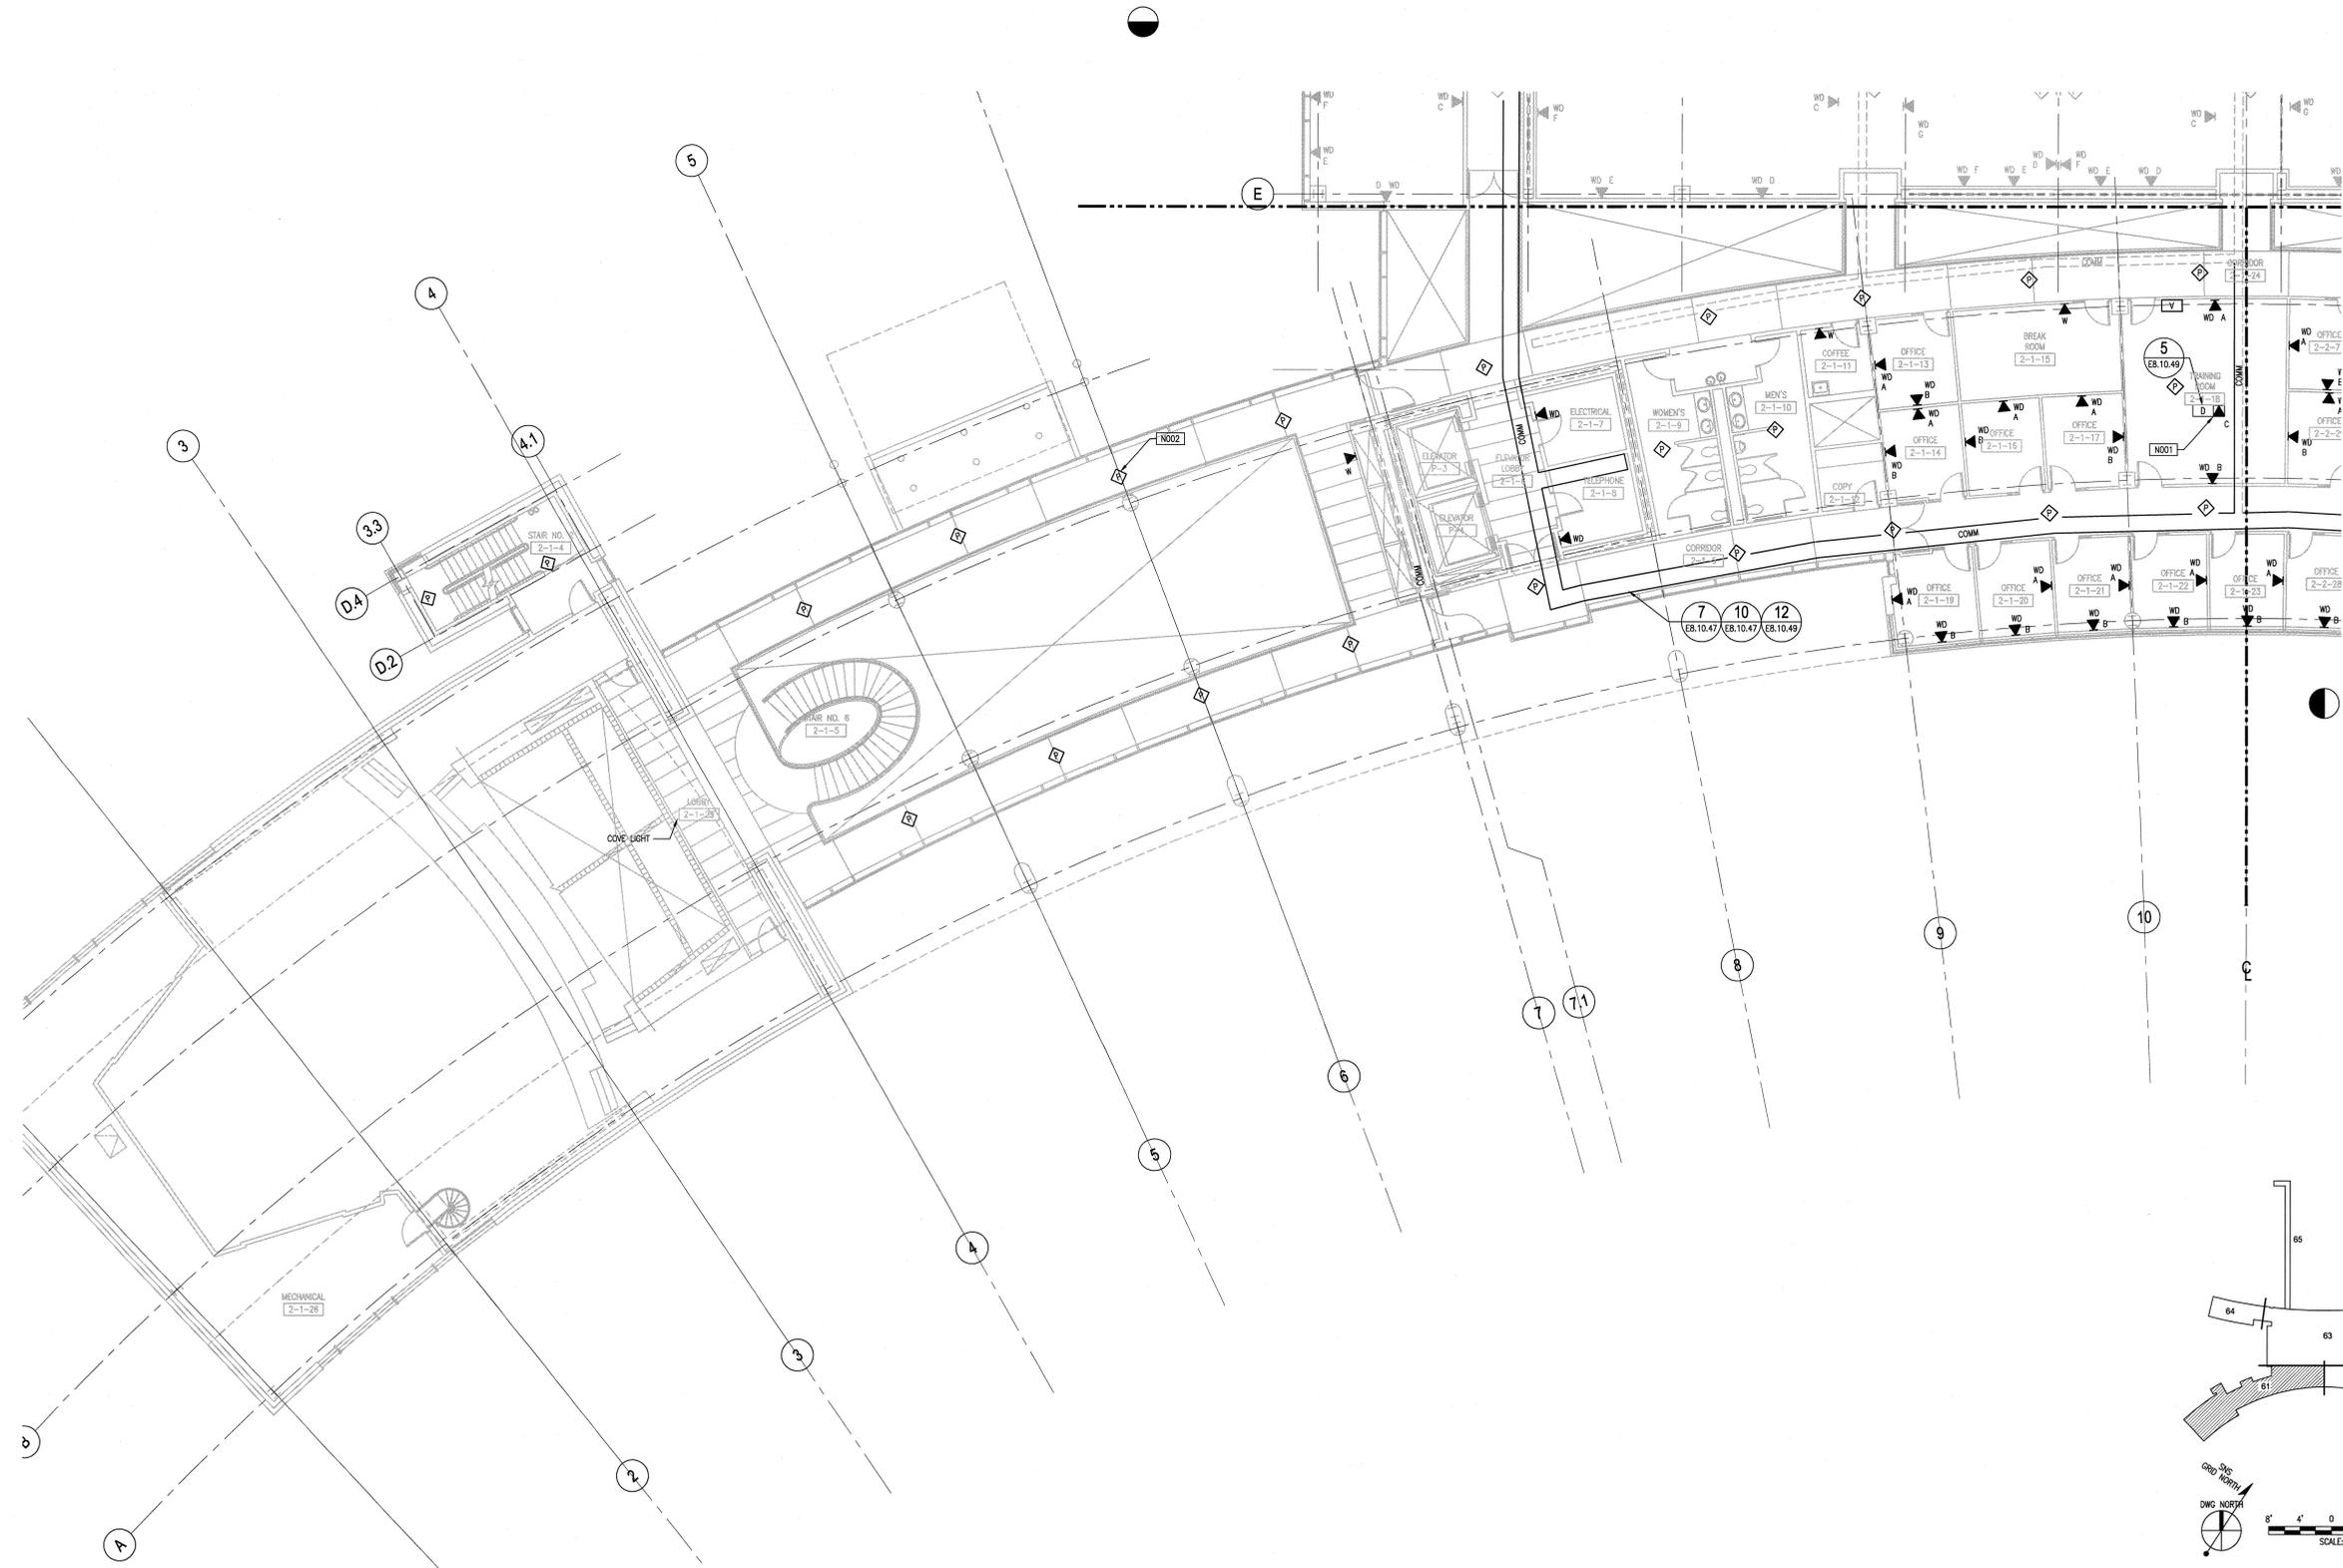

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO OTHERS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

NUMBER OF SECTION OR DETAIL

DRAWING ON WHICH SECTION OR DETAIL IS SHOWN OR TAKEN

THIS DOCUMENT CONTROLLED BY

CHANGE CONTROL SYSTEM

ENGINEERING

REV	DATE	BY	CHKD	APP'D	DESCRIPTION	REV	DATE	BY	CHKD	APP'D	DESCRIPTION
1	12/20/01	RL	VS		CERTIFIED FOR CONSTRUCTION - 12/20/01	DD	RL				
0	05/15/2001	VS			CERTIFIED FOR CONSTRUCTION - 05/15/2001	LP	VS				

DSN	L. PACHECO	5/15/01
DRW	CAD	5/15/01
CHK	V. STEFFEN	5/15/01
DEPT		
PE	C. GARREN	10/1/01
PJ	J. STELLERN	8/21/01
REQ		

108031400-E8E-8600-A081

**KNIGHT**  
 Knight Advanced Technology  
 4212 East Street, Suite #8  
 Knoxville, TN 37920  
 865-241-9433  
 Fax 865-241-3400

**UT-BATTELLE**  
 Oak Ridge National Laboratory  
 managed for the DEPARTMENT OF ENERGY under  
 U.S. GOVERNMENT contract DE-AC05-00OR22725  
 424 Central Expressway, Oak Ridge, Tennessee

PROJECT NAME:  
**SPALLATION NEUTRON SOURCE**  
**CENTRAL LAB AND OFFICE BUILDING**  
**ELECTRICAL COMMUNICATIONS PLAN**  
**LEVEL 2, SECTOR 61**

1	48	49	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8600	1	1	P	U	

AutocAD