
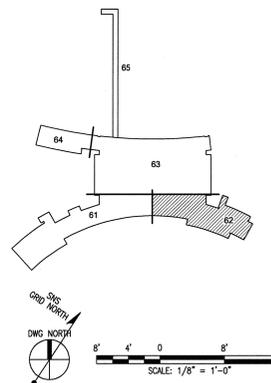


GENERAL NOTES:

- 1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E.0.00.01
- 2. CABLE TRAY FOR VOICE/DATA WIRING ONLY. MOUNT BOTTOM OF TRAY 1'-0" ABOVE FINISHED CEILING.
- 3. PROVIDE SLEEVED OPENING FOR ALL TELEPHONE ROOM FLOOR PENETRATIONS. REFER TO DWG E8.00.40 FOR CONDUIT QTY AND SIZE AND DWG E8.10.47 DETAIL 5.

KEYNOTES:

- NO01 MOUNT JUNCTION J-BOX IN THE CEILING SPACE BENEATH THE ABOVE FLOOR SLAB. CONNECT TO CABLE TRAY WITH 3/4" C.(TYP)
- NO02 CENTER THE FLOOR MOUNT VOICE/DATA WITHIN ROOM. (TYP)
- NO03 CONNECT ALL P.A. SPEAKERS TO AMPLIFIER 2-PA1 LOCATED IN TELEPHONE ROOM 2-3-122.

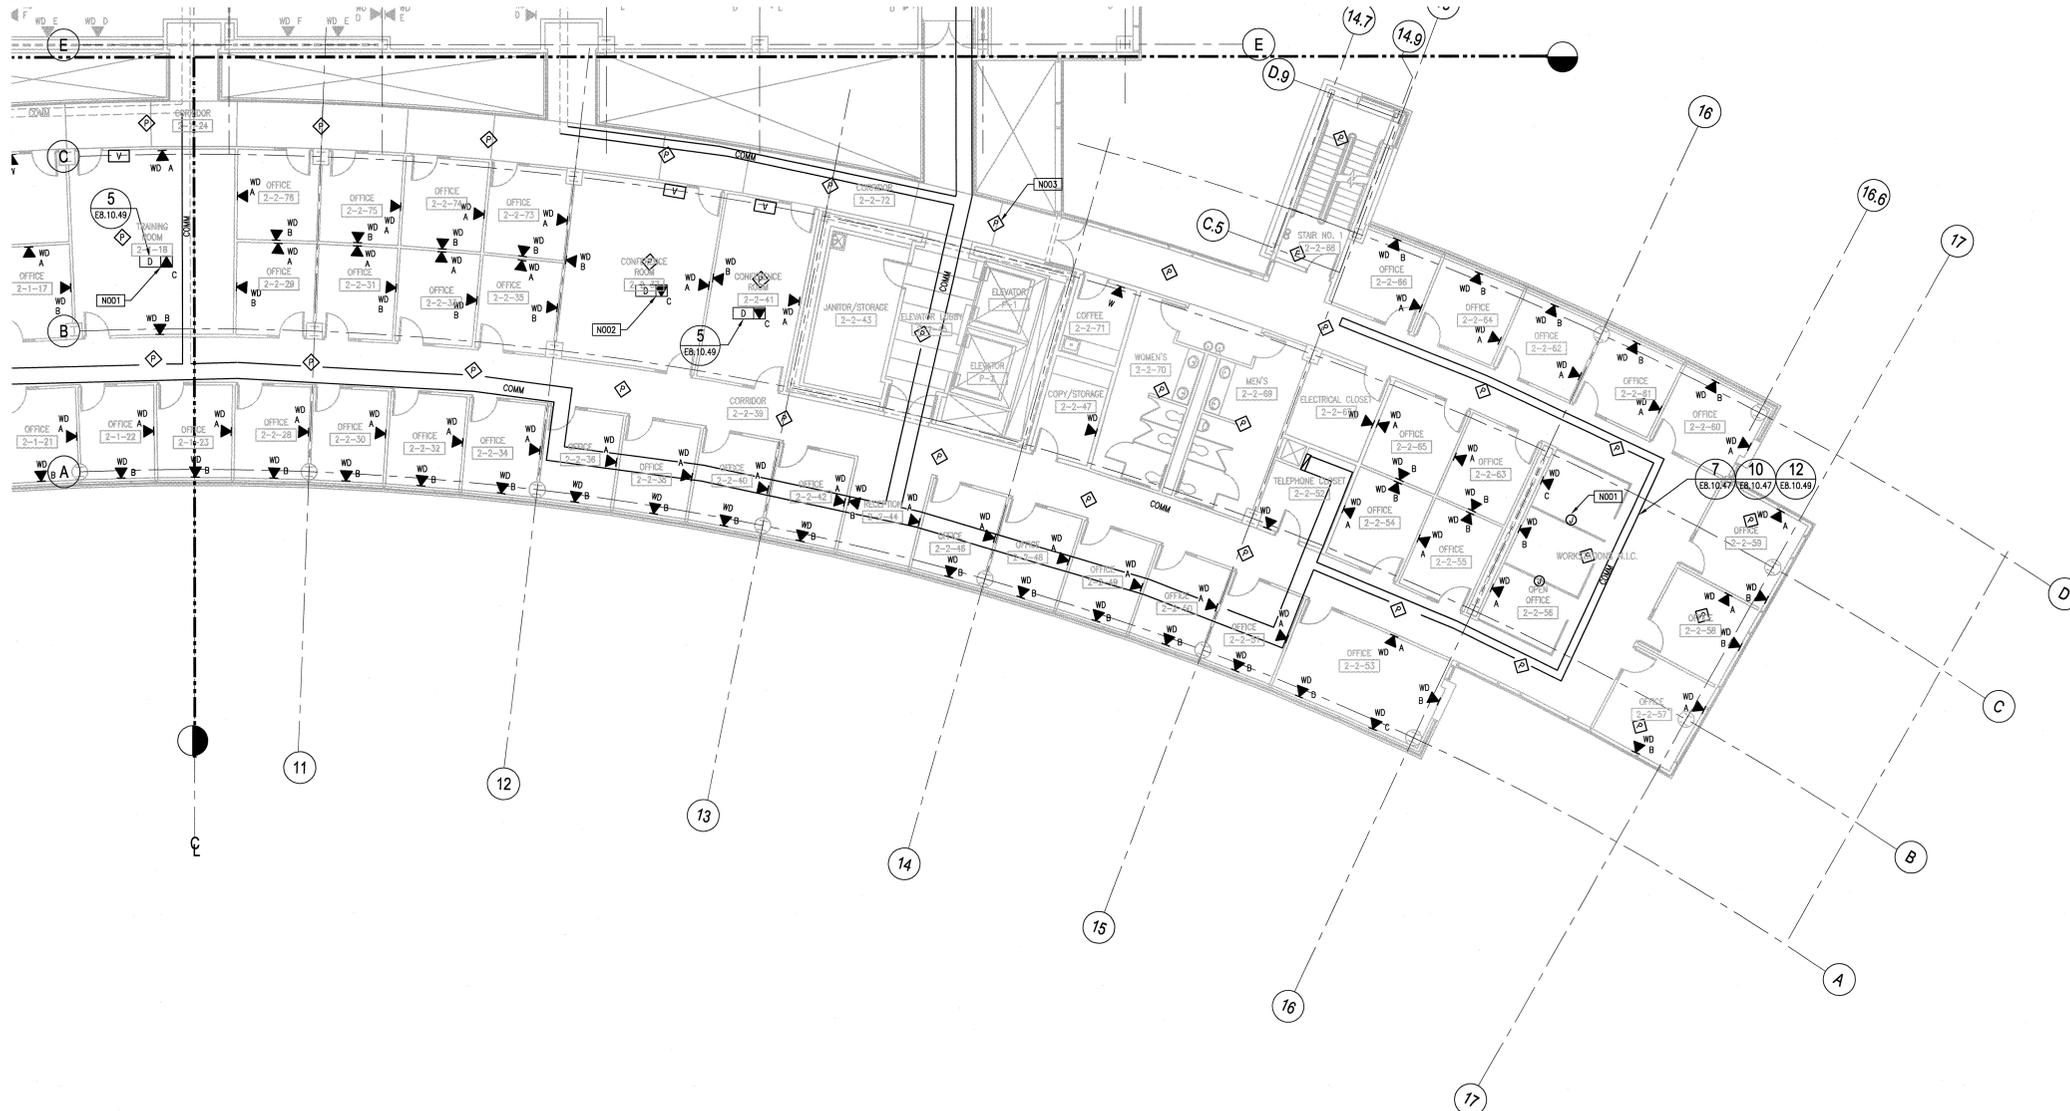

108031400-E8E-8600-A082

KNIGHT
Knight Advanced Technology
4710 East Dumbell, Suite #1
Phoenix, AZ 85044

UT-BATTELLE
Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725
UT-BATTELLE, LLC, Oak Ridge, Tennessee

PROJECT NAME:
SPALLATION NEUTRON SOURCE

CENTRAL LAB AND OFFICE BUILDING
ELECTRICAL COMMUNICATIONS PLAN
LEVEL 2, SECTOR 62

T1	48	48	50	PLANT	BLDG	FL	SH.	OF	TYPE	CLASS
3	E	X	X	8	8000	1	1	P	U	REV
51	52	53	WBS	1.8.3.14	E6.02.62	1				
NC	NA									

DSN	L. PACHECO	5/15/01
DRW	CAD	5/15/01
CHK	V. STEFFEN	5/15/01
DEPT		
PE	C. GARREN	10/1/01
PJ	J. STELLERN	8/21/01
REQ		
REV.	DATE	BY
1	12-17-01	J. JAWSON
10/8/01		

REV	TYPE	DATE	DESCRIPTION	DSN	CHK	DEPT	DATE	REQ	DATE	UTB	DATE	RPE	RPE NO	DATE	ST	CV	EC	EE	EM	IE	M	PD	SE	AR
1			CERTIFIED FOR CONSTRUCTION - 12/26/01	DD	RL		08/21/01																	
0			CERTIFIED FOR CONSTRUCTION - 05/15/2001	LP	VS		08/21/01																	

NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THAT THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS MAY NOT INFRINGE PRIVATE RIGHTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE, COPY, OR FOR DAMAGES RESULTING FROM THE USE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION TO REECS ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORWARDING CONTRACTOR.

SECTION AND DETAIL KEY

THIS DOCUMENT CONTROLLED BY
CHANGE CONTROL SYSTEM 4
ENGINEERING PROCEDURE SNS-ENG-0201

AutoCAD